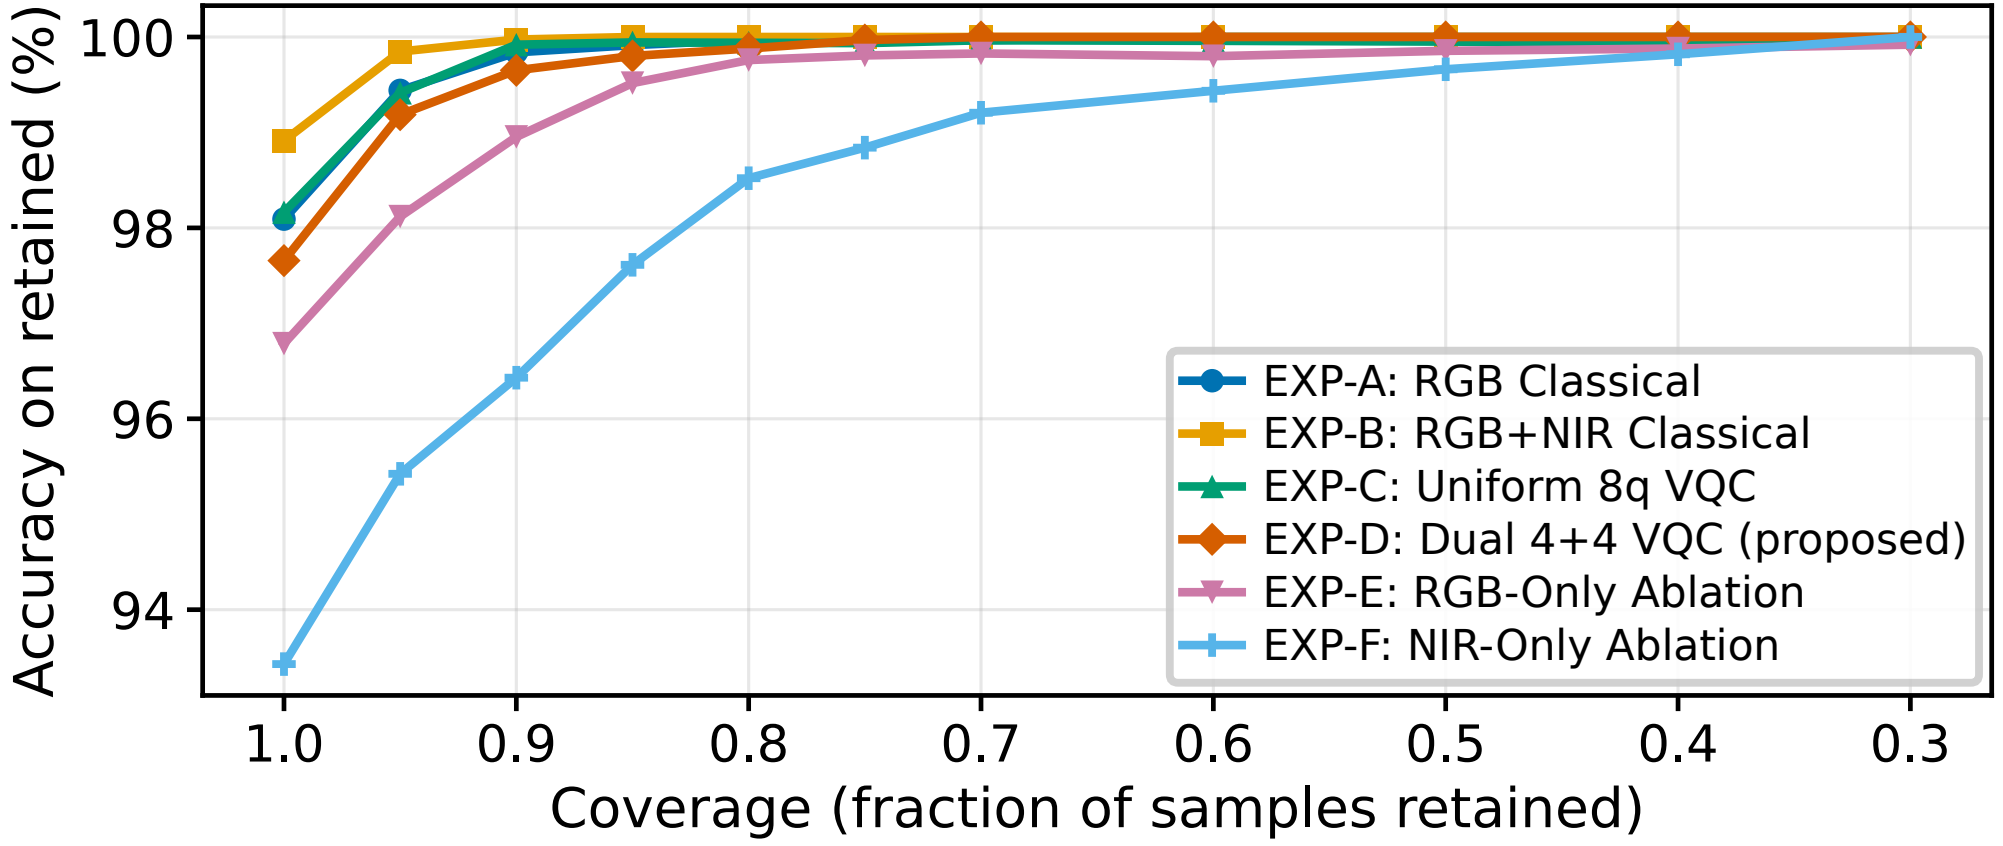
Accuracy on retained (%)
100
98
96
94
1.0
0.9
0.8
0.7
0.6
0.5
0.4
0.3
Coverage (fraction of samples retained)
EXP-A: RGB Classical
EXP-B: RGB+NIR Classical
EXP-C: Uniform 8q VQC
EXP-D: Dual 4+4 VQC (proposed)
EXP-E: RGB-Only Ablation
EXP-F: NIR-Only Ablation