Unique Electrodes™

Down to Earth....

Complete

Earthing & Lightning

Protection Solutions

Manufacturer of
Chemical Erthing & Lighting
Protection System



TESTED BY

CPRI APPROVED

ISO 9001:2015 CERTIFIED COMPANY

NABL

ERDA


UNIQUE®
Down to Earth....

ABOUT UNIQUE ELECTRODES

Unique Electrodes is committed to delivering high-quality earthing and lightning protection solutions for industrial, commercial, infrastructure, and residential applications.

With a focus on quality, innovation, and safety, we provide products that help protect people, equipment, and electrical systems from faults and lightning-related risks.

WHAT WE OFFER



Chemical Earthing Electrodes



Copper Bonded Earthing Rods



Hot Dib Galvanized Earthing



Earth Enhancement Compound



Funnel Earthing



Lightning Protection Systems



UNIQUE™
Down to Earth....

OUR PRODUCT

COPPER-COATED PIPE TYPE EARTHING ELECTRODES



Our Copper-Coated Pipe Type Earthing Electrodes are engineered to provide efficient, safe, and long-lasting grounding solutions for a wide range of electrical installations. Manufactured using high-quality steel pipes with a uniform copper coating, these electrodes offer excellent electrical conductivity, superior corrosion resistance, and reliable performance even in challenging soil conditions.

Available in both Pipe-in-Pipe and Flat-in-Pipe configurations, the electrodes are filled with highly conductive Conductive Carbon Compound (CCC), which helps reduce earth resistance and improves fault current dissipation. This advanced design ensures enhanced grounding efficiency, increased current-carrying capacity, and stable performance throughout their service life.

HOT-DIP GALVANIZED PIPE TYPE EARTHING ELECTRODES




Our Hot-dip Galvanized Pipe Type Earthing Electrodes are manufactured using premium-quality steel pipes with a durable zinc coating for superior corrosion protection and long service life. Designed to provide efficient grounding and low earth resistance, they ensure reliable fault current dissipation and enhanced electrical safety.

Available in 48mm and 76mm diameters, these electrodes are ideal for residential, commercial, industrial, telecom, and lightning protection applications. Their robust construction and maintenance-free performance make them a dependable choice for long-lasting earthing systems.

UNIQUE®
Down to Earth....

COPPER BONDED SOLID ROD

Engineered for durability and efficiency, Copper Bonded Solid Rods offer outstanding conductivity and long-term protection against corrosion. Their solid-core design ensures high mechanical strength, making them suitable for demanding grounding environments and deep-driven installations.

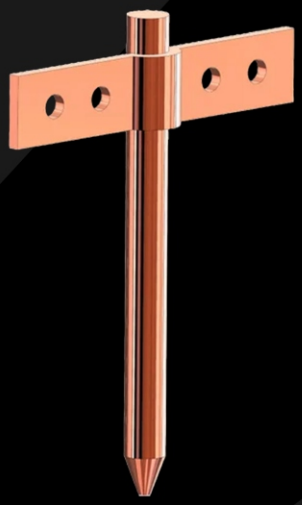

Available in 14mm, 17mm, 25mm, 32mm, and 38mm sizes, these rods provide a dependable and cost-effective earthing solution for industrial, commercial,and utility applications.

EARTH ENHANCEMENT COMPOUND

The efficiency of an earthing system is greatly influenced by the soil conditions surrounding the earthing electrode. Even when the same electrode and installation method are used, variations in soil composition can lead to significant differences in earth resistance and overall system performance.

Earth Enhancement Compound (EEC) is specially formulated to improve the conductivity of the soil around the earthing electrode. When mixed with the backfill soil during installation, it reduces soil resistivity and creates a stable, low-resistance path for fault current, ensuring reliable and consistent earthing performance.



STANDARD BFC BAG



STAR BFC BAG

UNIQUE®
Down to Earth....

LIGHTNING ARRESTER



Single Spike
Lightning Arrester



Multi Spike
Lightning Arrester




ESE Type
lightning arrester

SOLAR EARTHING KIT

Our Solar Earthing Kit is specially designed for rooftop and ground-mounted solar power projects. The kit consists of a high-strength copper bonded steel earthing rod available in 14mm and 17mm diameters with copper bonding thickness ranging from 50 Micron to 250 Micron. It provides excellent corrosion resistance, low earth resistance, and long service life, ensuring reliable protection for solar panels, inverters, structures, and electrical equipment.

We also offer Single Spike Lightning Arrester and Multi Spike Lightning Arrester solutions for complete lightning protection of solar power plants. These systems are designed to safely intercept lightning strikes and discharge the surge current to the ground through a reliable earthing network, helping protect solar modules, inverters, electrical panels, and other critical equipment from lightning-related damage.

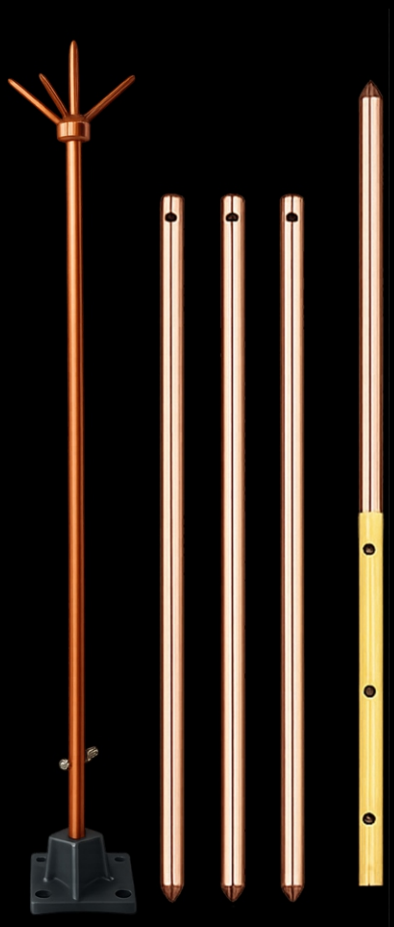

UNIQUE®
Down to Earth....

PRODUCT DIMENSIONS & TECHNICAL SPECIFICATIONS

EARTHING TYPE	COATING	LENGTH	MICRON	OUTER ELECTRODE DIA	INNER STRIP SIZE
Copper Coated Earthing	Copper Coating	1.2,3 Mtr	50 Micron 100 Micron 250 Micron	48,60,76,88 mm	Strip: 25x3, 25x6, 32x6, 40x6, 50x6, 50x10
Hot-dip Galvanized Earthing	Hot-dip Galvanized	1.2,3 Mtr	80 Micron	48,60,76,88 mm	Strip: 25x3, 25x6, 32x6, 40x6, 50x6, 50x10
Solid Rod Earthing	Copper Coating	1.2,3 Mtr	50 Micron 100 Micron 250 Micron	14,17,19,25,32,38 mm	N.A.

INSTALLATION METHOD

It is very important that the earthing system is installed correctly for the system to work at its full efficiency. upon proper installation, the system will give very good (desired resistance value) compare to conventional system of earthing. It will require no maintenance under normal soil conditions except the normal watering of pits during hot summer seasons. The standerd installation method description is packed with every electrode manufactured by us.

NOTE: Since there exist varying types of soil& environment conditions around the best resistance values of an earthing system vary.

NORMAL SOIL

- Make a bore of 8" to 10" in dia up to the electrode length of 2/3 meters.
- Fill the bottom 4" of the bore with the supplied BFC (Electrodite).
- Vertically place the electrode in the center of the pit.
- Fill the cavity around the electrode with the BFC (Electrodite).
- Ensure there are no air gaps in the BFC Filled cavity region.
- Now pour sufficient water into the earth pit unit the BFC takes the from of a paste / mud. allow the pit to absorb the water and settle.
- Test the earth pit and make the required connections to the electrical service box.

CAUTION: avoid excess watering and don't hammer the electrode.

UNIQUE®
Down to Earth....

RECOMMENDATION OF INSTALLATION OF EARTHING AS PER IS:3043

INSTALLATIONS/3 PHASE SHORT-CIRCUIT CURRENT (ISC CAPACITY)	IR VALUE REQUIRED	SOIL TYPE/RESISTIVITY	EARTH SYSTEM
House hold earthing / 3kA	8 ohm	Normal Soil / up to 50 ohm-meter	Single Electrode
		Sandy Soil / between 50 to 2000 ohm-meter	Single Electrode
		Rocky Soil / more than 2000 ohm-meter	Multiple Electrodes
Commercial premises, Office /5kA	2 ohm	Normal Soil / up to 50 ohm-meter	Single Electrode
		Sandy Soil / between 50 to 2000 ohm-meter	Multiple Electrodes
		Rocky Soil / more than 2000 ohm-meter	Multiple Electrodes
Transformers, substation earthing, LT line equipment /15kA	less than 1 ohm	Normal Soil / up to 50 ohm-meter	Single Electrode
		Sandy Soil / between 50 to 2000 ohm-meter	Multiple Electrodes
		Rocky Soil / more than 2000 ohm-meter	Multiple Electrodes
LA, High current equipment / 50kA	less than 1 ohm	Normal Soil / up to 50 ohm-meter	Single Electrode
		Sandy Soil / between 50 to 2000 ohm-meter	Multiple Electrodes
		Rocky Soil / more than 2000 ohm-meter	Multiple Electrodes
PRS, UTS, RTUS, Data processing center etc./5kA	less than 0.5 ohm	Normal Soil / up to 50 ohm-meter	Single Electrode
		Sandy Soil / between 50 to 2000 ohm-meter	Multiple Electrodes
		Rocky Soil / more than 2000 ohm-meter	Multiple Electrodes

UNIQUE®
Down to Earth....

OTHER PRODUCTS & ACCESSORIES



CAST IRON EARTHING



COPPER STRIP



GI STRIP




RCC CHAMBER



PPE CHAMBER



PLATE EARTHING

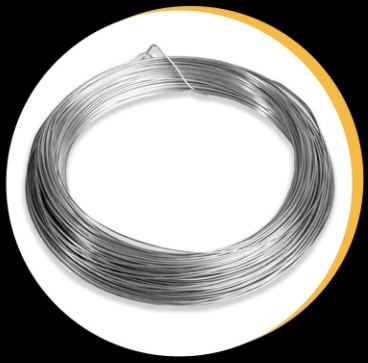

GI WIRE



EARTHING CLAMP



LIGHTING ARRESTER ACCESSORIES

UNIQUE™
Down to Earth....

APPLICATION AREAS



RENEWABLE ENERGY



INDUSTRIAL FACILITIES



RESIDENTIAL & COMMERCIAL PROJECTS




POWER & ENERGY



MANUFACTURING PLANTS



RAILWAY

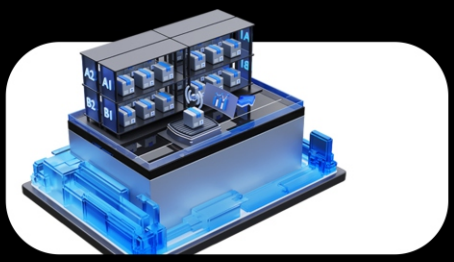

DATA CENTERS



GOVERNMENT PROJECTS



ELECTRICAL SUBSTATION

OUR VALUABLE CLIENT

INDIAN RAILWAYS

COS POWER
"from engineering to projects....."

SGCCI

NC NUTRICORE

ramas
LAB GROWN DIAMONDS

GOPIN DEVELOPERS
SINCERELY YOURS!

Avadh ©

WOOP!
GET HIGH!

RAYCAL

CLIMATE DETOX
Renewables Private Limited

Unique Electrodes™

Down to Earth....

+91 95122 31350 / +91 95370 25302

uniqueenterprise2601@gmal.com

PLOT NO.- B/116,SHED NO.1, UDHANA UDHYOG NAGAR, ROAD NO.8,UDHANA,SURAT,GUJRAT-394210, SURAT, 394210

Meetscripts | 9974 9974 49

Tel. No.0755-2586343
Fax No. 0755 – 2587774
Email: cpribpl@sancharnet.in

CENTRAL POWER RESEARCH INSTITUTE
GOVINDPURA : BHOPAL – 462 023

23 MAR 2026

PROVISIONAL REPORT

Test Report No. CPRIBPLSTNBMISC26T0059 **Date of test: 11 March 2026**

1. **Customer:** Unique Enterprise
Plot No. B/116, Shed No. 1, Udhana Udhyog Nagar,
Road No. 8, Udhana, Surat, Gujarat, 394210
2. **Sample tested:** 17.2 mm Copper Bonded Earthing Electrode

3. **Serial Number:** UE-SR-173 **4. Sample Code No.:** STNBMISC26S0082
5. **Type:** Solid **5.1 Designation:** -
6. **Drawing Number:** UE0002026 (Drawings to be revised and verified)
7. **Rating of the Sample:**
7.1 **Rated Voltage :** - - **Rated Current :** -
7.3 **Rated Frequency :** - **50Hz** **No. of phases :** Single
7.5 **Rated insulation voltage:** -
7.6 **Rated short time current:** 15 kArms for 1.0 second dynamic peak of 30kA

8. **Sample tested for the following ratings:**
8.1 **Short time current:** 15 kArms for 1.0 second dynamic peak of 30kA

9 **Type of test carried out:** Short time current Test

10 **Specification followed:** As per customer's requirement
10.1 **Customer's requirement:** Only Short time current to be conducted on earthing electrode
11 **Test results:**

Oscillogram No.	Short time current in kApk/kArms	Duration in second	Equivalent current for 1.0 second in kArms
	I		
CPRIBPLSTNB MISC26T0059S002	30.17/15.11	1.0	15.11
Single phase short time current test on earthing electrode.			
Observations:	No abnormality. Earthing Electrode found intact. Discoloration of copper observed		

TEST ENGINEER **LABORATORY IN-CHARGE**

संयुक्त निदेशक
Joint Director
केन्द्रीय विद्युत अनुसंधान संस्थान
Central Power Research Institute
स्विचगियर परीक्षण एवं विकास केन्द्र
Switchgear Testing & Development Station
गोविन्दपुरा,भोपाल-462023
Govindpura, Bhopal- 462023

This is only a provisional report. The final report alongwith drawings and otherdocuments will be issued separately within one month from the date of test.

Tel. No.0755-2586343
Fax No. 0755 – 2587774
Email: cpribpl@sancharnet.in

CENTRAL POWER RESEARCH INSTITUTE
GOVINDPURA : BHOPAL – 462 023

23 MAR 2026

PROVISIONAL REPORT

Test Report No. CPRIBPLSTNBMISC26T0060 **Date of test: 11 March 2026**

1. **Customer:** Unique Enterprise
Plot No. B/116, Shed No. 1, Udhana Udhyog Nagar,
Road No. 8, Udhana, Surat, Gujarat, 394210
2. **Sample tested:** 76 mm GI Earthing Electrode

3. **Serial Number:** UE-SIP-763 **4. Sample Code No.:** STNBMISC26S0081
5. **Type:** Pipe in Pipe **5.1 Designation:** -
6. **Drawing Number:** UE0002025 (Drawings to be revised and verified)
7. **Rating of the Sample:**
7.1 **Rated Voltage :** - - **Rated Current :** -
7.3 **Rated Frequency :** - 50Hz **No. of phases :** Single
7.5 **Rated insulation voltage:** -
7.6 **Rated short time current:** 30 kArms for 1.0 second dynamic peak of 71 kA

8. **Sample tested for the following ratings:**
8.1 **Short time current:** 30 kArms for 1.0 second dynamic peak of 71 kA

9 **Type of test carried out:** Short time current Test

10 **Specification followed:** As per customer's requirement
10.1 **Customer's requirement:** Only Short time current to be conducted on earthing electrode
11 **Test results:**

Oscillogram No.	Short time current in kApk/kArms	Duration in second	Equivalent current for 1.0 second in kArms
	I		
CPRIBPLSTNB MISC26T0060S002	71.54/31.10	1.0	31.10
Single phase short time current test on earthing electrode.			
Observations:	No abnormality. Earthing Electrode found intact. Discoloration of copper observed		

TEST ENGINEER

संयुक्त निदेशक
Joint Director
केन्द्रीय विद्युत अनुसंधान संस्थान
Central Power Research Institute
स्विचगियर परीक्षण तथा विकास केन्द्र
Switchgear Testing & Development Station
गोविन्दपुरा,भोपाल-462023
Govindpura, Bhopal- 462023

LABORATORY IN-CHARGE

This is only a provisional report. The final report alongwith drawings and otherdocuments will be issued separately within one month from the date of test.

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
ERDA ROAD, GIDC, MAKARPURA, VADODARA-390 010. INDIA
EPABX : +91 (0265) 2642942, 2642964, 2642377, 3043129 / 30 / 31 / 33
E-mail : erda@erda.org
Web : http://www.erda.org

TEST REPORT

NAME & ADDRESS OF CUSTOMER **UNIQUE ENTERPRISE** Plot No.116/1, Shed No.1, Udhana Udhayog Nagar Road No.8, Udhana, Surat Gujarat - 394210	**TEST REPORT NO.:** RP-2526-034776 **DATE OF ISSUE:** 19/01/2026
	CUSTOMER REF. NO.: Letter — **DATED:** 30/09/2025
	DATE OF SAMPLE RECEIPT: 30/09/2025 — **DATE OF TESTING:** 05/01/2026 to 13/01/2026
SAMPLE DESCRIPTION **(As provided by customer)** **25MM, 3MTR. EARTHING ELECTRODE** Earthing rod length : 3000 mm Earthing rod dia. : 25 mm Earthing rod raw material : MS low carbon Coating thickness : 250 microns copper coating **Rated short-time withstand current & its duration:** 25 kArms for 1 sec. Quantity (Tested) : 1 No.	**SAMPLE IDENTIFICATION** **ERDA SAMPLE CODE NO.:** ERDA-00650856 **TYPE DESIGNATION:** UECB 2503
TEST DETAILS Short-time withstand current tests	**TEST SPECIFICATIONS** As per customer's requirement

ENCLOSURES:

Number of oscillogram	: One
Number of photograph	: One
Number of test circuit diagram	: One
Number of drawing	: One

TEST WITNESSED BY: Mr. Divyesh Padsala

REMARKS: Test results as per enclosures.

CHECKED BY

MUNAF PATEL
APPROVED BY

Note:
1. This report relates only to the particular sample received for testing in good condition at ERDA Vadodara.
2. This report cannot be reproduced in part under any circumstances.
3. Publication of this report requires prior permission in writing from Director, ERDA.
4. This report shall not be used for any purpose such as PR brochures, propaganda, advertisement and/or legal proceedings, for the granted purpose.
5. Only the tests asked for by the customer have been carried out.
6. Particulars of manufacturer/supplier, given in this report are based on information supplied by the customer, along with the test request/sample. ERDA does not assume any responsibility for the correctness of the information for above mentioned Sample Under Test (SUT). ERDA will not be responsible for any changes in SUT made after the test. This test report is given as per instrument status while testing.
7. In case of any dispute, Vadodara will be the exclusive jurisdiction & shall be construed as where the cause has arised.

Caution:
ERDA is not responsible for the authenticity of photocopied or reproduced test reports.
ERDA provides support to customers for verification of the authenticity of test reports issued by ERDA within 10 years of date of issue of report.

Electrical Research and Development Association • Vadodara • GEN/09 002

Ph.: 0261-2363600
0261-2363700

Bhumi Research Center® LLP
We Care
CIVIL ENGINEERING TESTING & CONSULTANCY SERVICES
"Bhumi House" Plot No. 76, Satarawadi, Near Sosyo Circle, Udhna Magdalla Road, Udhna, Surat-394210.

Test Report

Report No.: MT-02-2026-EEC-PHY-1742-01
Lab. No. 6274
Discipline: Mechanical Testing
Group: Soil & Rock
Product: Earthing Compound

Report Date: 23/02/2026
Date of Receipt: 19/02/2026
Date of Test Start: 20/02/2026
Date of Test Completed: 23/02/2026
Test Location: At Laboratory

Name of Client: M/s.Unique Enterprise
Name of Work: B-116, Shade No.-01, Udhna Udhyognagar, Road No.-08, Udhna, Surat
Source of Material: Earthing Compound
Sample Identification: Unique Electodes
Quantity of Sample: 25 kg
Condition of Sample: Acceptable

Sr. No.	Test Parameter	Test Results	Test Method
1	Ele. Resistivity (Ohm-cm)	0.84	IEC 62561-7-2018
2	Grain Size Analysis (%)		IS 2720 (Part 4)-1985
	Gravels >4.75mm	0.00	
	Sand: 4.75mm to 0.075mm	3.13	
	Silt+Clay: <0.075mm	96.88	
3	Volumetric Free Swell Index (%)	81.82	IS 2720 (Part 40)-1977
4	Swelling Volume (ml)	8.18	IS 2720 (Part 40)-1977
5	Moisture Content (%)	4.32	IS 2720 (Part 2)-1973
6	Bulk Density (kg/m^3)	1063	IS 2386 (Part 3)-1963

Remark: #: Data / Information is provided by the customer and can affect the validity of results.
The test of resistivity done on the 26.8cm x 15.9cm x 9.4cm box size.

PL/PS
Reviewed By

EEC-PHY - 6274

Authorised Signatory
Pratik Kothiya
(Quality Manager)

Note: 1) : This test report and results relate to the particular sample / specimen of the material as delivered by the client and received & tested in the laboratory under certain environmental condition.
2) : This test report or part of the same shall not be reproduced without written permission from the Bhumi Research Center.
3) : This report/results are not supposed to use for publicity.
4) : Any correction invalidates this Test Report.

Format No:QR-220

--- End of Test Report ---

Reg. Off. 'Bhumi House', 2/1362, Sagrampura, Opp. Sub-Jail, Ring Road, Surat-395 002.
URL: www.bhumiresearch.com Email : bhumi.soil@gmail.com

भारत सरकार
Government of India
सूक्ष्म, लघु एवं मध्यम उद्यम मंत्रालय
Ministry of Micro, Small and Medium Enterprises

MSME सूक्ष्म, लघु एवं मध्यम उद्यम MICRO, SMALL & MEDIUM ENTERPRISES

UDYAM REGISTRATION CERTIFICATE

UDYAM REGISTRATION NUMBER UDYAM-GJ-22-0120594

NAME OF ENTERPRISE UNIQUE ENTERPRISE

TYPE OF ENTERPRISE *

SNo.	Classification Year	Enterprise Type	Classification Date
1	2026-27	Micro	22/04/2026
2	2025-26	Micro	01/04/2025
3	2024-25	Micro	27/04/2024
4	2023-24	Micro	09/05/2023
5	2022-23	Micro	26/06/2022

MAJOR ACTIVITY MANUFACTURING

SOCIAL CATEGORY OF ENTREPRENEUR GENERAL

NAME OF UNIT(S)

S.No.	Name of Unit(s)
1	UNIQUE ENTERPRISE

OFFICAL ADDRESS OF ENTERPRISE

Flat/Door/Block No.	Plot-B/116 Shed No-1	Name of Premises/ Building	Udhna Udhyog Nagar
Village/Town	Udhna	Block	Udhna
Road/Street/Lane	Road No.8	City	Surat
State	GUJARAT	District	SURAT , Pin 394210
Mobile	9512231350	Email:	padasaladivyesh1999@gmail.com

DATE OF INCORPORATION / REGISTRATION OF ENTERPRISE 01/07/2021

DATE OF COMMENCEMENT OF PRODUCTION/BUSINESS 01/07/2021

NATIONAL INDUSTRY CLASSIFICATION CODE(S)

SNo.	NIC 2 Digit	NIC 4 Digit	NIC 5 Digit	Activity
1	46 - Wholesale trade, except of motor vehicles and motorcycles	4652 - Wholesale of electronic and telecommunications equipment and parts	46529 - Wholesale of other electronic equipments and parts thereof	Trading
2	27 - Manufacture	2732 - Manufacture of other electronic and	27320 - Manufacture of	Manufacturing

Certificate of Registration

This is to Certify that The Quality Management Systems of

UNIQUE ENTERPRISE

B/14 UPG, MEXICAN PLAZA, CENTRAL ROAD NO. 4,
UDHNA, SURAT, GUJARAT, 394210

Has been assessed and found to conform to the requirements of:

ISO 9001:2015

For the following scope

MANUFACTURERS AND TRADERS

Certificate Number: TSNUK02740
Date of certification: 11-07-2022
1st Surveillance Audit date: 10-07-2023
2nd Surveillance Audit date: 10-07-2024
Certificate Expiry: 10-07-2025

Signed on Behalf of TSN Certification Limited

Director of Certifications

TSN Certification Limited
Registered with The Registrar of Companies for England and Wales (UK), Registration No. 13793893
UK Address: 17 King Edwards Road, College House, Ruislip, London, United Kingdom, HA4 7AE (UK)
India Address: 5/133, Ground Floor, Vineet Khand-5, Gomti Nagar, Lucknow, Uttar Pradesh-226010

The certificate remains the property of TSN Certification Limited to whom it must be returned on request. Lack of fulfillment of certification terms and conditions at all times, may render this certificate invalid. The approval is subject to the company maintaining its system to the required standards.This certificate can be verified at **www.tsncertification.com**

Accredited By:
EUAS - Euro Universal Accreditation Systems
USA Address: 1401 Morris Road, Building 1, Suite 600, Alpharetta, GA 30004, Georgia, (USA)
Website: www.euas-ac.org