


Ablation Study — ContrastiveXAI-FS

F1-macro by Configuration
(8-Class Attack Classification (label2))



Incremental Gain per Component
(8-Class Attack Classification (label2))

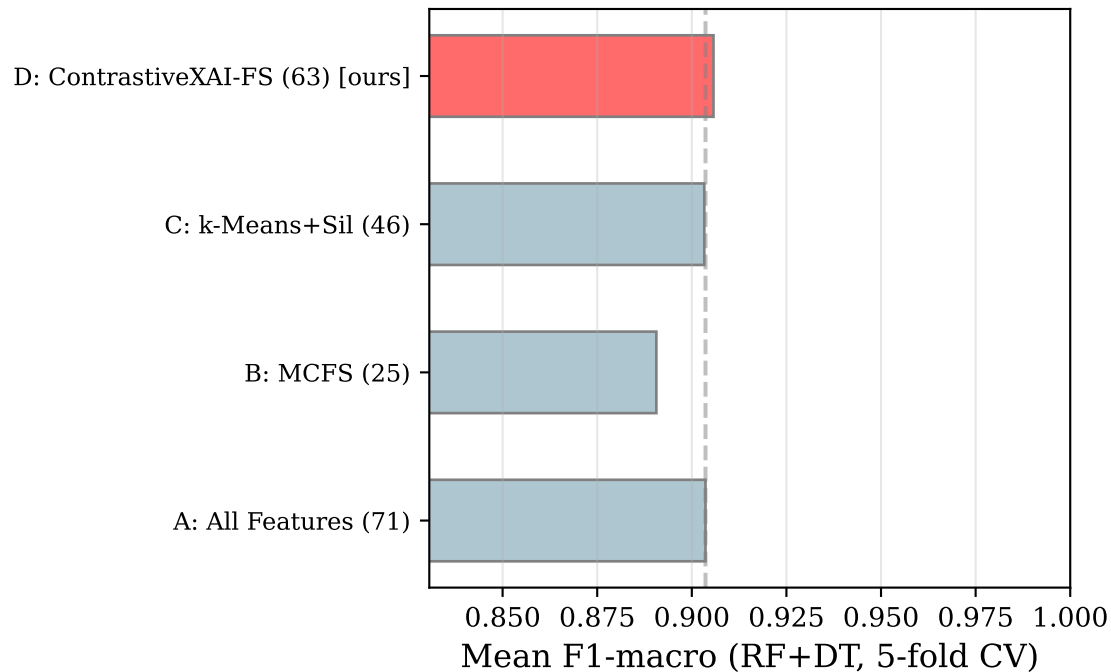