











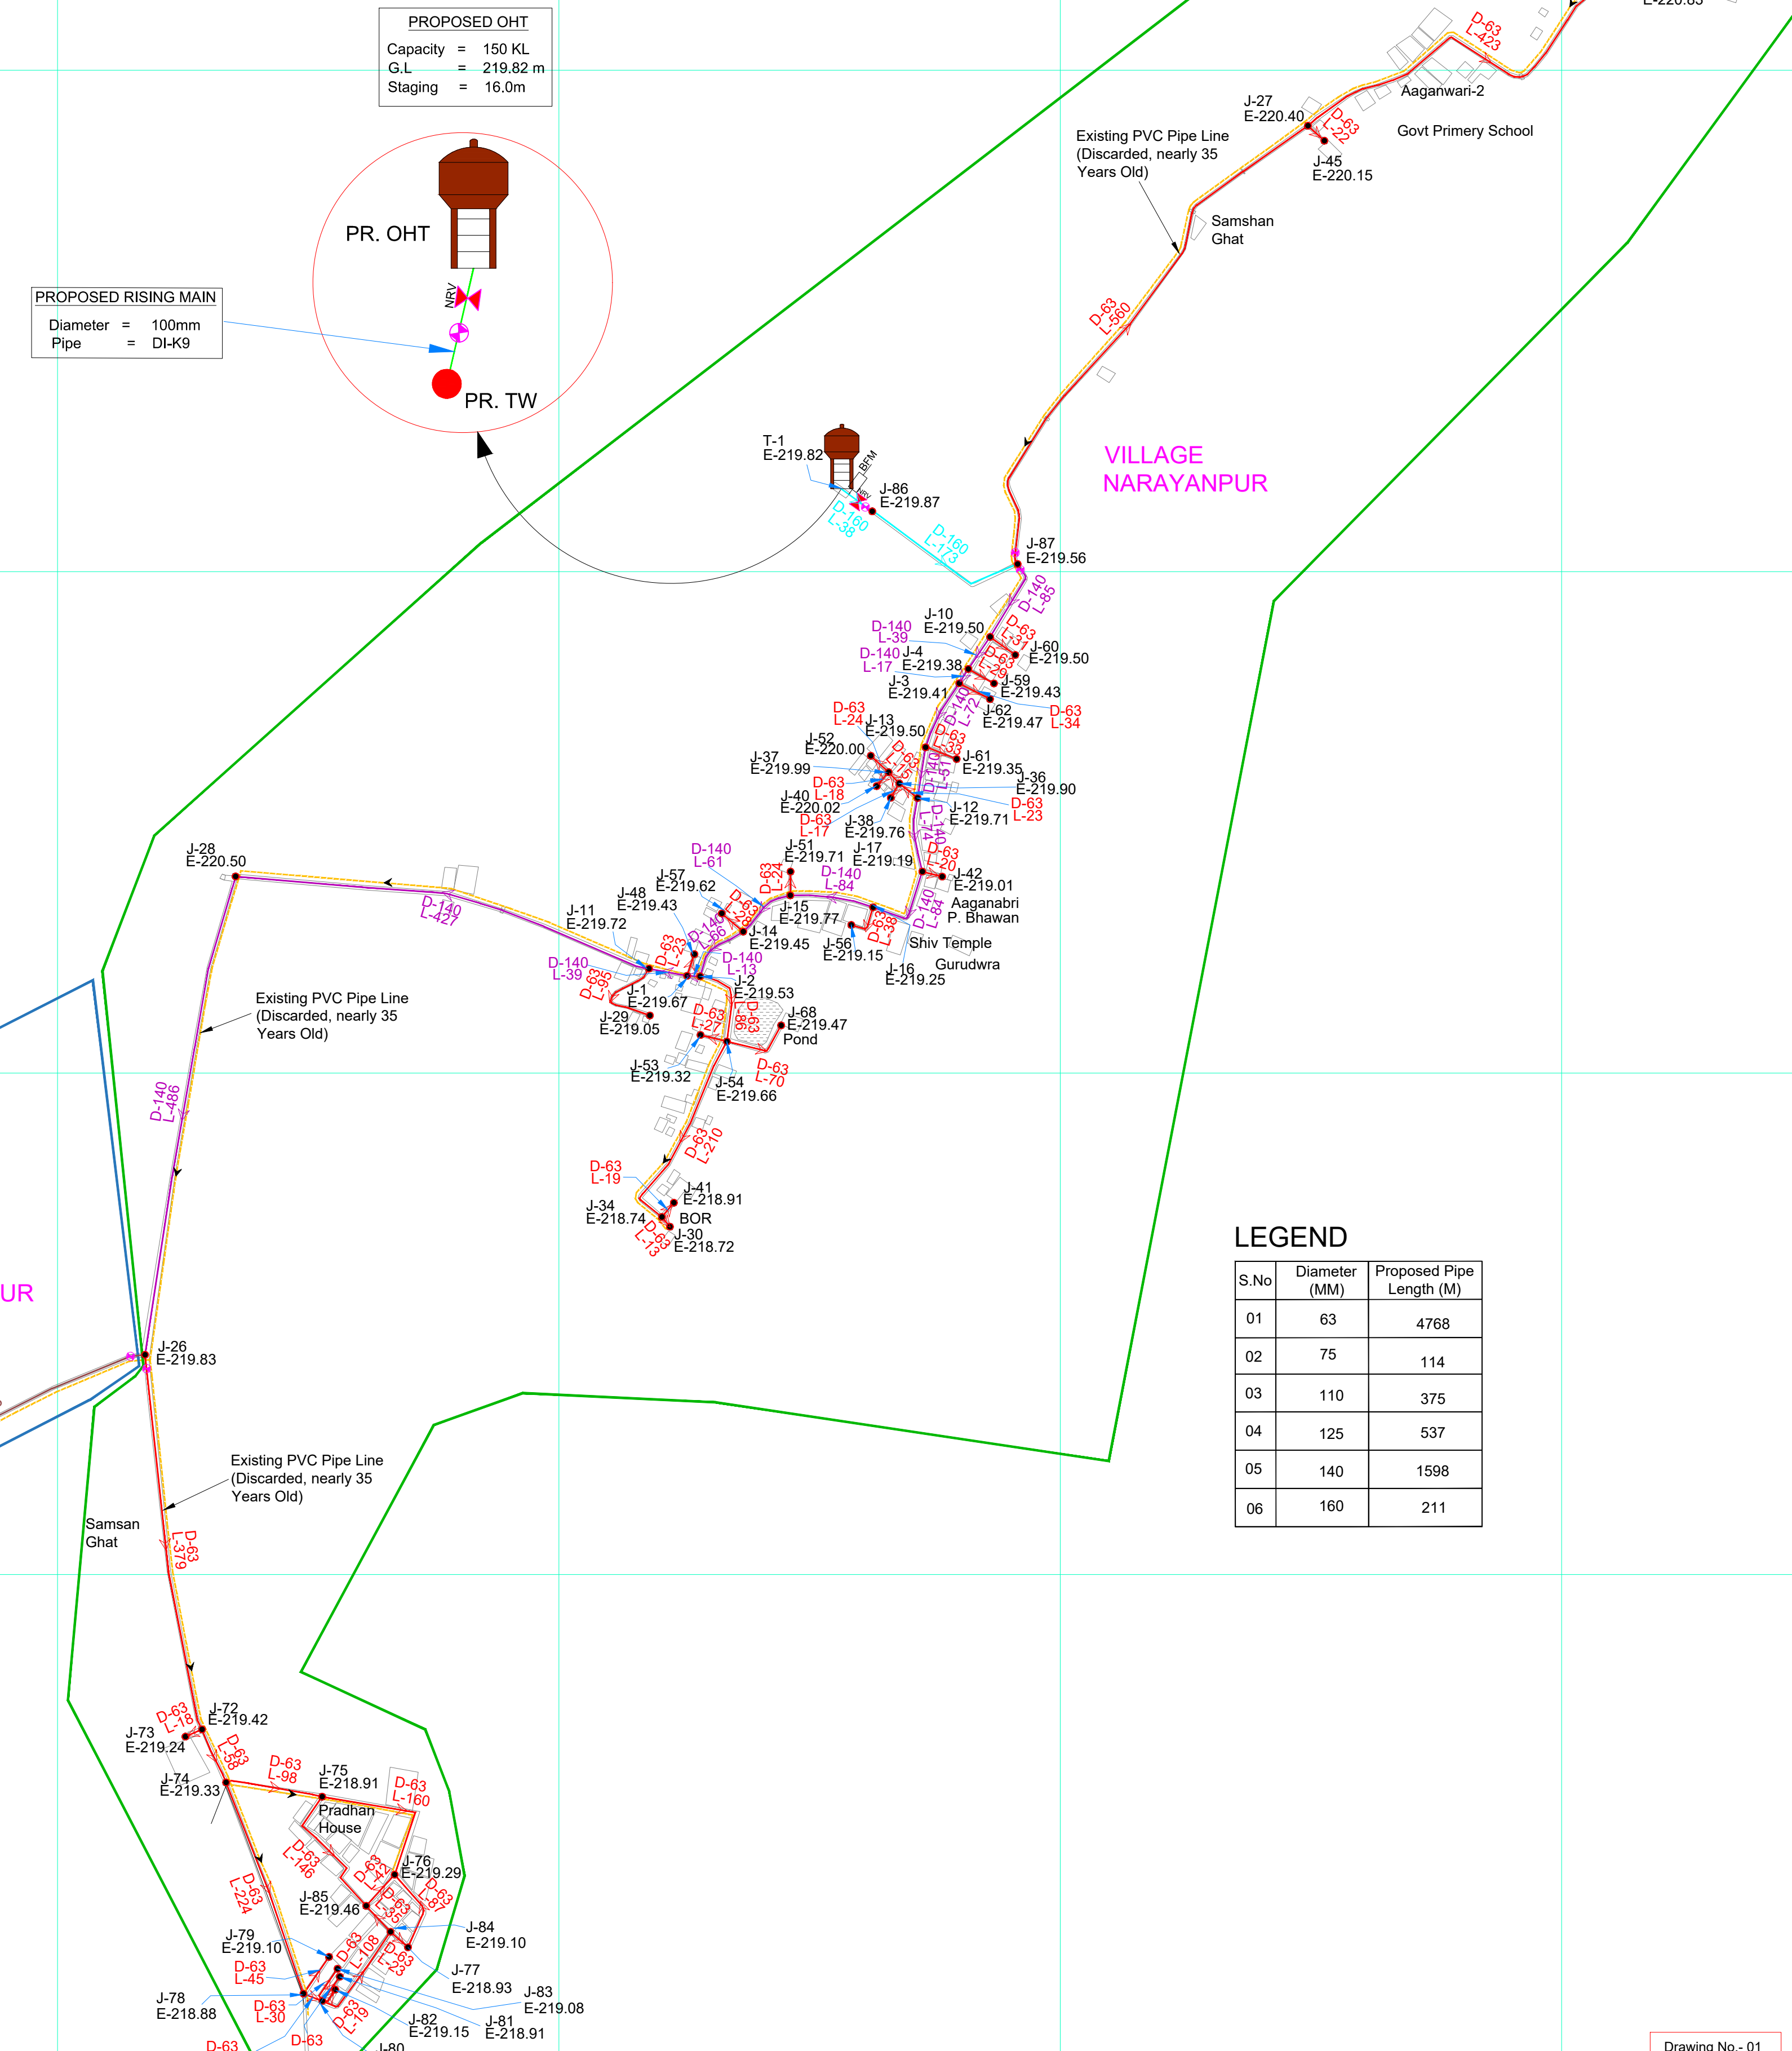






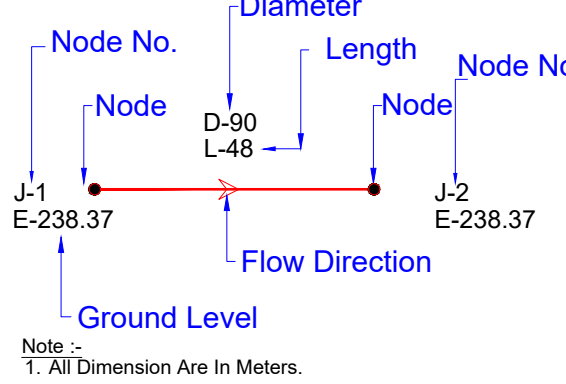


| Village Mukundpur | | |
|-------------------|---------------|---------------------|
| Label | Elevation (m) | Hydraulic Grade (m) |
| J-5 | 218.63 | 231.82 |
| J-6 | 218.66 | 231.85 |
| J-7 | 218.31 | 231.77 |
| J-8 | 219.30 | 232.06 |
| J-9 | 219.30 | 232.15 |
| J-18 | 217.79 | 230.74 |
| J-19 | 218.22 | 230.73 |
| J-22 | 217.62 | 230.87 |
| J-24 | 219.77 | 232.42 |
| J-25 | 217.84 | 231.49 |
| J-26 | 219.83 | 232.94 |
| J-32 | 217.94 | 231.43 |
| J-33 | 217.88 | 231.41 |
| J-35 | 218.37 | 231.77 |
| J-39 | 217.69 | 231.41 |
| J-43 | 217.83 | 231.11 |
| J-44 | 217.58 | 231.11 |
| J-46 | 217.82 | 231.17 |
| J-47 | 217.83 | 231.23 |
| J-49 | 218.99 | 231.82 |
| J-50 | 219.29 | 231.82 |
| J-55 | 217.85 | 231.17 |
| J-58 | 217.83 | 231.30 |
| J-63 | 218.83 | 231.82 |
| J-64 | 217.76 | 230.87 |
| J-65 | 219.30 | 232.06 |
| J-66 | 218.12 | 231.30 |
| J-67 | 217.63 | 231.23 |
| J-69 | 217.92 | 231.82 |
| J-70 | 218.83 | 232.15 |
| J-71 | 217.07 | 230.74 |



LEGEND

| S.No | Diameter (MM) | Proposed Pipe Length (M) |
|------|---------------|--------------------------|
| 01 | 63 | 4768 |
| 02 | 75 | 114 |
| 03 | 110 | 375 |
| 04 | 125 | 537 |
| 05 | 140 | 1598 |
| 06 | 160 | 211 |

| | |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----|
|  | |
| <p>Notes:</p> <p>1-All dimensions and levels are in Meter unless stated</p> <p>2-All diameters are in Milli Meter unless stated</p> <p>3-All levels are wrt Mean Sea Level.</p> <p>4-The pipe alignment, levels are tentative. The contractor must modify pipe alignment, levels based on detailed survey and to suit site condition.</p> <p>5-The location of proposed Intake Structure, Treatment Plant, Reservoirs, Pump House are tentative. Exact locations to be established based on detailed site survey to suit site condition.</p> | |
| <p>LEGEND</p> <p>Proposed Network</p> <p> 63MM dia. Pipe HDPE</p> <p> 75MM dia. Pipe HDPE</p> <p> 110MM dia. Pipe HDPE</p> <p> 125MM dia. Pipe HDPE</p> <p> 140MM dia. Pipe HDPE</p> <p> 160MM dia. Pipe HDPE</p> <p> DIAMETER IN M</p> <p> LENGTH IN M</p> <p> ELEVATION IN M</p> <p> BULK FLOW METER</p> <p> SLUICE VALVE</p> <p> AIR RELEASE VALVE</p> <p> PROPOSED ESR</p> <p> PROPOSED RISING MAIN</p> <p> PROPOSED TUBE WELL</p> <p> VILLAGE BOUNDARY</p> <p> EXISTING PIPE NETWORK (DISCARDED, NEARLY 35 YEARS OLD)</p> | |
|  | |
| <p>TITLE :- DISTRIBUTION NETWORK</p> | |
| <p>Name of Project :- Narayanpur MVS Water Supply Scheme.</p> | |
| <p>CONSULTANT:- Manju Satya Prakash Infratech Pvt. Ltd. 403, Gyatri Sumitra Palace, Ramnagri, Patna - 800025 Email: info@mspipl.com</p> | |
| <p>CLIENT:-</p> | |
| AAE | EE |
| <p>Utтарakhand Jal Sansthan, Rudrapur, Udham Singh Nagar</p> | |