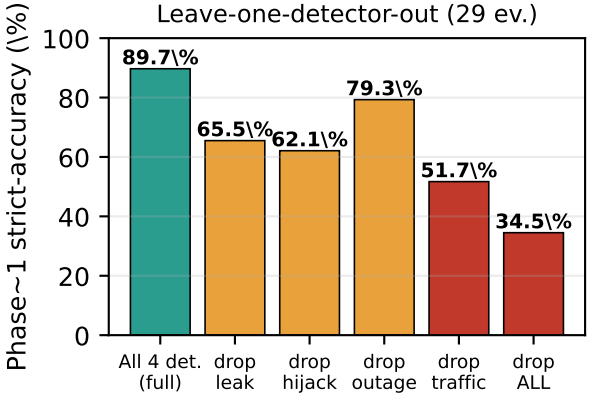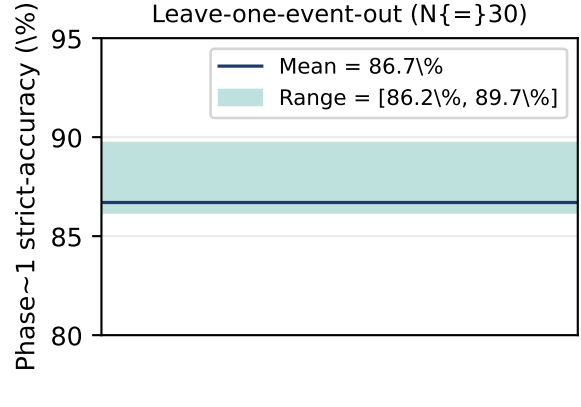Ablation: each detector non-redundant; headline robust to single-event removal