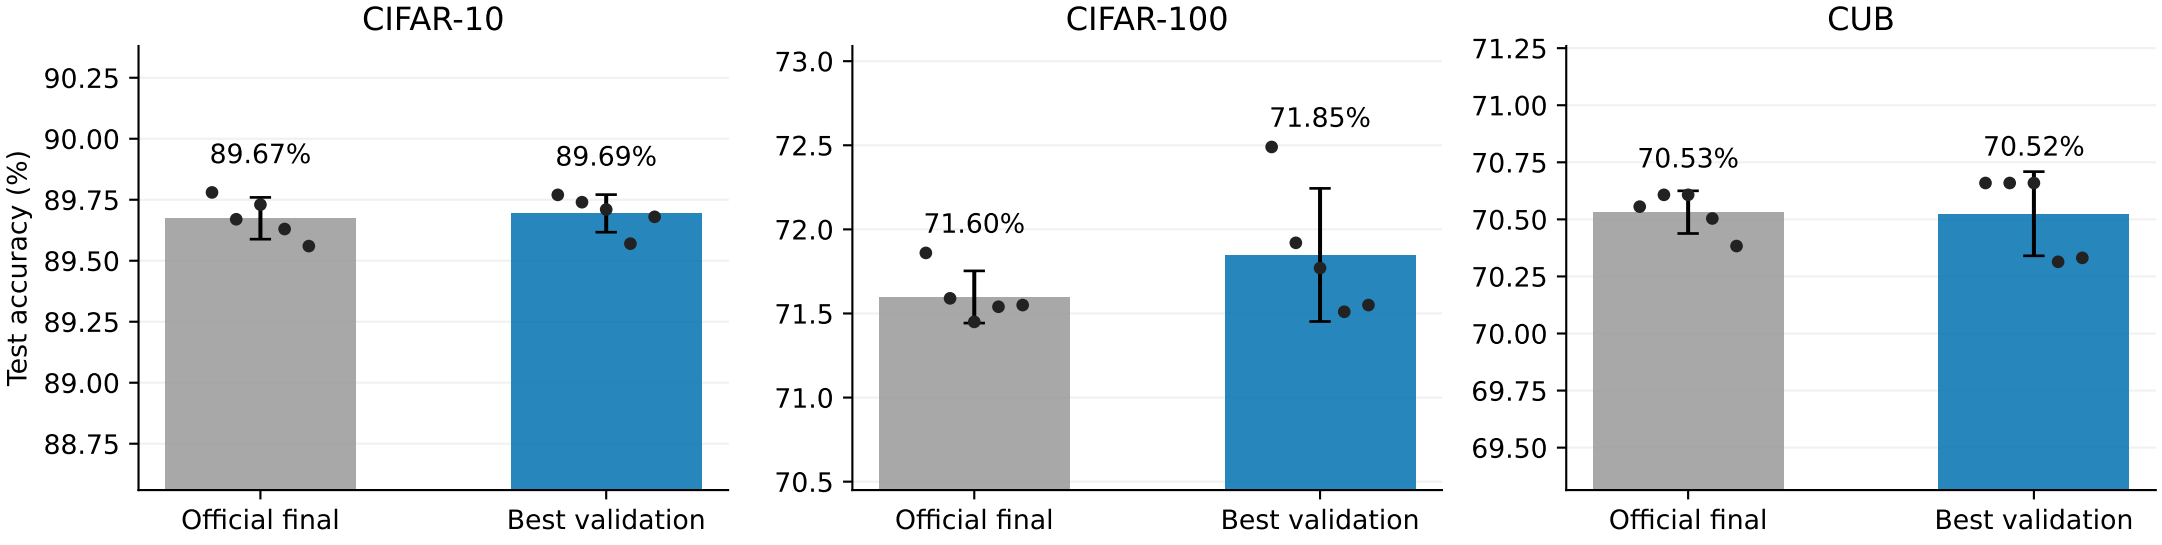
Clean PS-CBM reproduction: five independent training seeds
CIFAR-10
CIFAR-100
CUB
Test accuracy (%)
90.25
90.00
89.75
89.50
89.25
89.00
88.75
89.67%
89.69%
73.0
72.5
72.0
71.5
71.0
70.5
71.60%
71.85%
71.25
71.00
70.75
70.50
70.25
70.00
69.75
69.50
70.53%
70.52%
Official final
Best validation
Official final
Best validation
Official final
Best validation
Bars: mean ± training-seed SD; dots: seeds42–46. Fixed training concept bank and pretrained features shared.