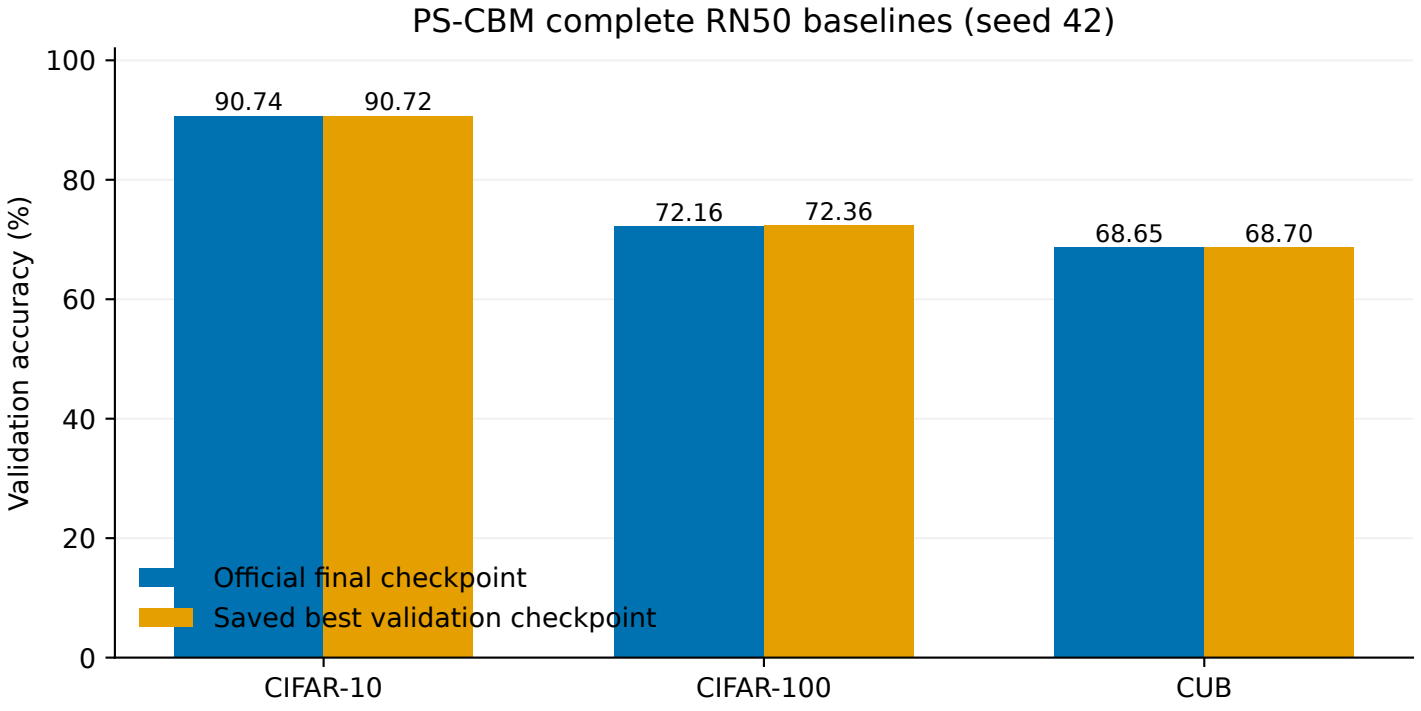
PS-CBM complete RN50 baselines (seed 42)
Validation accuracy (%)
100
80
60
40
20
0
90.74
90.72
72.16
72.36
68.65
68.70
Official final checkpoint
Saved best validation checkpoint
CIFAR-10
CIFAR-100
CUB