


AS-BUILT EQUIPMENT RECORD CARDS

Stock No:		APPROVED FOR INSTALLING				Store:		GREEN		<input type="radio"/>	
Is this a NEW Asset?		tick		or a USED / REFURBISHED Asset?		tick		Type of Equipment:			
Type of Change:	New	Removed		Replaced		Ownership:	PCo		Transformer		
Reason for Change:	Faulty	End of Life		Vegetation			Other	Customer	Circuit Breaker		
	Reconstruction	Vehicle		Relocation		Date Acquired:			Voltage Regulator		
Name:					Installed By:					Recloser	
No:	Road:				Date Installed:					Ring Main Unit	
Town:					Installers Name:					Sectionliser	
CIWR No:		Pco W/O No:		Contractors W/O No:		other:					
New Asset Site ID:				Zone Substation:							
Old Asset Site ID:				Feeder ID:							
Pole ID:				GXP:				Estimate Cost:			
S/N:					Voltage:		HV	LV	\$		
Make:					Volt Test:				For Dedicated Site:		
Model:					Voltage Rating:				Quantity:		
Manufacturer:					Tap Setting: %				Suppliers Code:		
Phases: THREE / ONE / SWER		Model Capacity:		eg 15 KVA		-10 -7.5 -5 -2.5 0 +2.5 5					
Fuse Size:		HV		LV		MDI Fitted?		Y	N	CT Ratio:	
Remote Controlled?	NO		YES		Earth Test:		1, 2,				
Remote Indication?	NO		YES		Total MEN:						
Counter Reading?	NO		YES								
Normal State		HV Connection Type		LV		Mounting Type					
Closed		Bushing		G/M		Cubicle		Pedestial		Free Standing	
		Dead Break		O/H		X-Arm		Vertical		Bracket	
		Cable Box		E/T		Plastic		Fenced		Fibre Glass	
Open		Pitch Box				Cust site		Spar		Metal Cover	
Comments: (any characteristics)											

EMAIL To : Asbuild.data@powerco.co.nz

AS-BUILT EQUIPMENT RECORD CARDS

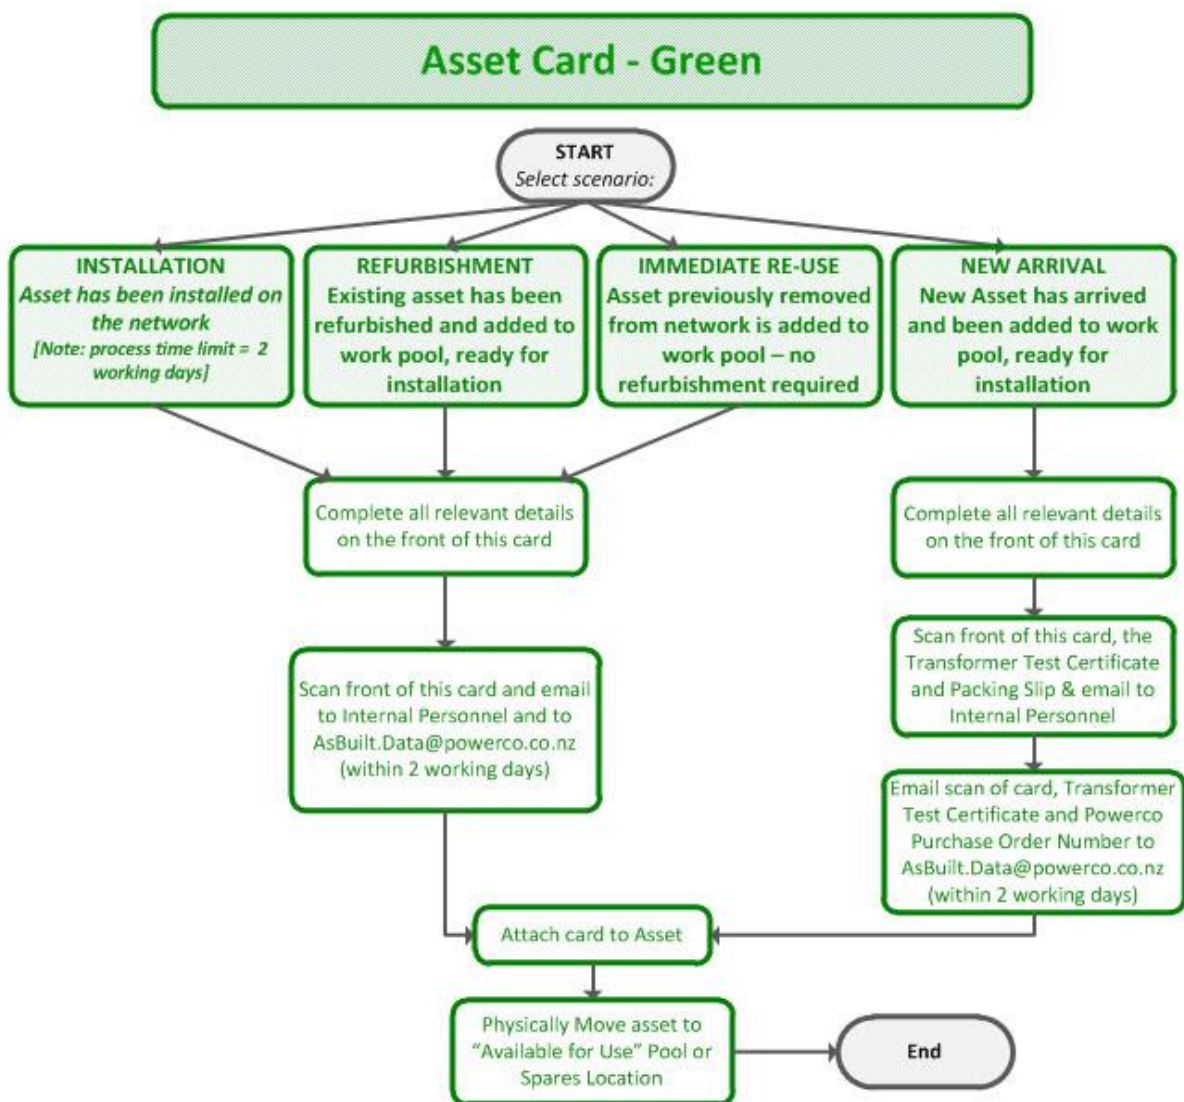

AS-BUILT EQUIPMENT RECORD CARDS

Stock No.		NOT AVAILABLE FOR USE				Store:				RED	
To be Reviewed		tick	Awaiting Refurbishment			tick	Scrap		tick	Type of Equipment:	
Type of Change:		Removed	<input type="checkbox"/>	Replaced	<input type="checkbox"/>	Ownership:		PCo	<input type="checkbox"/>	Transformer	
						Date Removed:				Circuit Breaker	
Name:						Removed By:				Voltage Regulator	
No.		Road:				Date Returned:				Recloser	
Town:						Removers Name:				Ring Main Unit	
CIWR No.			Pco W/O No.			Contractors W/O No:				Sectionliser	
New Asset Site ID:					Zone Substation:					other:	
Old Asset Site ID:					Feeder ID:						
Pole ID:					GXP:					Estimate Cost	
S/N:						Voltage:				HV	LV
Make:						Volt Test:				\$	
Model:						Voltage Rating:				For Dedicated Site:	
Manufacturer:				Year:		Tap Setting: %				Quantity:	
Phases: THREE / ONE / SWER		Model Capacity:				eg 15 KVA				Suppliers Code:	
Fuse Size:		HV		LV		MDI Fitted?		Y	N	CT Ratio:	
Remote Controlled?		NO	<input type="checkbox"/>	YES		<input type="checkbox"/>	Office use only		Refurb	<input type="checkbox"/>	Comments: (any characteristics)
Remote Indication?		NO	<input type="checkbox"/>	YES		<input type="checkbox"/>	PO:		Maint	<input type="checkbox"/>	
Counter Reading?		NO	<input type="checkbox"/>	YES		<input type="checkbox"/>	WO:				
						return to:		date:			
Reason for Change:						Faulty		<input type="checkbox"/>	End Of Life		<input type="checkbox"/>
Weather		<input type="checkbox"/>	Capacity or Reconstruction		<input type="checkbox"/>	Vehicle		<input type="checkbox"/>	DTU Pool		<input type="checkbox"/>
Vegetation		<input type="checkbox"/>	Relocation		<input type="checkbox"/>	Vandalism		<input type="checkbox"/>	Network Spares		<input type="checkbox"/>
						Contractor P/O					
						Received					
						Completed					

EMAIL To : Asbuild.data@powerco.co.nz

AS-BUILT EQUIPMENT RECORD CARDS

