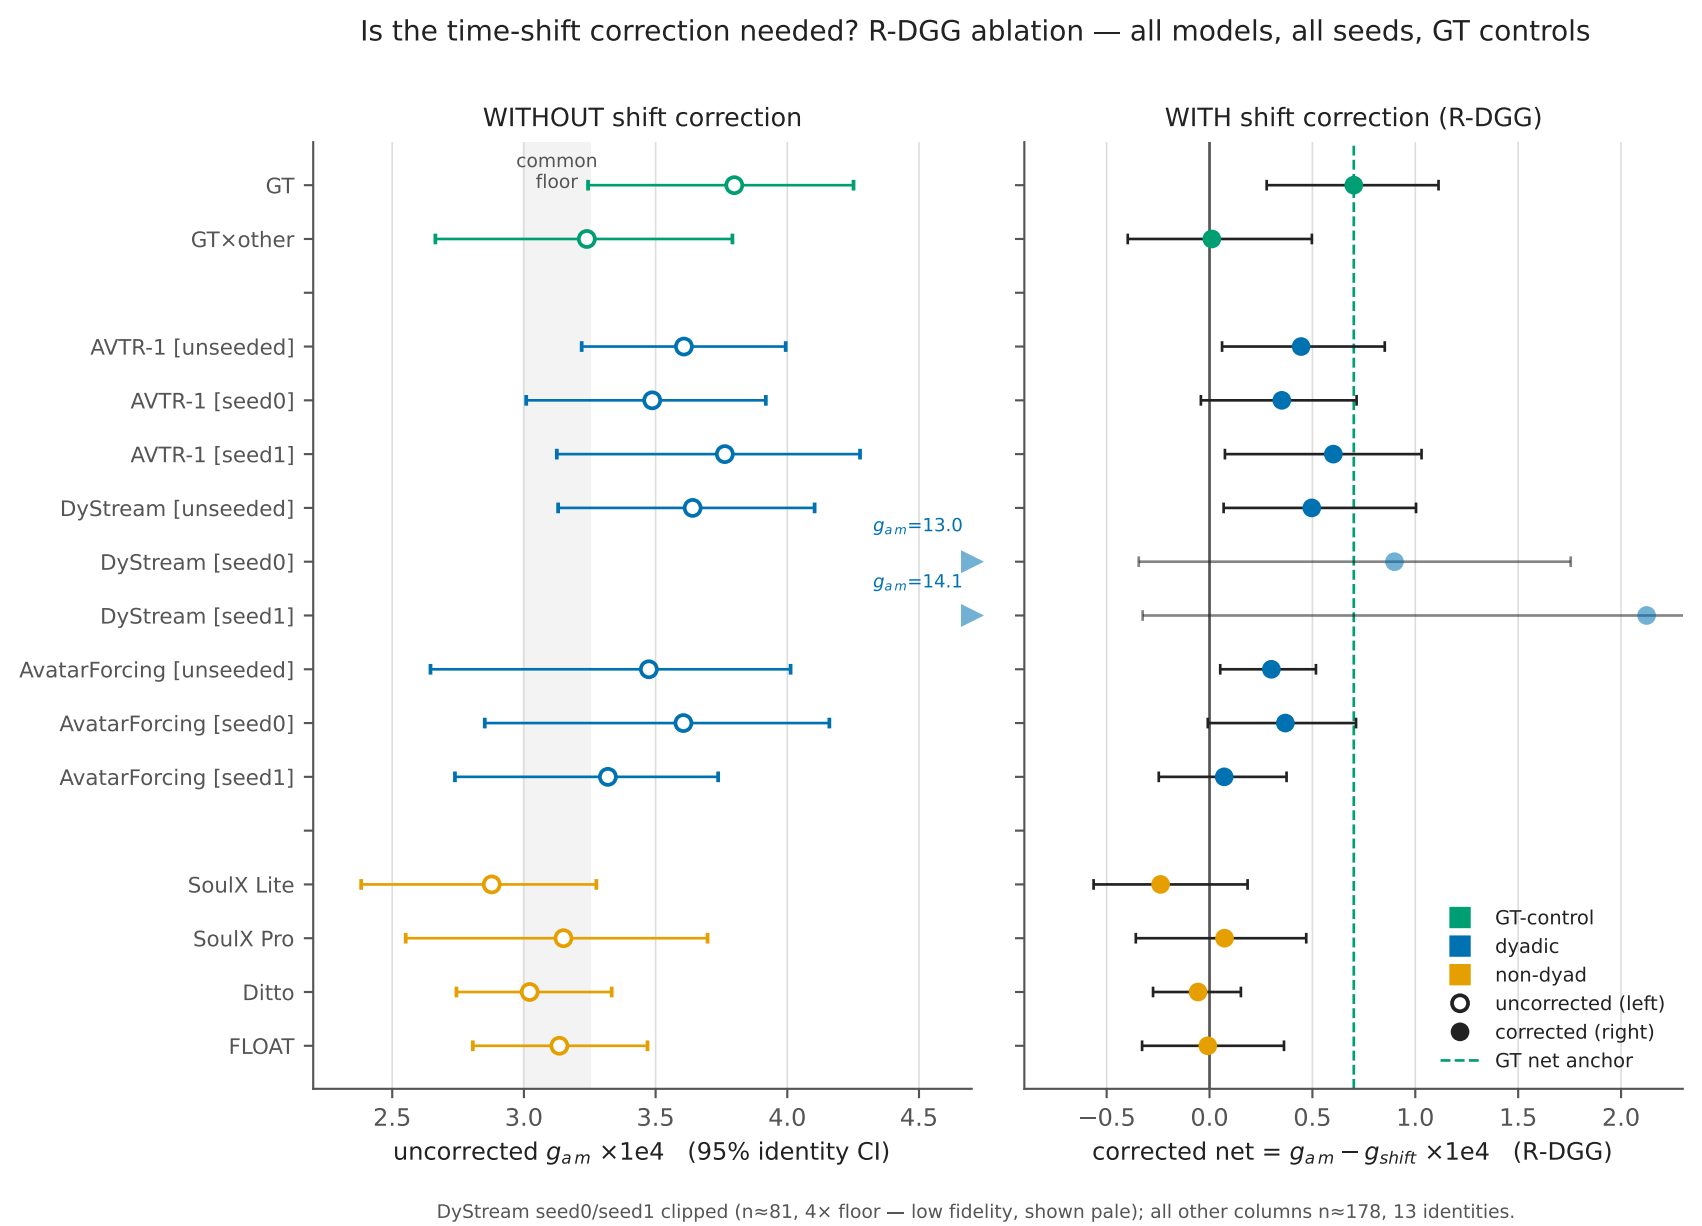
Is the time-shift correction needed? R-DGG ablation — all models, all seeds, GT controls
WITHOUT shift correction
WITH shift correction (R-DGG)
common floor
GT
GT×other
AVTR-1 [unseeded]
AVTR-1 [seed0]
AVTR-1 [seed1]
DyStream [unseeded]
DyStream [seed0]
DyStream [seed1]
AvatarForcing [unseeded]
AvatarForcing [seed0]
AvatarForcing [seed1]
SoulX Lite
SoulX Pro
Ditto
FLOAT
g_{am}=13.0
g_{am}=14.1
2.5
3.0
3.5
4.0
4.5
uncorrected g_{am} ×1e4 (95% identity CI)
−0.5
0.0
0.5
1.0
1.5
2.0
corrected net = $g_{am} - g_{shift}$ ×1e4 (R-DGG)
GT-control
dyadic
non-dyad
uncorrected (left)
corrected (right)
GT net anchor
DyStream seed0/seed1 clipped (n≈81, 4× floor — low fidelity, shown pale); all other columns n≈178, 13 identities.