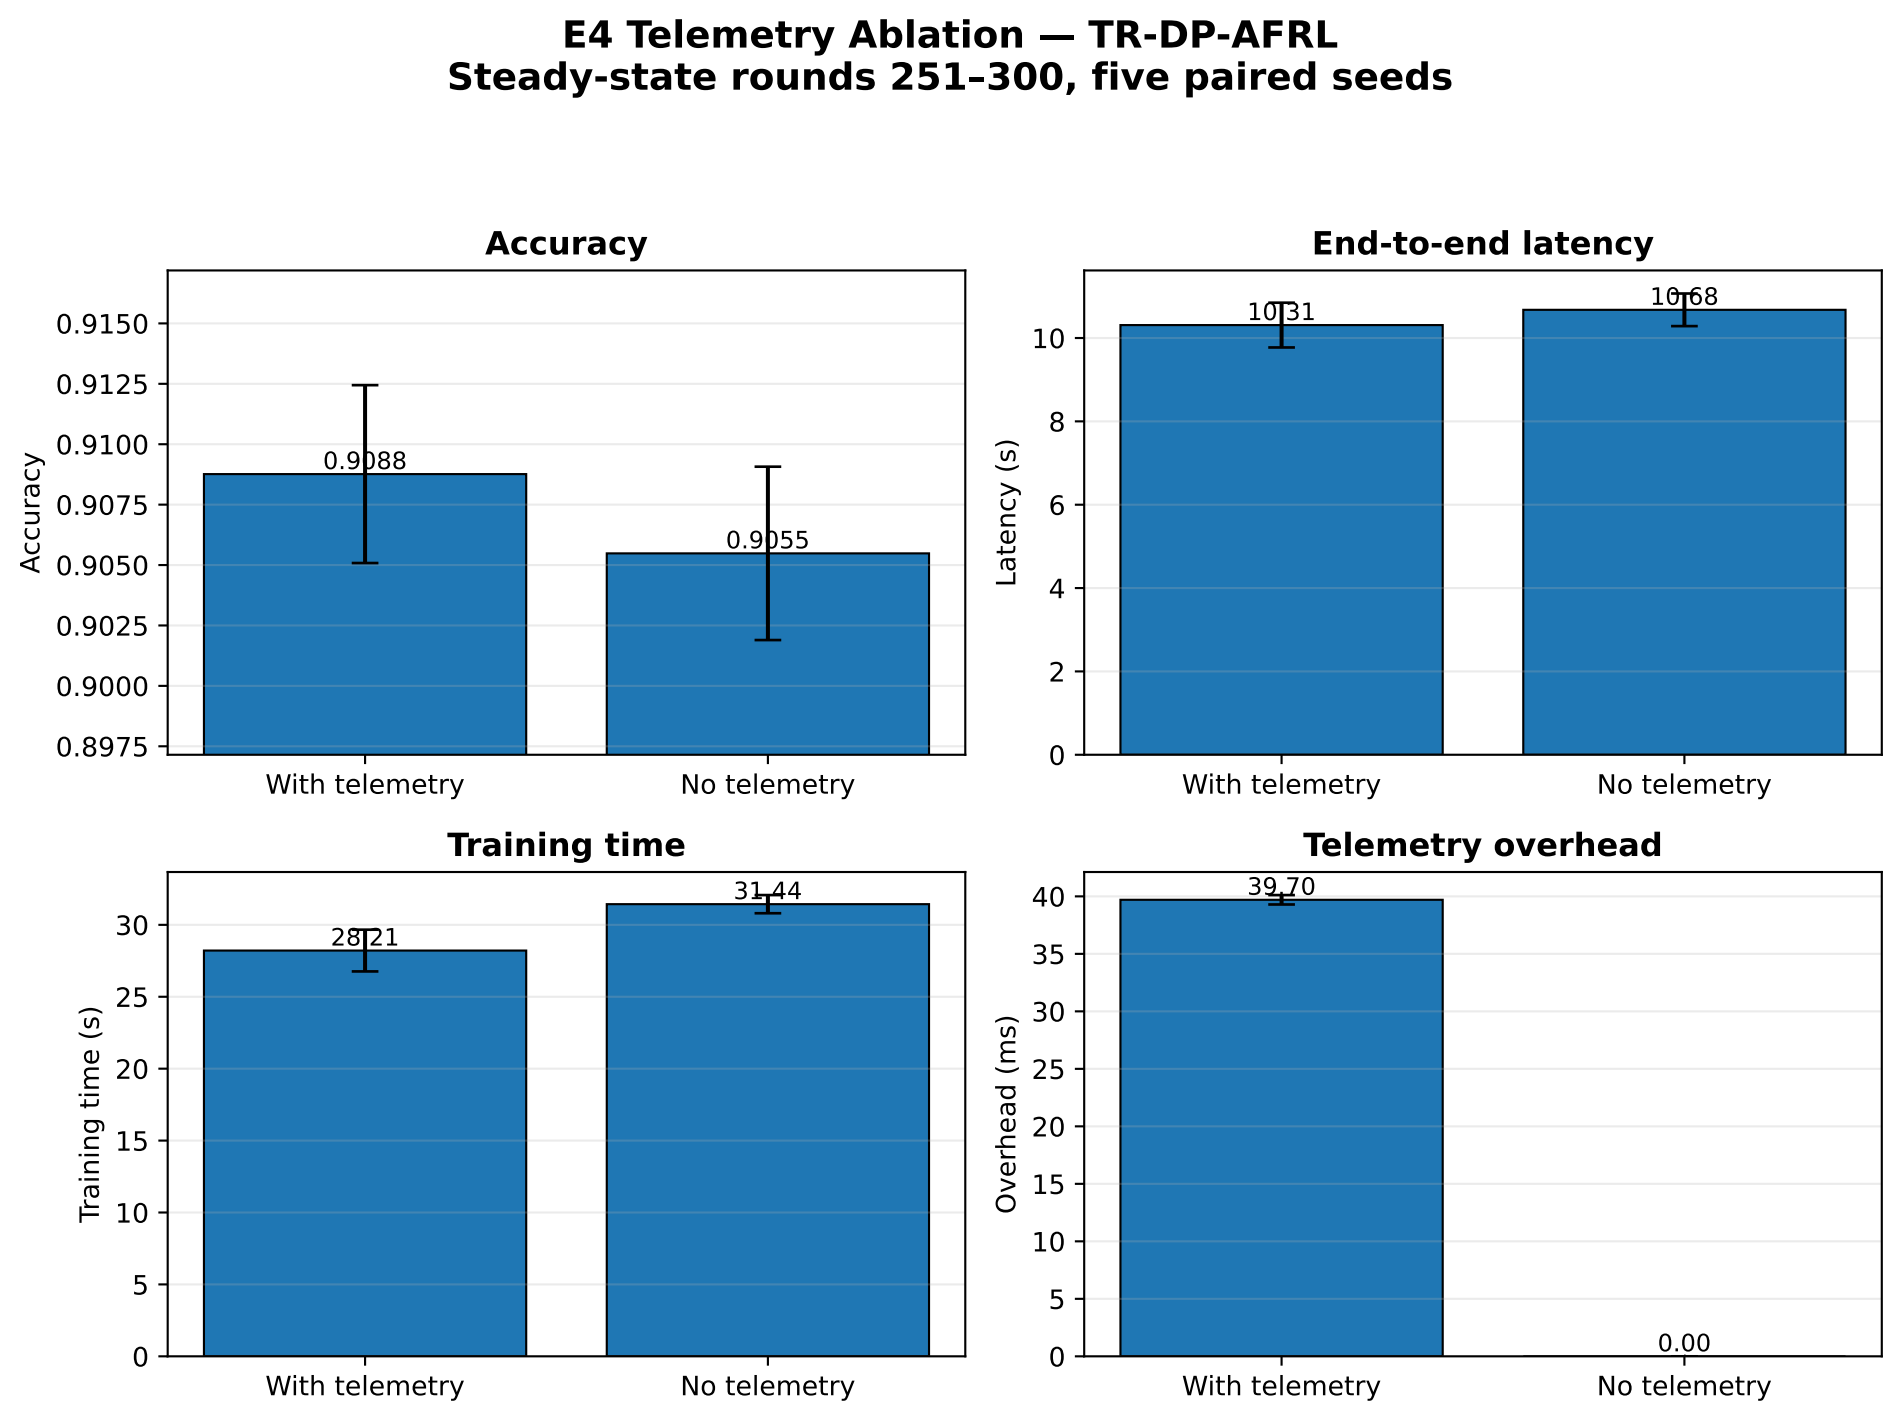
E4 Telemetry Ablation — TR-DP-AFRL
Steady-state rounds 251–300, five paired seeds
Accuracy
Accuracy
0.9150
0.9125
0.9100
0.9075
0.9050
0.9025
0.9000
0.8975
0.9088
0.9055
With telemetry
No telemetry
End-to-end latency
Latency (s)
10
8
6
4
2
0
10.31
10.68
With telemetry
No telemetry
Training time
Training time (s)
30
25
20
15
10
5
0
28.21
31.44
With telemetry
No telemetry
Telemetry overhead
Overhead (ms)
40
35
30
25
20
15
10
5
0
39.70
0.00
With telemetry
No telemetry