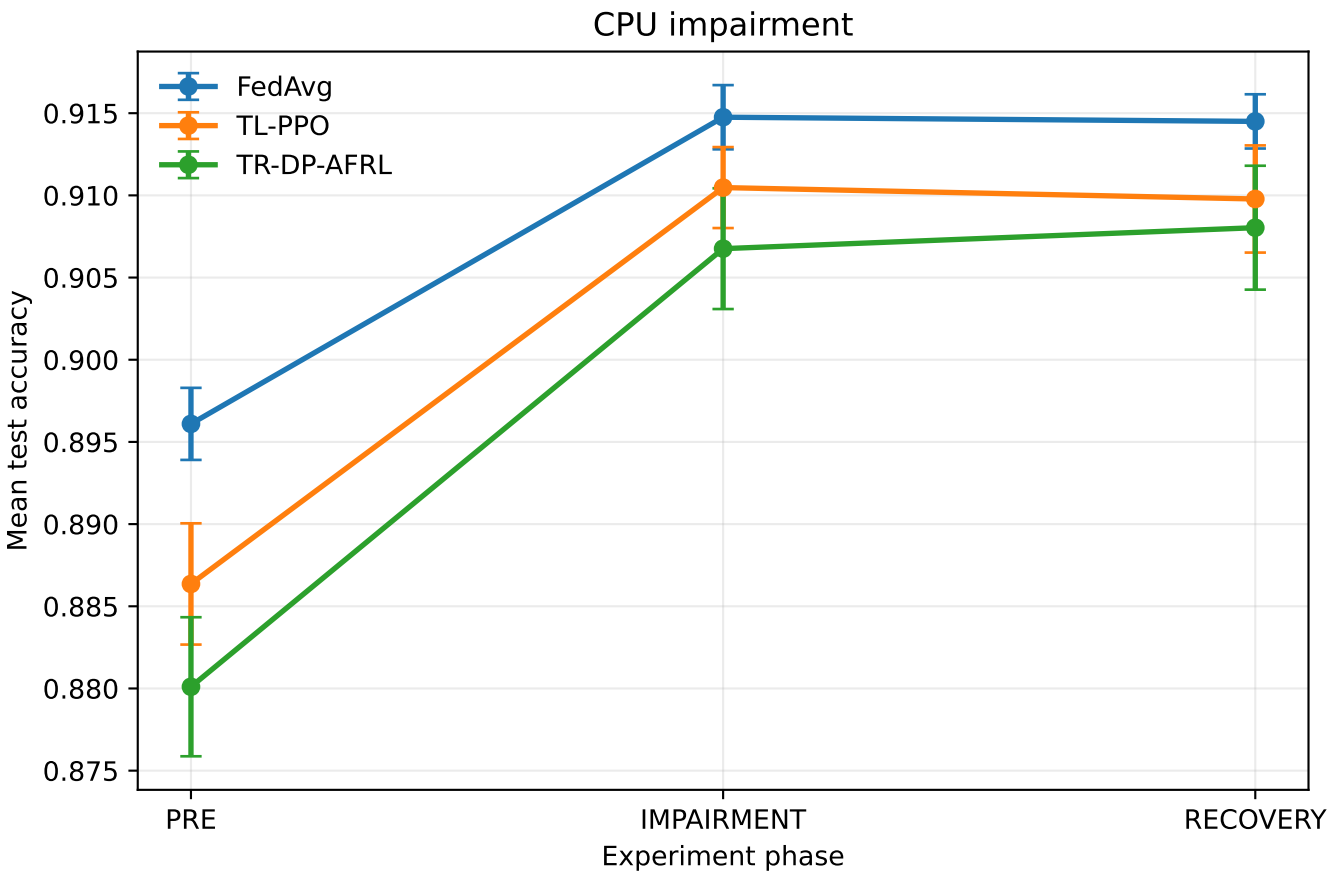
CPU impairment
FedAvg
TL-PPO
TR-DP-AFRL
Mean test accuracy
0.915
0.910
0.905
0.900
0.895
0.890
0.885
0.880
0.875
PRE
IMPAIRMENT
RECOVERY
Experiment phase