

PTX WIND
CONFIDENTIAL

NNF
NC
NO
CWS
CWR
OSBL

NORMALLY NO FLOW
NORMALLY CLOSE
NORMALLY OPEN
COOLING WATER SUPPLY
COOLING WATER RETURN
OUTSIDE NETTERY LIMIT


		DATE	NAME
Drawn		NOV 2022	Jain
Prepared		NOV 2022	Jain
Checked			
Approved			


SIZE	FSCM NO	DWG NO	REV
		1011-02 Methanol Synthesis-Methanol Reactor	
SCALE 1 : 1		SHEET 2 OF 4	

TON	1011R001	1011EE02	1011EE03	1011P001	1011P002
DESIGNATION	Methanol Reactor	Reactor Feed Preater	Water Heater (electrical)	Start-Up Pump	Refill Pump
TON	1011EE01				
DESIGNATION	Syngas Preheater (Electrical)				

DRAWN Jain, Darshan Maheshkumar (IMVT)

ISSUED

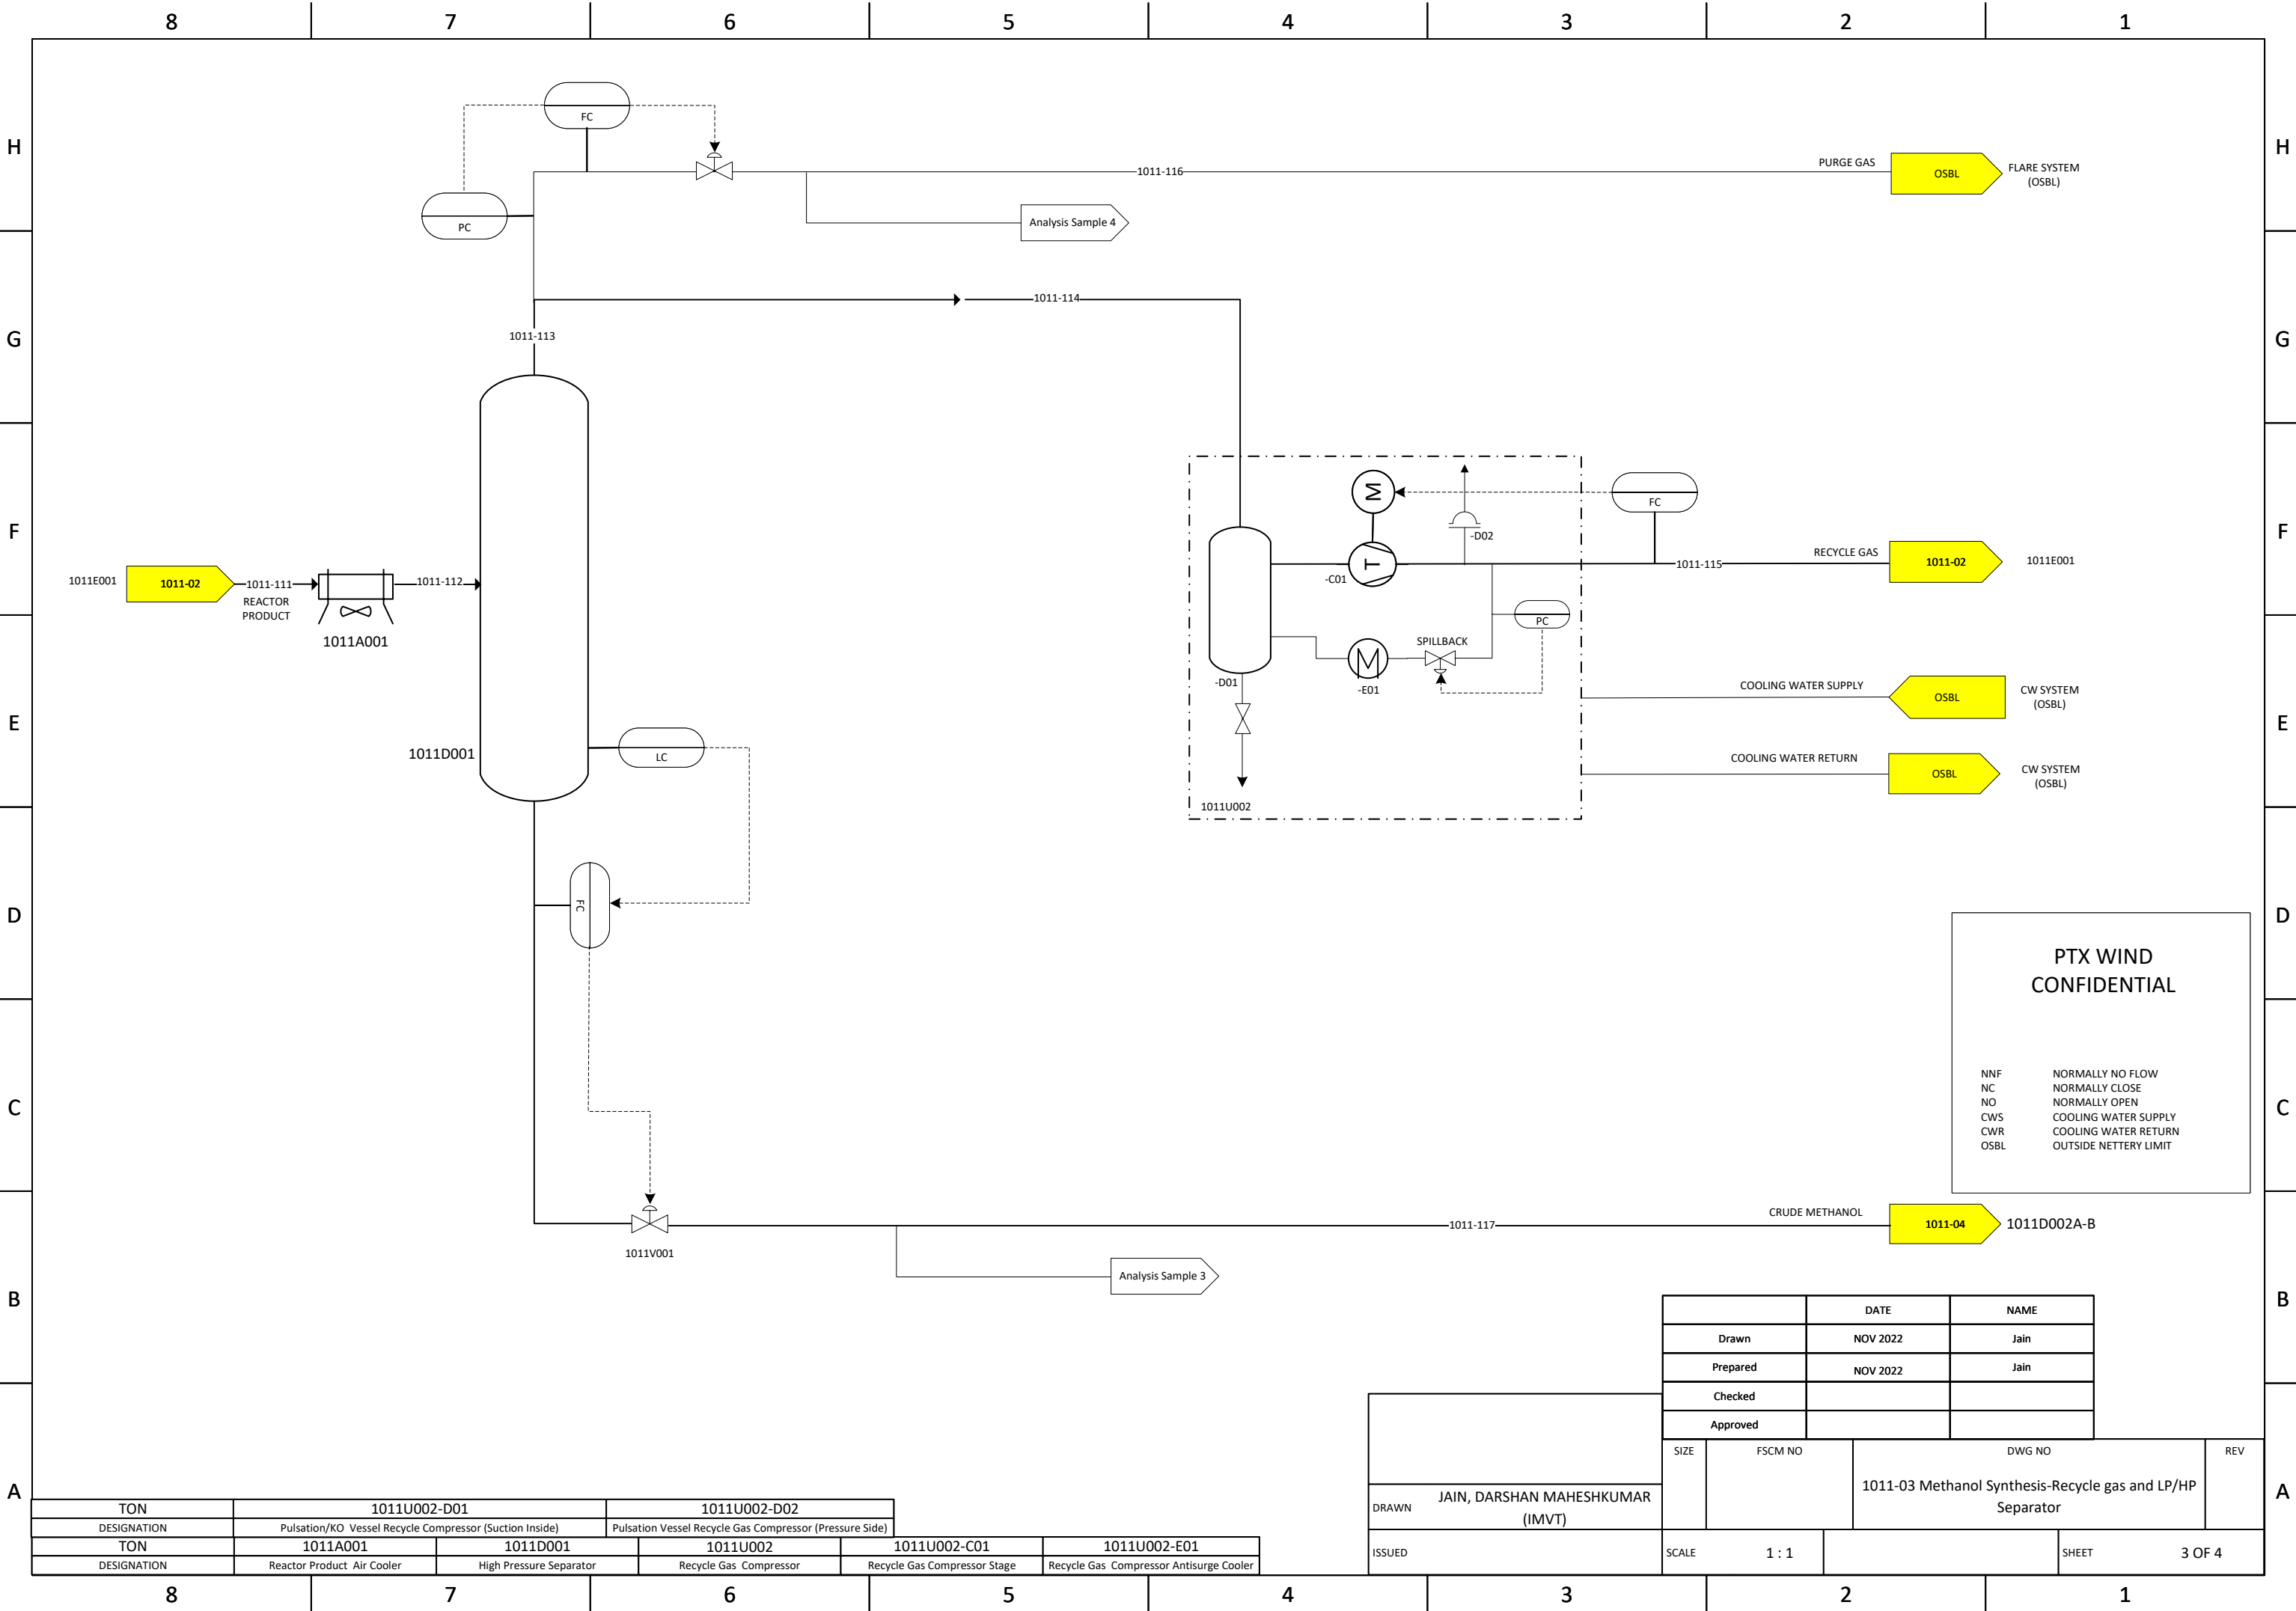

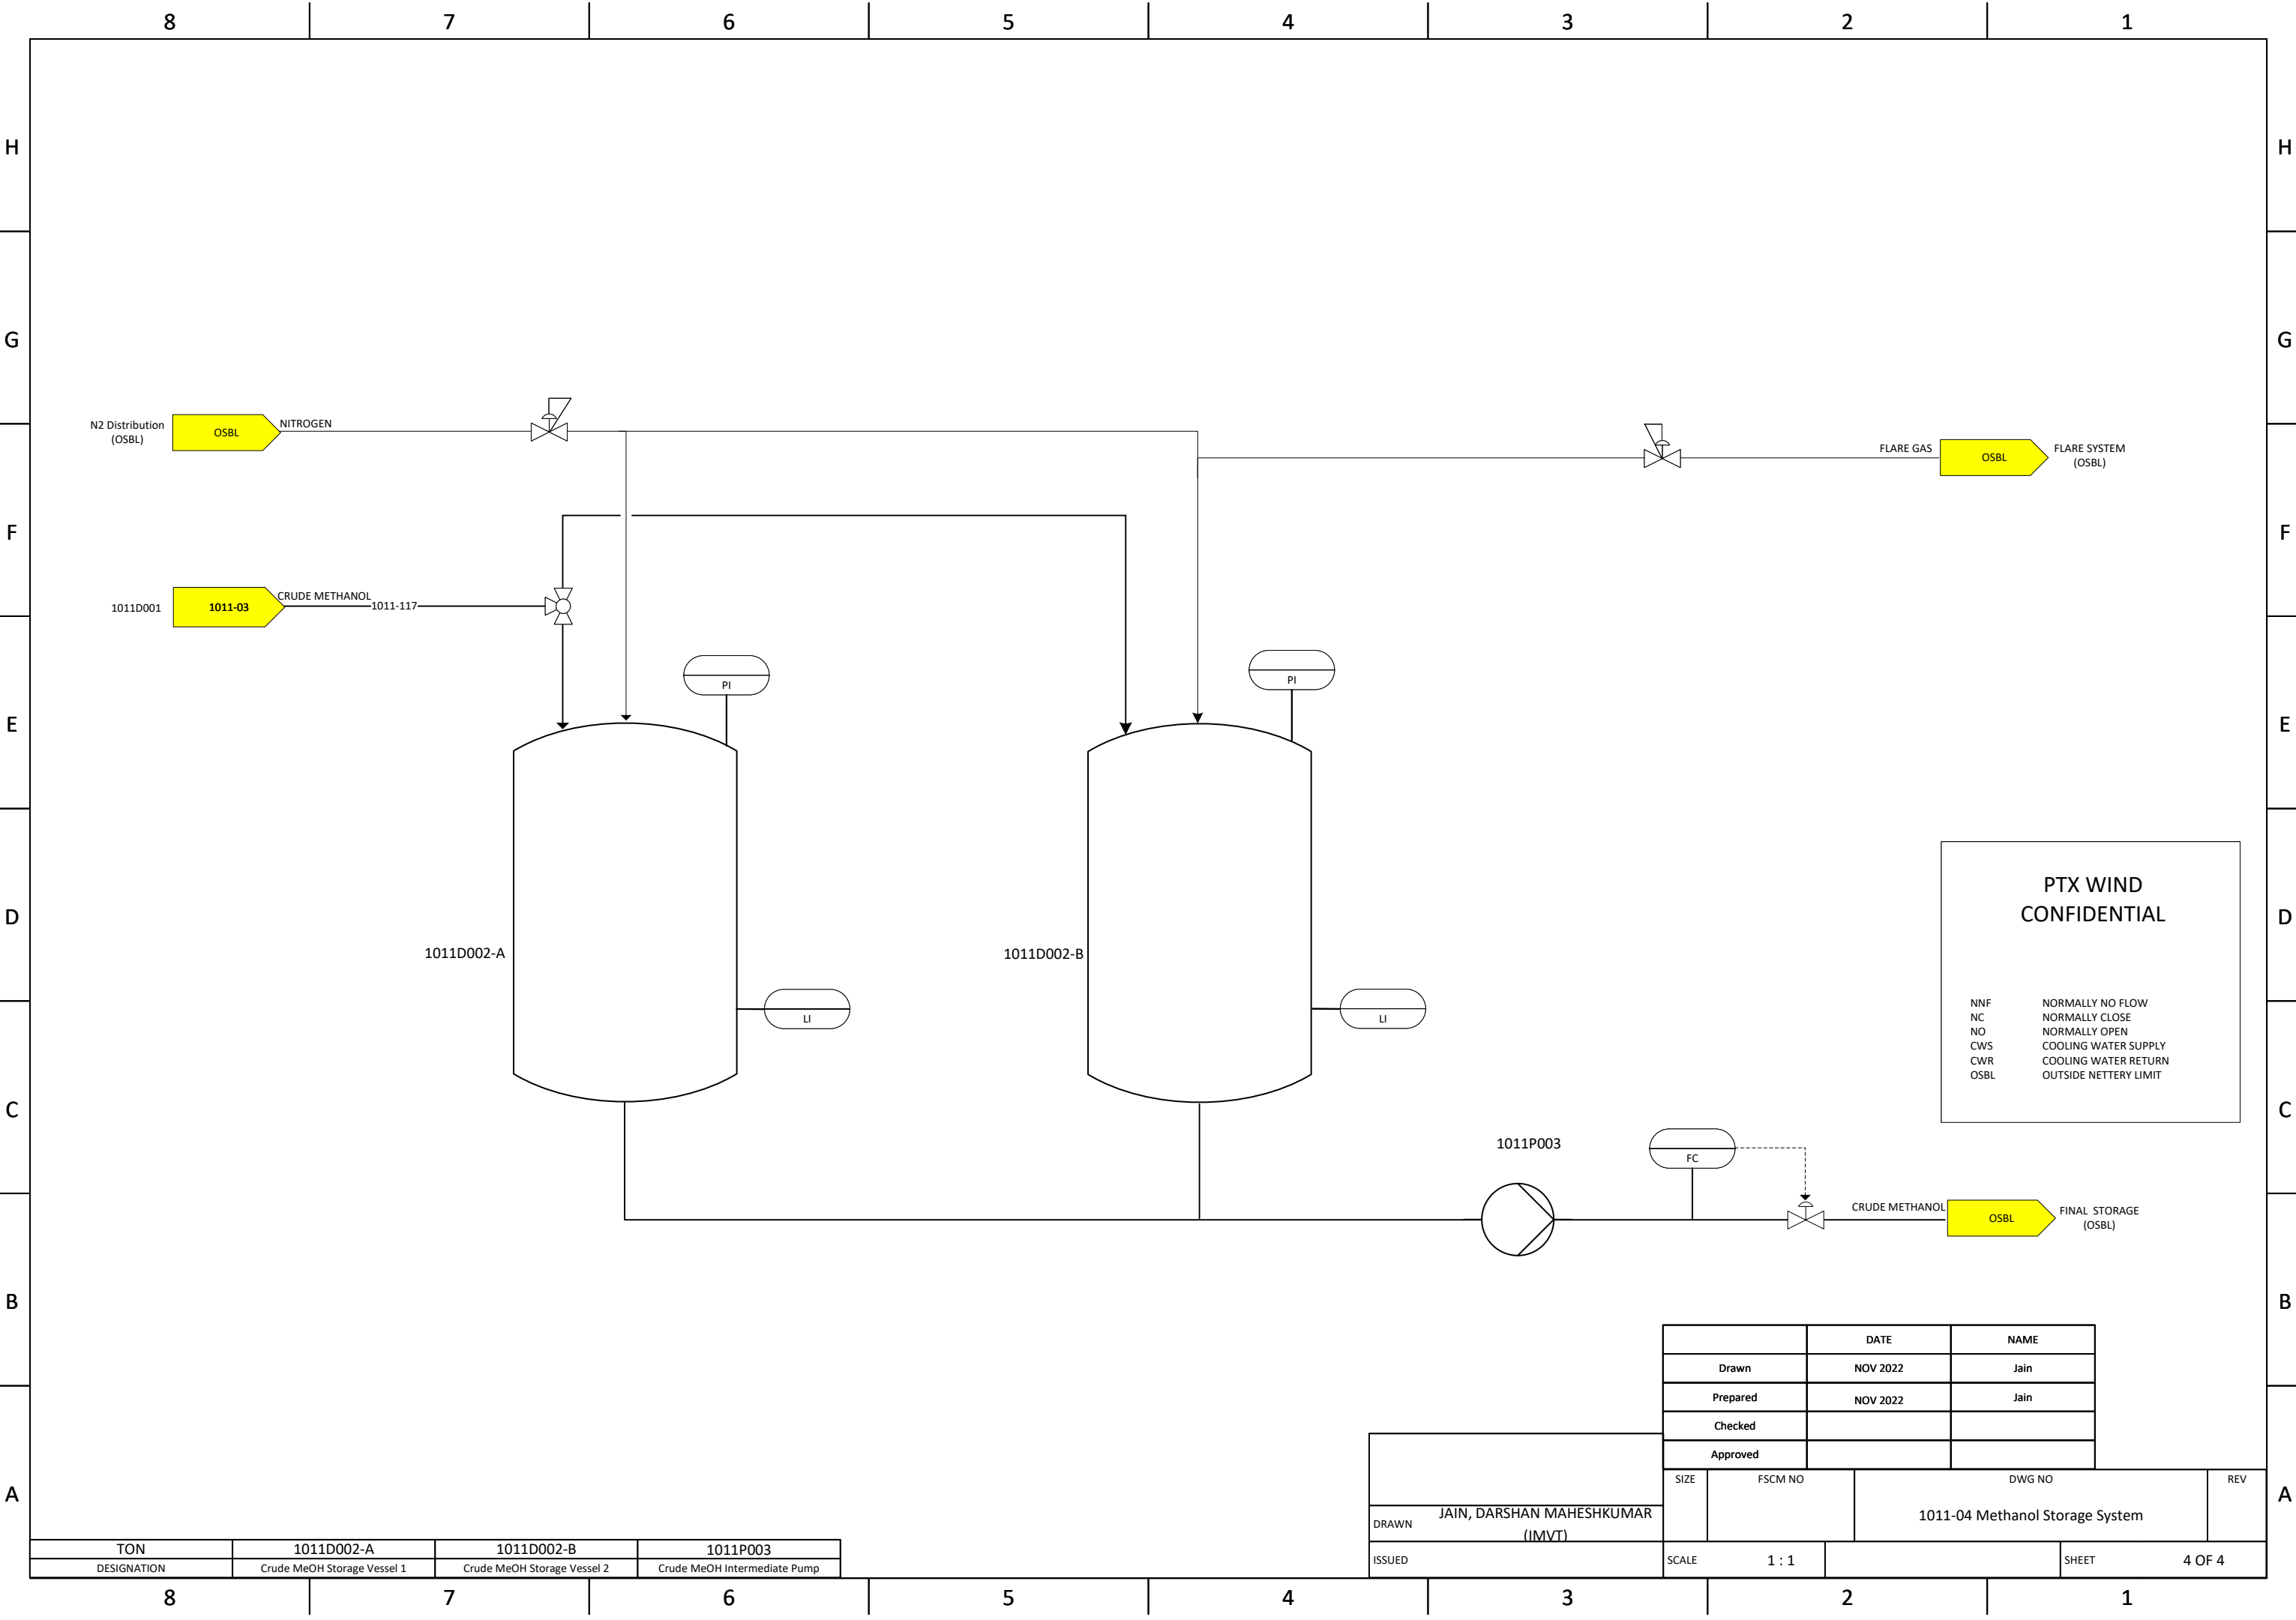

PTX WIND
CONFIDENTIAL

NNF NORMALLY NO FLOW
NC NORMALLY CLOSE
NO NORMALLY OPEN
CWS COOLING WATER SUPPLY
CWR COOLING WATER RETURN
OSBL OUTSIDE NETTERY LIMIT

TON	1011D002-A	1011D002-B	1011P003
DESIGNATION	Crude MeOH Storage Vessel 1	Crude MeOH Storage Vessel 2	Crude MeOH Intermediate Pump

DRAWN JAIN, DARSHAN MAHESHKUMAR (IMVT)		DATE	NAME
		NOV 2022	Jain
		NOV 2022	Jain
ISSUED	SCALE	FSCM NO	DWG NO
	1 : 1		1011-04 Methanol Storage System
			REV
			4 OF 4