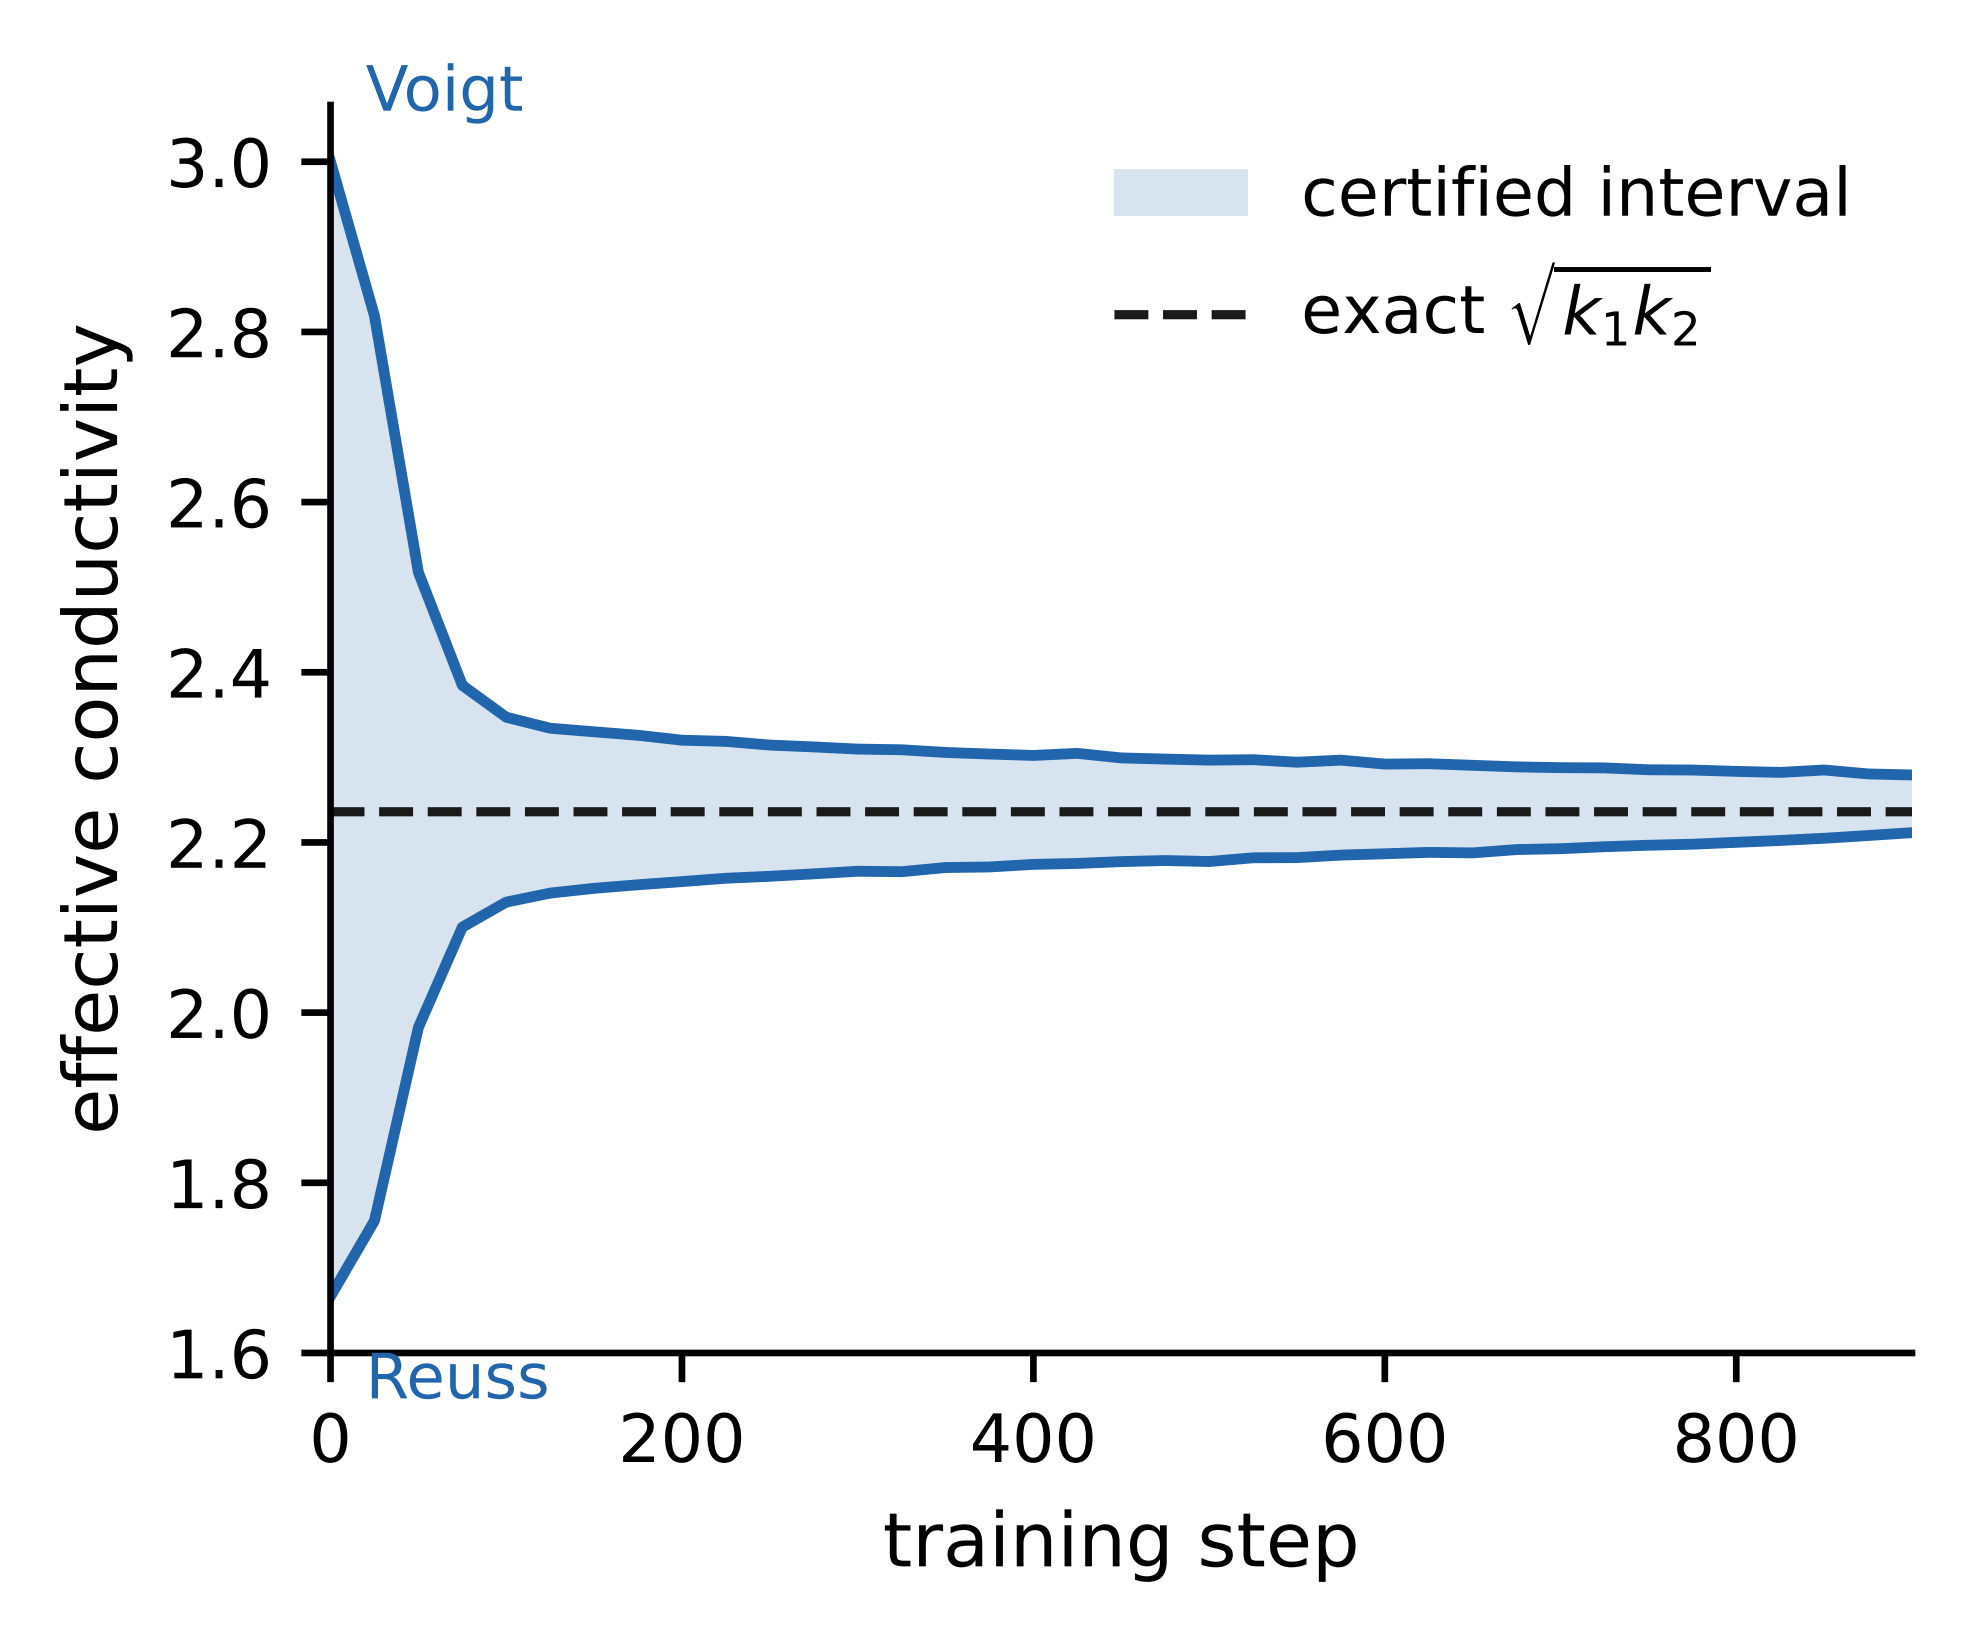
Voigt
Reuss
certified interval
exact $\sqrt{k_1 k_2}$
effective conductivity
training step
3.0
2.8
2.6
2.4
2.2
2.0
1.8
1.6
0
200
400
600
800