




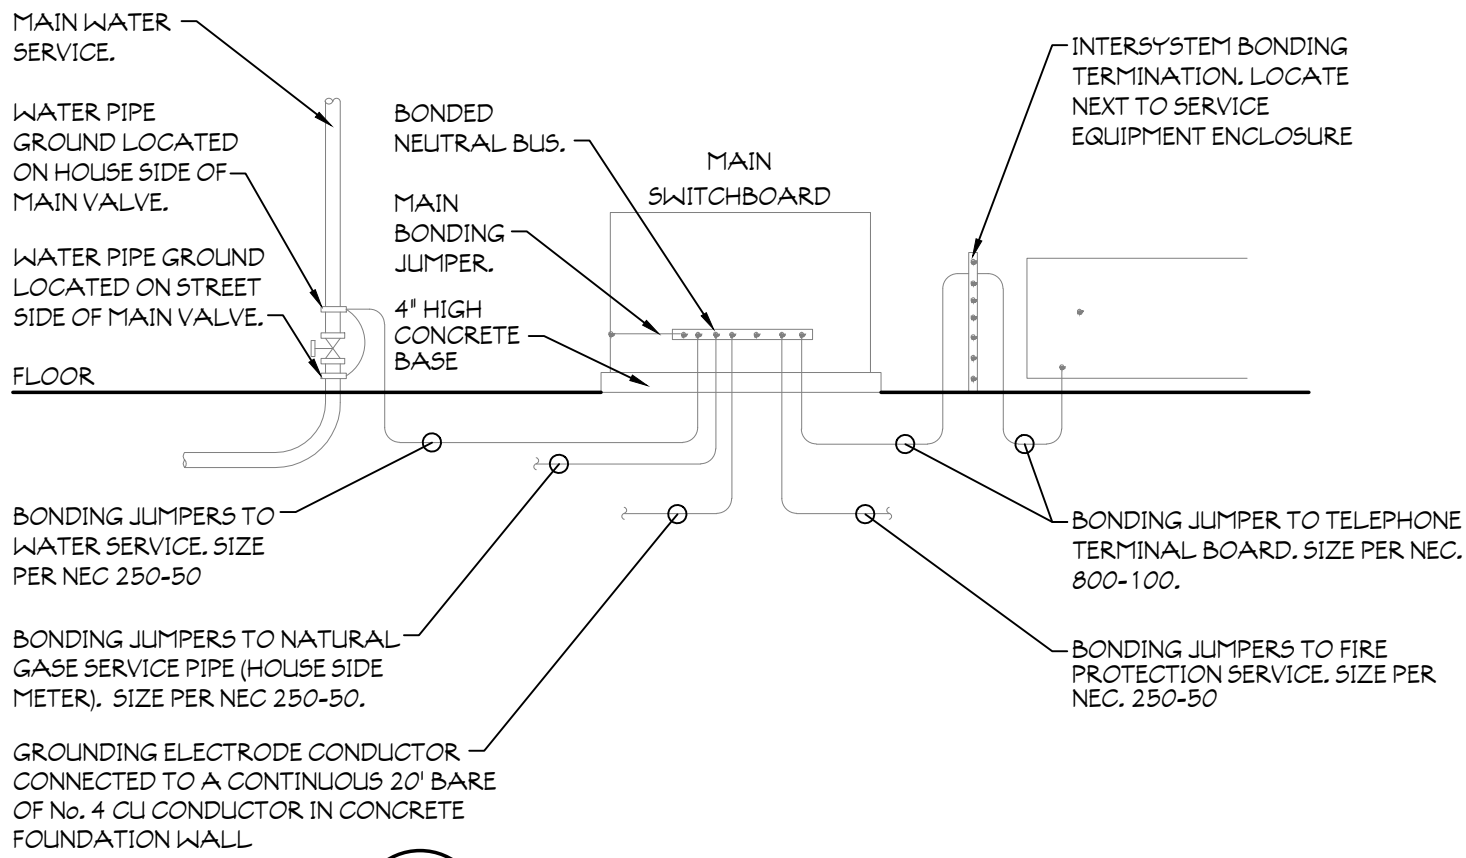


5 SYSTEM GROUNDING DETAIL
SCALE: NOT TO SCALE

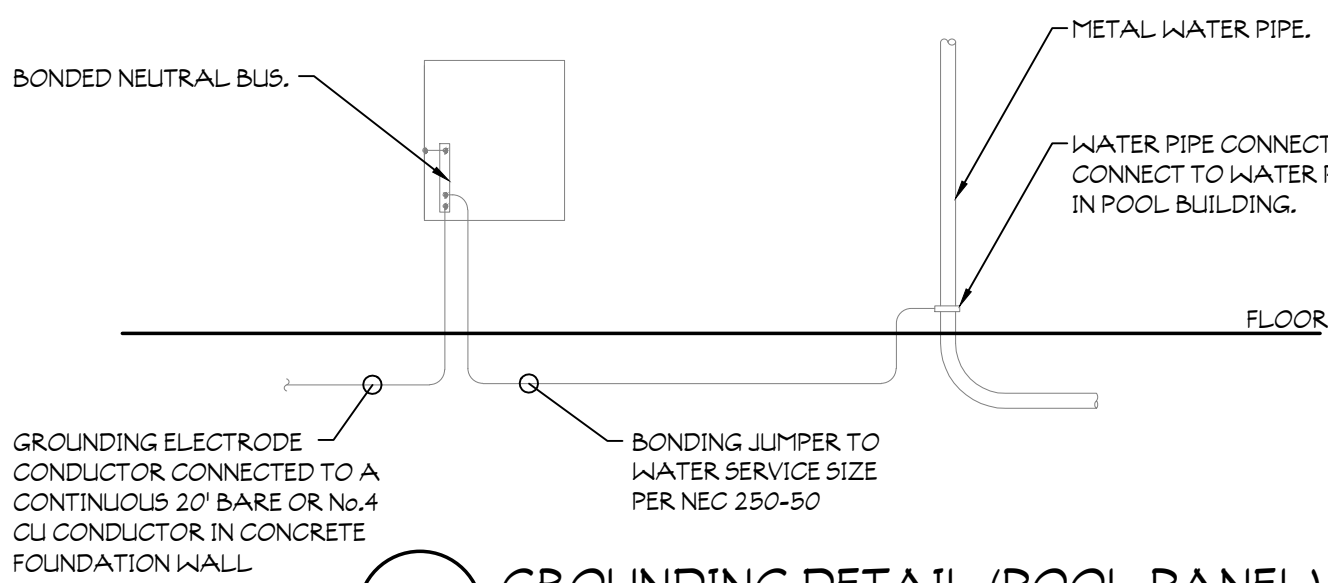


6 GROUNDING DETAIL (POOL PANEL)
SCALE: NOT TO SCALE

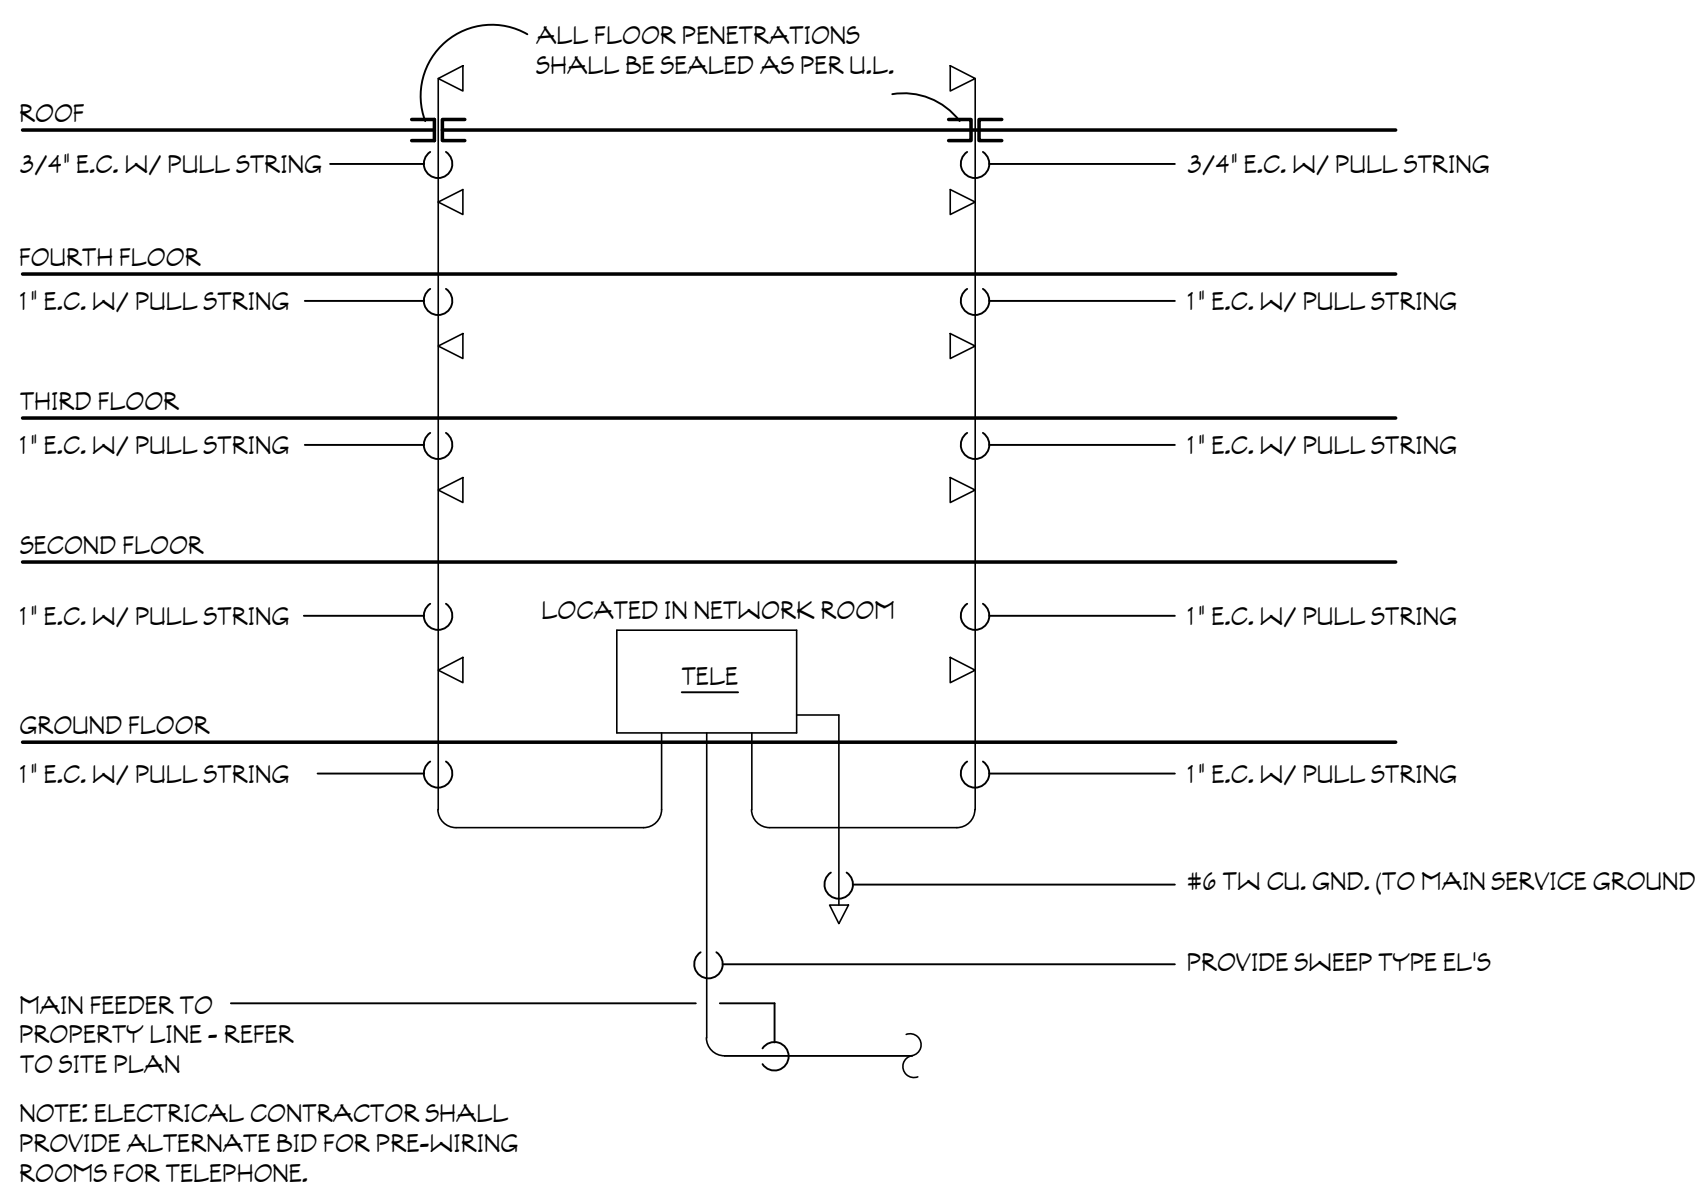


7 TYP. GUEST ROOM TELEPHONE RISER DIAGRAM
SCALE: NOT TO SCALE

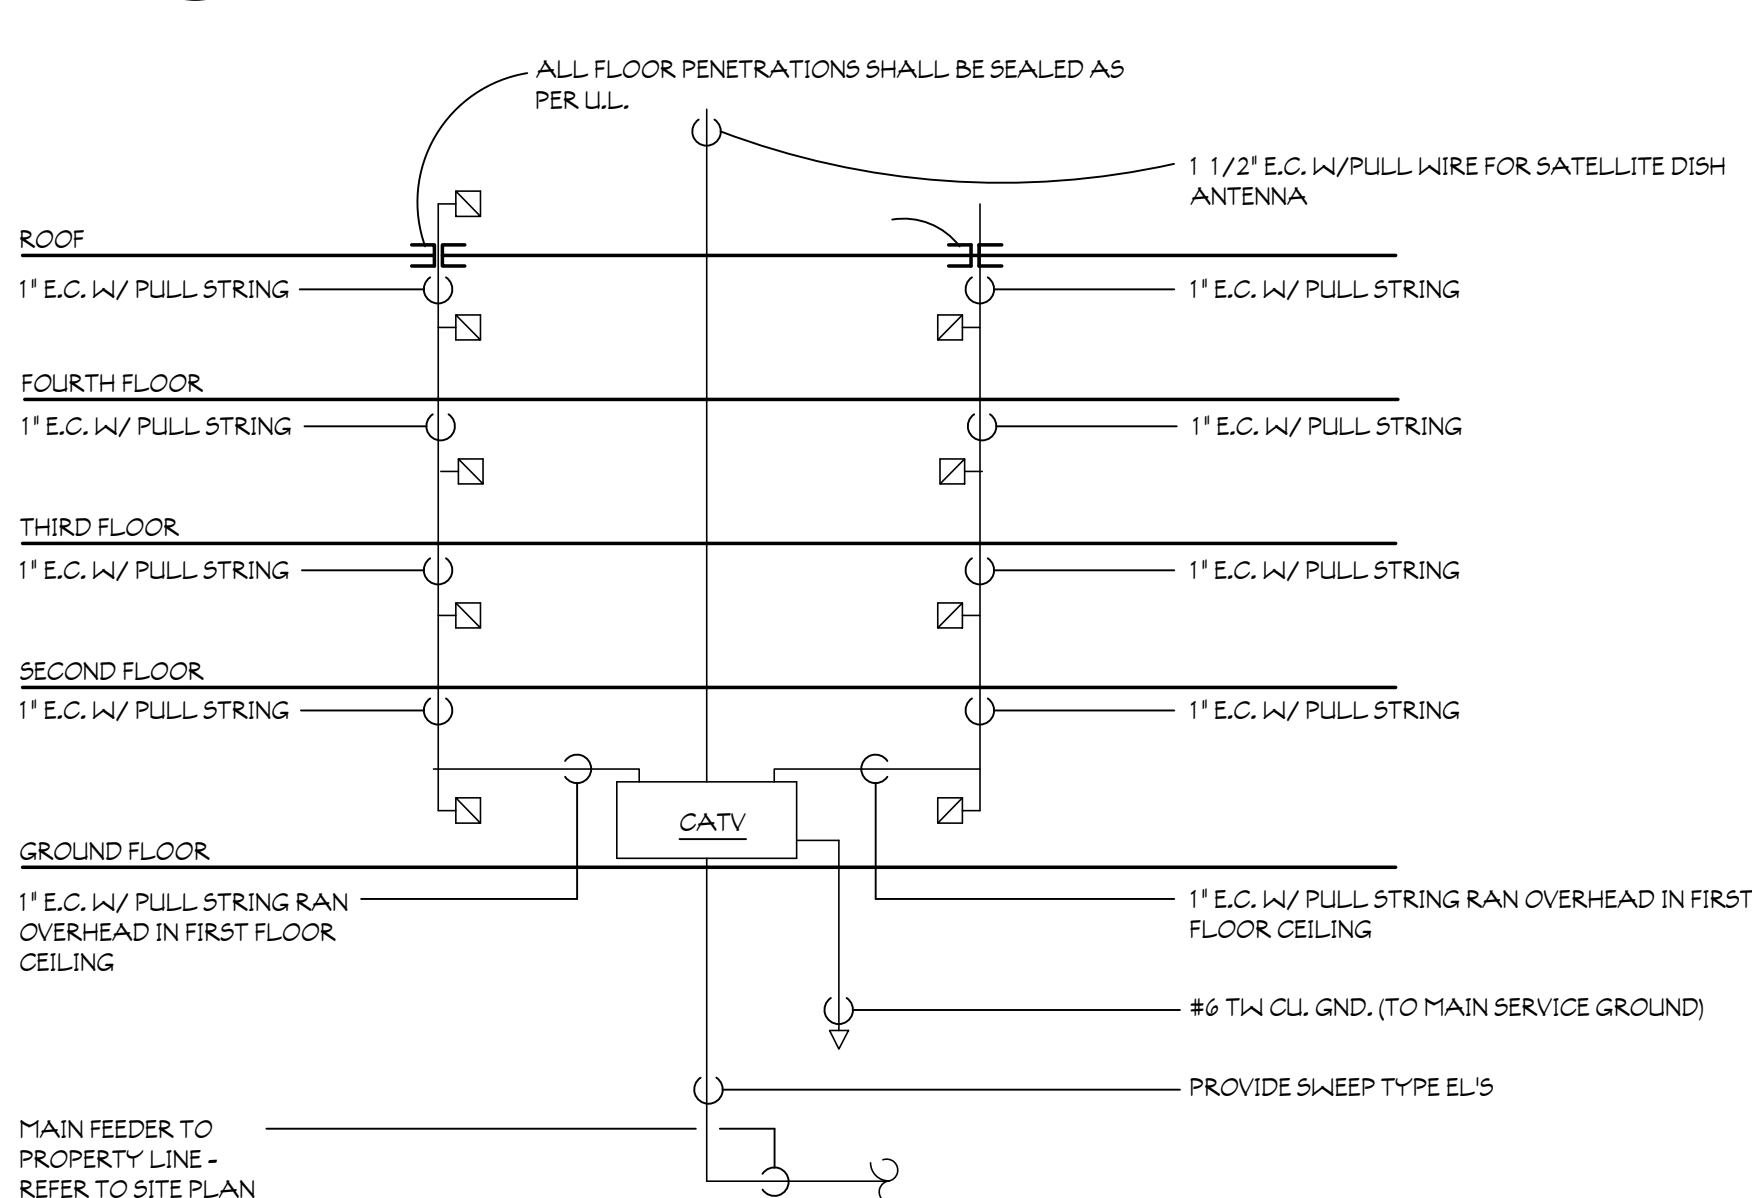


8 TYP. GUEST ROOM CABLE T.V. RISER DIAGRAM
SCALE: NOT TO SCALE

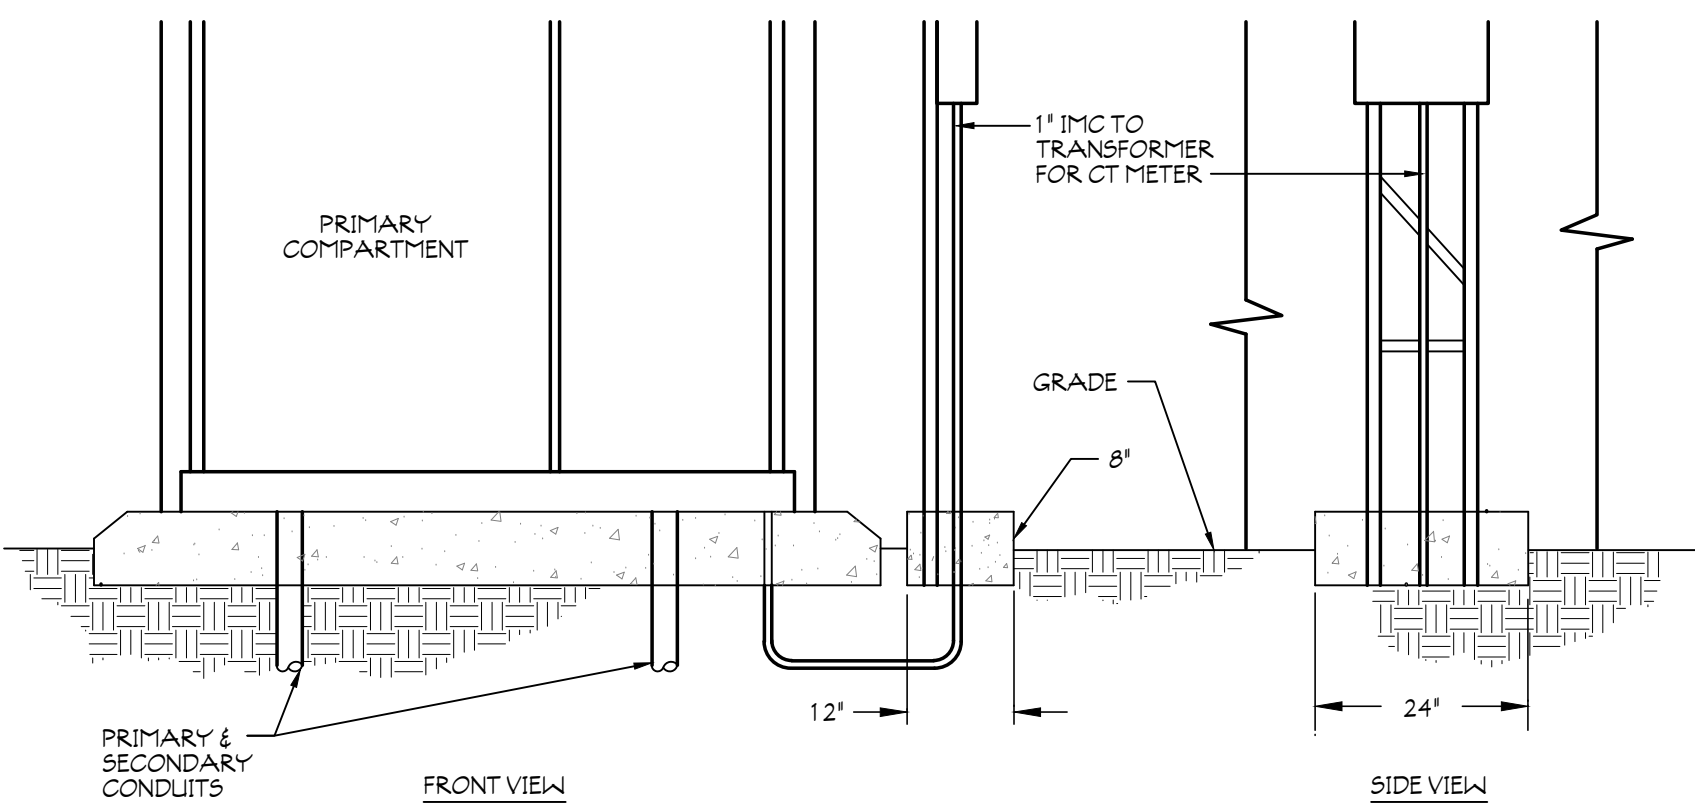

4 TRANSFORMER METER DETAIL
SCALE: NOT TO SCALE

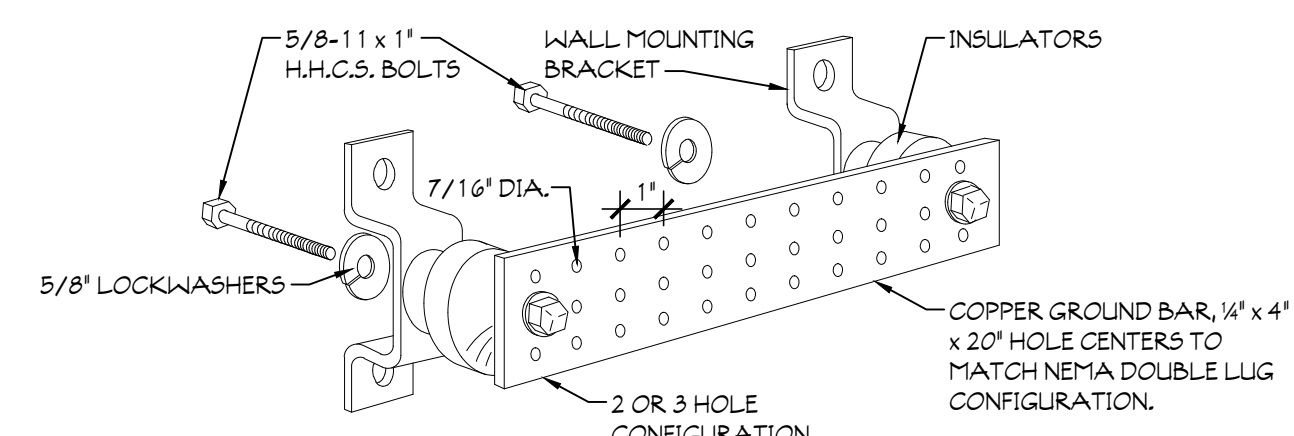


3 GROUNDING DETAIL
SCALE: NOT TO SCALE

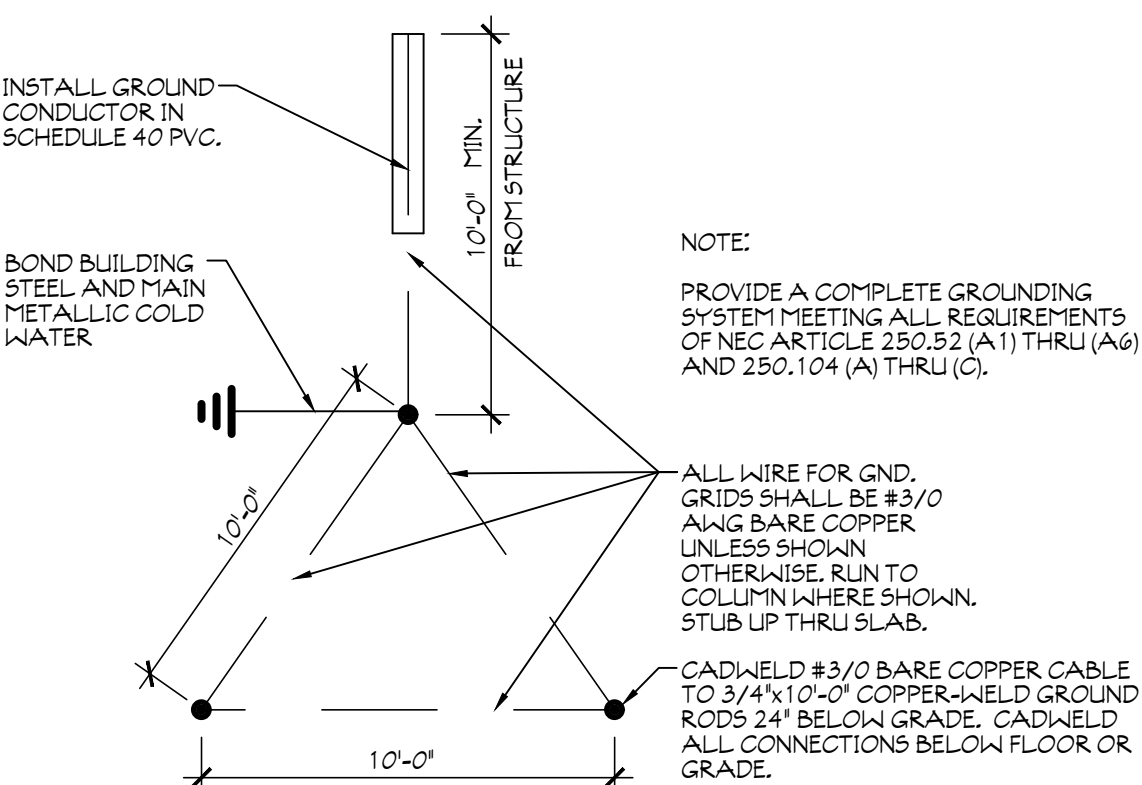


2 GROUNDING DETAIL
SCALE: NOT TO SCALE

SCHEDULE OF MAIN DISTRIBUTION PANEL "MDP"											ELECTRICAL 118B														
MAINS:		3000		VOLT:		120/208		PHASE: 3		WIRE:				4		MIN BREAK A/C		65,000		MOUNT: PAD					
FEEDER/ BRANCH CIRCUITS											TO FEED		CONNECTED LOAD KVA		DEMAND LOAD KVA		CIRCUIT BREAKERS					REMARKS			
DISIGNATION		SETS		WIRE SIZE		GRD COND.		CONDUIT SIZE		FRAME							AMPS		POLES						
1				2 (4) #3/0		#3		2 1/2"		H		90.8		43.3		400		400		3					
2				1 (4) #3/0		#6		2"		K		93.8		31.5		225		200		3					
3				2 (4) #3/0		#3		2 1/2"		L		133.4		118.3		400		400		3					
4				1 (4) #3/0		#3		2 1/2"		A		148.4		84.16		400		400		3					
5				1 (4) #3/0		#6		2"		B		65.6		32.62		225		200		3					
6				1 (4) #3/0		#6		2"		P		39.5		35.62		225		200		3					
7				1 (4) #3/0		#3		2 1/2"		2A		193.6		111.12		400		400		3					
8				1 (4) #3/0		#3		2 1/2"		2B		152.8		84.99		400		400		3					
9				1 (4) #3/0		#3		2 1/2"		3A		193.6		111.12		400		400		3					
10				1 (4) #3/0		#3		2 1/2"		3B		152.8		84.99		400		400		3					
11				1 (4) #3/0		#3		2 1/2"		4A		193.6		111.12		400		400		3					
12				1 (4) #3/0		#3		2 1/2"		4B		152.8		84.99		400		400		3					
13				1 (4) #3/0		#6		2"		4C		84.4		78		225		200		3					
14				1 (4) #3/0		#6		2"		ELEVATOR		12.5 *		12.5 *		60 *		60 *		3					
15				1 (4) #3/0		#6		2"		ELEVATOR		12.5 *		12.5 *		60 *		60 *		3					
16																									
17																									
18																									
19																									
20																									
21																									
22																									
23																									
24																									
NOTES		* Verify with Elevator Manufacturer								TOTAL DEMAND KVA:						1011.83						TOTAL AMPS:		2812	

KEY NOTE: (APPLIES TO THIS SHEET ONLY)

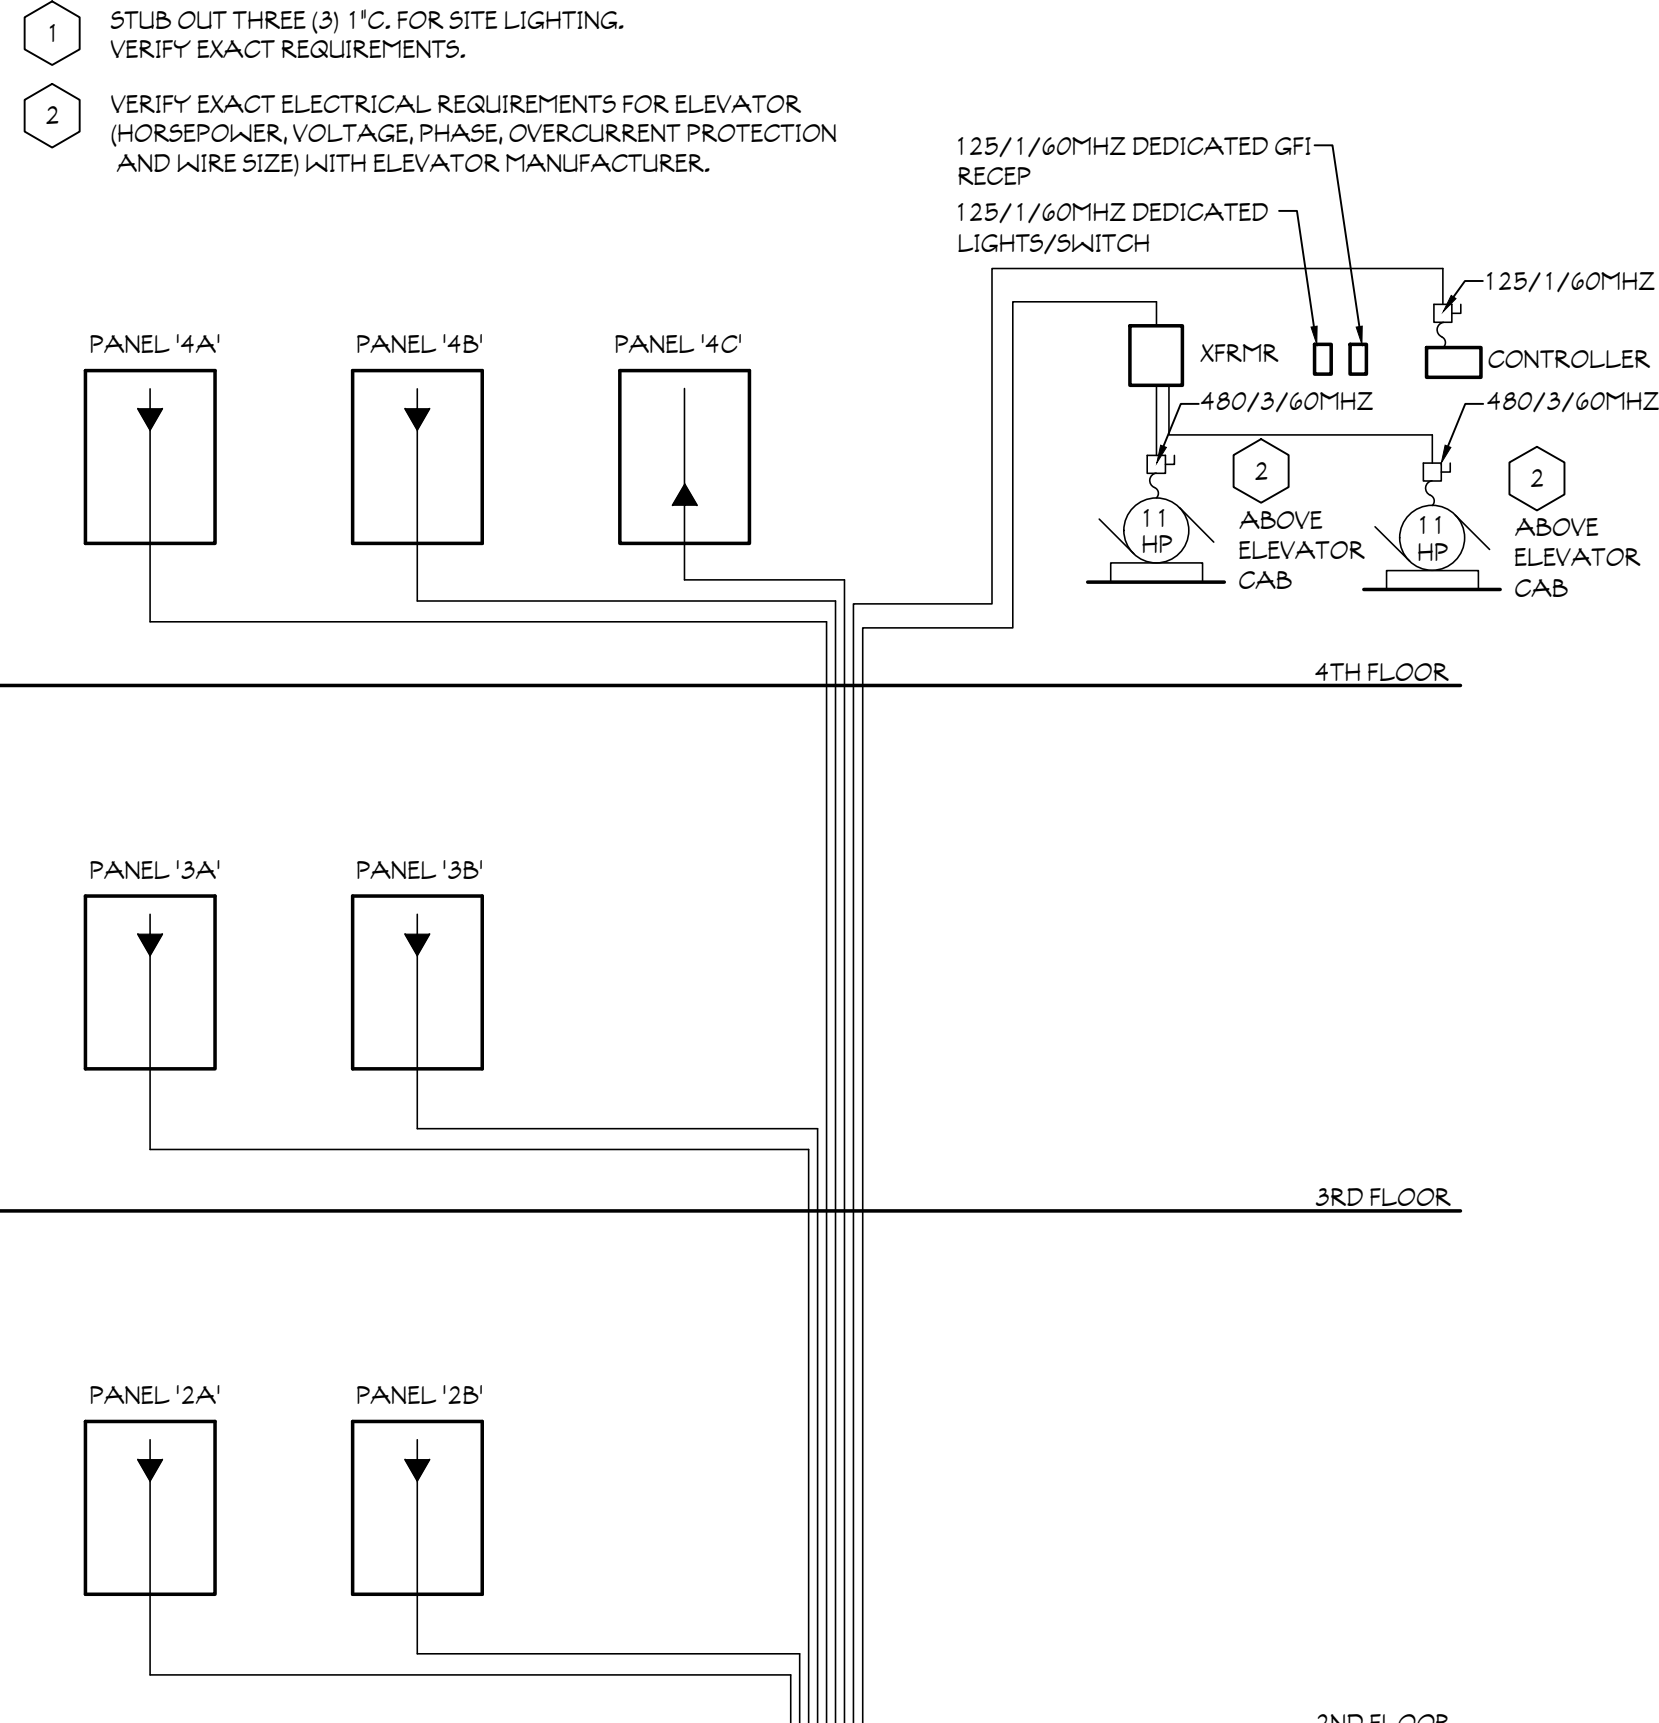

1 POWER RISER DIAGRAM
SCALE: NOT TO SCALE

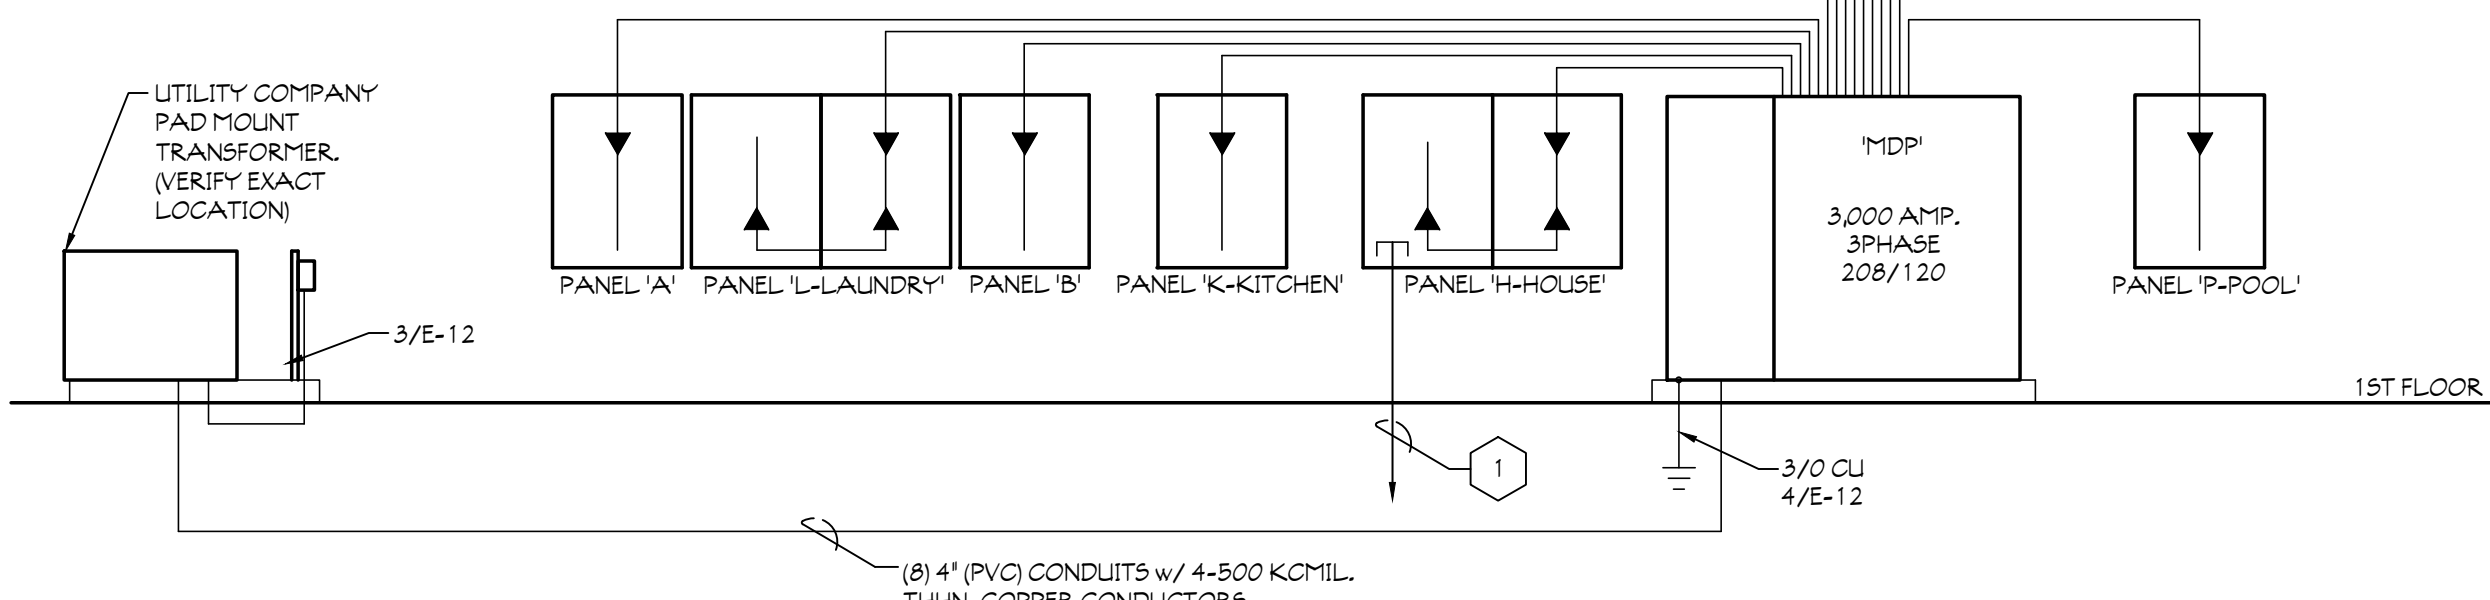

NOTES:

ELECTRICAL EQUIPMENT, SUCH AS SWITCHBOARDS, SWITCHGEAR, PANELBOARDS, INDUSTRIAL CONTROL PANELS, METER SOCKET ENCLOSURES, AND MOTOR CONTROL CENTERS, THAT IS IN OTHER THAN DWELLING UNITS, AND IS LIKELY TO REQUIRE EXAMINATION, ADJUSTMENT, SERVICING, OR MAINTENANCE WHILE ENERGIZED, SHALL BE FIELD OR FACTORY MARKED TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS. THE MARKING SHALL MEET THE REQUIREMENTS IN 110.2.1(B) AND SHALL BE LOCATED SO AS TO BE CLEARLY VISIBLE TO QUALIFIED PERSONS BEFORE EXAMINATION, ADJUSTMENT, SERVICING, OR MAINTENANCE OF THE EQUIPMENT.

SERVICE EQUIPMENT AT OTHER THAN DWELLING UNITS SHALL BE LEGIBLY MARKED IN THE FIELD WITH THE MAXIMUM AVAILABLE FAULT CURRENT. THE FIELD MARKING(S) SHALL INCLUDE THE DATE THE FAULT-CURRENT CALCULATION WAS PERFORMED AND BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED.

ALL SWITCHBOARDS, SWITCHGEAR, AND PANELBOARDS SUPPLIED BY A FEEDER SHALL BE PERMANENTLY MARKED TO INDICATE EACH DEVICE OR EQUIPMENT WHERE THE POWER ORIGINATES. THE LABEL SHALL BE PERMANENTLY AFFIXED OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED, AND NOT HANDWRITTEN.

IN OTHER THAN GUESTROOMS, A PERMANENT LABEL SHALL BE FIELD OR FACTORY APPLIED TO SERVICE EQUIPMENT RATED 1200 AMPS OR MORE. THE LABEL SHALL MEET THE REQUIREMENTS OF 110.2.1(B) AND CONTAIN THE FOLLOWING INFORMATION:

NOMINAL SYSTEM VOLTAGE.
AVAILABLE FAULT CURRENT AT THE SERVICE OVERCURRENT PROTECTIVE DEVICES.
THE CLEARING TIME OF SERVICE OVERCURRENT PROTECTIVE DEVICES BASED ON THE AVAILABLE FAULT CURRENT AT THE SERVICE EQUIPMENT.
THE DATE THE LABEL WAS APPLIED.

GUESTROOM PANELS ARE TO BE SUPPLIED BY #2-4 SER. CABLE FROM FLOOR SERVICE PANELS

GENERAL NOTES

ALTHOUGH DRAWINGS ARE DRAWN TO SCALE, THE ACCURACY OF THE DRAWINGS CANNOT BE GUARANTEED. FIELD MEASUREMENTS AND VERIFICATION OF DIMENSIONS SHOULD BE OBTAINED FROM DIMENSIONED PLANS.

ALL DIMENSIONS UNLESS OTHERWISE SPECIFIED SHALL BE IN FEET AND INCHES. FRACTIONS SHALL BE IN 16THS OF AN INCH.

ALL DIMENSIONS UNLESS OTHERWISE SPECIFIED SHALL BE IN FEET AND INCHES. FRACTIONS SHALL BE IN 16THS OF AN INCH.

MAUIST ARCHITECTURAL SERVICES
DIVISION OF L.E.M., INC.
112 NORTH MAIN STREET
GOSHEN, INDIANA 46526
PHONE: (574) 537-4500
FAX: (574) 537-0808

* Architects
* Plumbers
* Electricians
* Construction Mgmt.
* Rule 5 and MS4 Filing

These drawings are the property of Maui Architectural Services and may not be reprinted, copied, altered or used in any manner without the written consent of Maui Architectural Services.

HOME 2
SUITES BY HILTON

SHEET SIZE 24x36

FT. WAYNE, INDIANA

REVISIONS:

PRELIMINARY - NOT FOR CONSTRUCTION

DATE: 05/01/26
JOB NO.: MAS-26-105
NAME: ELECTRICAL RISER DIAGRAMS
SHEET: E002