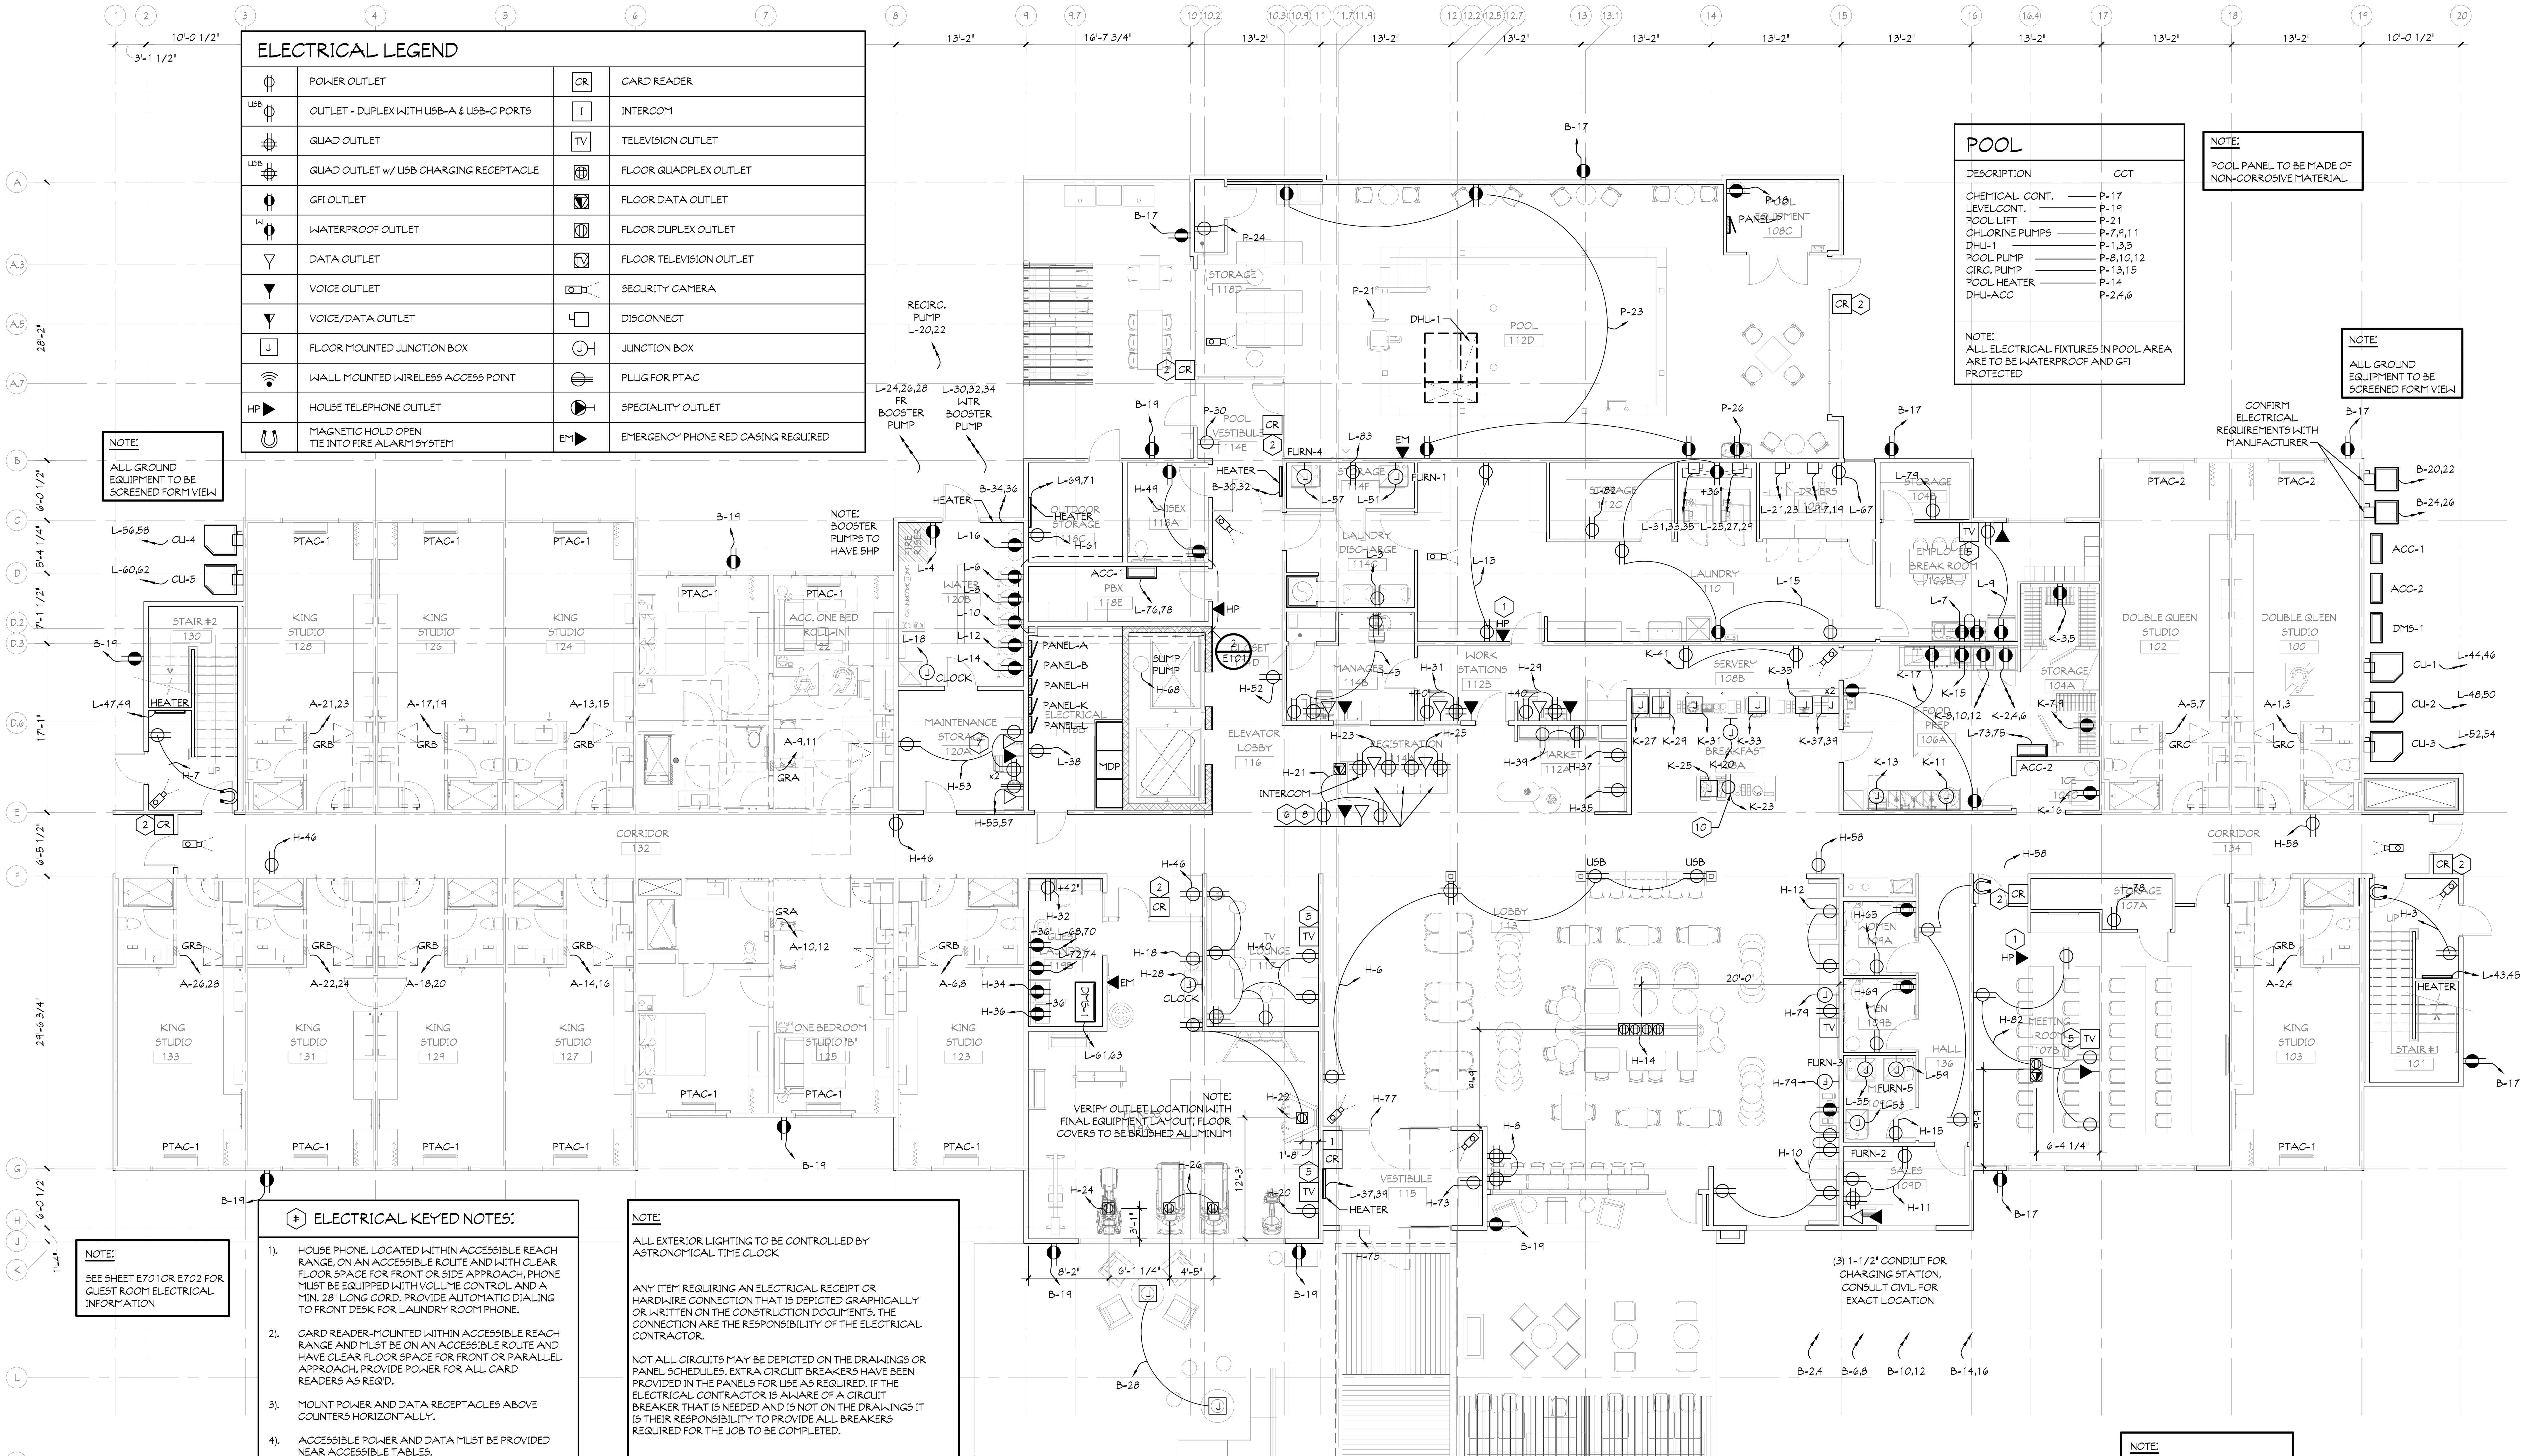

1 FIRST FLOOR POWER PLAN
SCALE: 1/8" = 1'-0"

ELECTRICAL LEGEND

Symbol	Description	Symbol	Description
	POWER OUTLET	CR	CARD READER
USB	OUTLET - DUPLEX WITH USB-A & USB-C PORTS	I	INTERCOM
	QUAD OUTLET	TV	TELEVISION OUTLET
USB	QUAD OUTLET w/ USB CHARGING RECEPTACLE		FLOOR QUADPLEX OUTLET
	GFI OUTLET		FLOOR DATA OUTLET
W	WATERPROOF OUTLET		FLOOR DUPLEX OUTLET
	DATA OUTLET	TV	FLOOR TELEVISION OUTLET
	VOICE OUTLET		SECURITY CAMERA
	VOICE/DATA OUTLET		DISCONNECT
J	FLOOR MOUNTED JUNCTION BOX	J	JUNCTION BOX
	WALL MOUNTED WIRELESS ACCESS POINT		PLUG FOR PTAC
HP	HOUSE TELEPHONE OUTLET		SPECIALITY OUTLET
	MAGNETIC HOLD OPEN TIE INTO FIRE ALARM SYSTEM	EM	EMERGENCY PHONE RED CASING REQUIRED

POOL

DESCRIPTION	CCT
CHEMICAL CONT.	P-17
LEVELCONT.	P-19
POOL LIFT	P-21
CHLORINE PUMPS	P-7,9,11
DHU-1	P-1,3,5
POOL PUMP	P-8,10,12
CIRC. PUMP	P-13,15
POOL HEATER	P-14
DHU-ACC	P-2,4,6

NOTE:
ALL ELECTRICAL FIXTURES IN POOL AREA ARE TO BE WATERPROOF AND GFI PROTECTED

NOTE:
POOL PANEL TO BE MADE OF NON-CORROSIVE MATERIAL

NOTE:
ALL GROUND EQUIPMENT TO BE SCREENED FORM VIEW

NOTE:
ALL GROUND EQUIPMENT TO BE SCREENED FORM VIEW

NOTE:
SEE SHEET E701 OR E702 FOR GUEST ROOM ELECTRICAL INFORMATION

ELECTRICAL KEYED NOTES:

1). HOUSE PHONE. LOCATED WITHIN ACCESSIBLE REACH RANGE, ON AN ACCESSIBLE ROUTE AND WITH CLEAR FLOOR SPACE FOR FRONT OR SIDE APPROACH, PHONE MUST BE EQUIPPED WITH VOLUME CONTROL AND A MIN. 28" LONG CORD. PROVIDE AUTOMATIC DIALING TO FRONT DESK FOR LAUNDRY ROOM PHONE.

2). CARD READER-MOUNTED WITHIN ACCESSIBLE REACH RANGE AND MUST BE ON AN ACCESSIBLE ROUTE AND HAVE CLEAR FLOOR SPACE FOR FRONT OR PARALLEL APPROACH. PROVIDE POWER FOR ALL CARD READERS AS REQ'D.

3). MOUNT POWER AND DATA RECEPTACLES ABOVE COUNTERS HORIZONTALLY.

4). ACCESSIBLE POWER AND DATA MUST BE PROVIDED NEAR ACCESSIBLE TABLES.

5). PROVIDE POWER, TV FEED & BLOCKING FOR WALL OR CEILING MOUNTED TV STANDARDS. ALL TV LOCATIONS TO HAVE CAT6 AND COAXIAL CABLE

6). REFER TO ENLARGED PLAN FOR MILLWORK POWER REQUIREMENTS.

7). PROVIDE PMS CONNECTION AND (2) MATV OUTLETS PLUS OUTLET SIZED FOR PTAC MAINTENANCE.

8.) OUTLET TO BE HORIZONTALLY-ORIENTED

9.) PROVIDE STUB-UPS THROUGH FLOOR BELOW MILLWORK. DEVICES TO BE MOUNTED WITHIN MILLWORK CAVITY. COORDINATE THE LOCATION OF ELECTRICAL BOXES INSIDE MARKET COOLER AND FREEZER RECESSES WITH DEPTH OF EQUIPMENT TO BE CONTAINED.

10. PROVIDE DUAL SIDED POP-UP COUNTER OUTLET THAT IS SURFACE MOUNTED TO THE COUNTERTOP - NICKEL FINISH.

NOTE:

ALL EXTERIOR LIGHTING TO BE CONTROLLED BY ASTRONOMICAL TIME CLOCK

ANY ITEM REQUIRING AN ELECTRICAL RECEIPT OR HARDWIRE CONNECTION THAT IS DEPICTED GRAPHICALLY OR WRITTEN ON THE CONSTRUCTION DOCUMENTS. THE CONNECTION ARE THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR.

NOT ALL CIRCUITS MAY BE DEPICTED ON THE DRAWINGS OR PANEL SCHEDULES. EXTRA CIRCUIT BREAKERS HAVE BEEN PROVIDED IN THE PANELS FOR USE AS REQUIRED. IF THE ELECTRICAL CONTRACTOR IS AWARE OF A CIRCUIT BREAKER THAT IS NEEDED AND IS NOT ON THE DRAWINGS IT IS THEIR RESPONSIBILITY TO PROVIDE ALL BREAKERS REQUIRED FOR THE JOB TO BE COMPLETED.

NOTE:
ALL SECURITY CAMERAS SHOULD HAVE A CAT6E WIRING

GENERAL NOTES:

ALL TRADES NEED TO FIRE CAULK THEIR OWN PENETRATIONS PER CODE.

ANY DAMAGE TO FINISHED DRYWALL OR FINISHED SURFACE WILL BE THE RESPONSIBILITY OF THE SUB CONTRACTOR

ALL SUBCONTRACTORS ARE RESPONSIBLE TO CLEAN UP ALL DEBRIS AND MATERIALS AT THE END OF EACH DAY

NOTE:

FIRE ALARM TO BE PER BRAND STANDARDS CONTRACTOR TO BE AWARE OF BRAND STANDARDS.

FIRE ALARM SYSTEM TO BE ADDRESSABLE

EXTERIOR

DESCRIPTION	CCT
SITE LIGHTING	B-1,3,5,7,9,11
MONUMENT SIGN	B-13,15
EXTERIOR RECEPTACLES	B-17,19
(EE) FLAG POLE	B-21
DUMPSTER	B-23,25
DIRECTIONAL SIGN	B-41

NOTE:
CONTRACTOR TO VERIFY EXACT ELECTRICAL REQUIREMENTS FOR THIS AREA

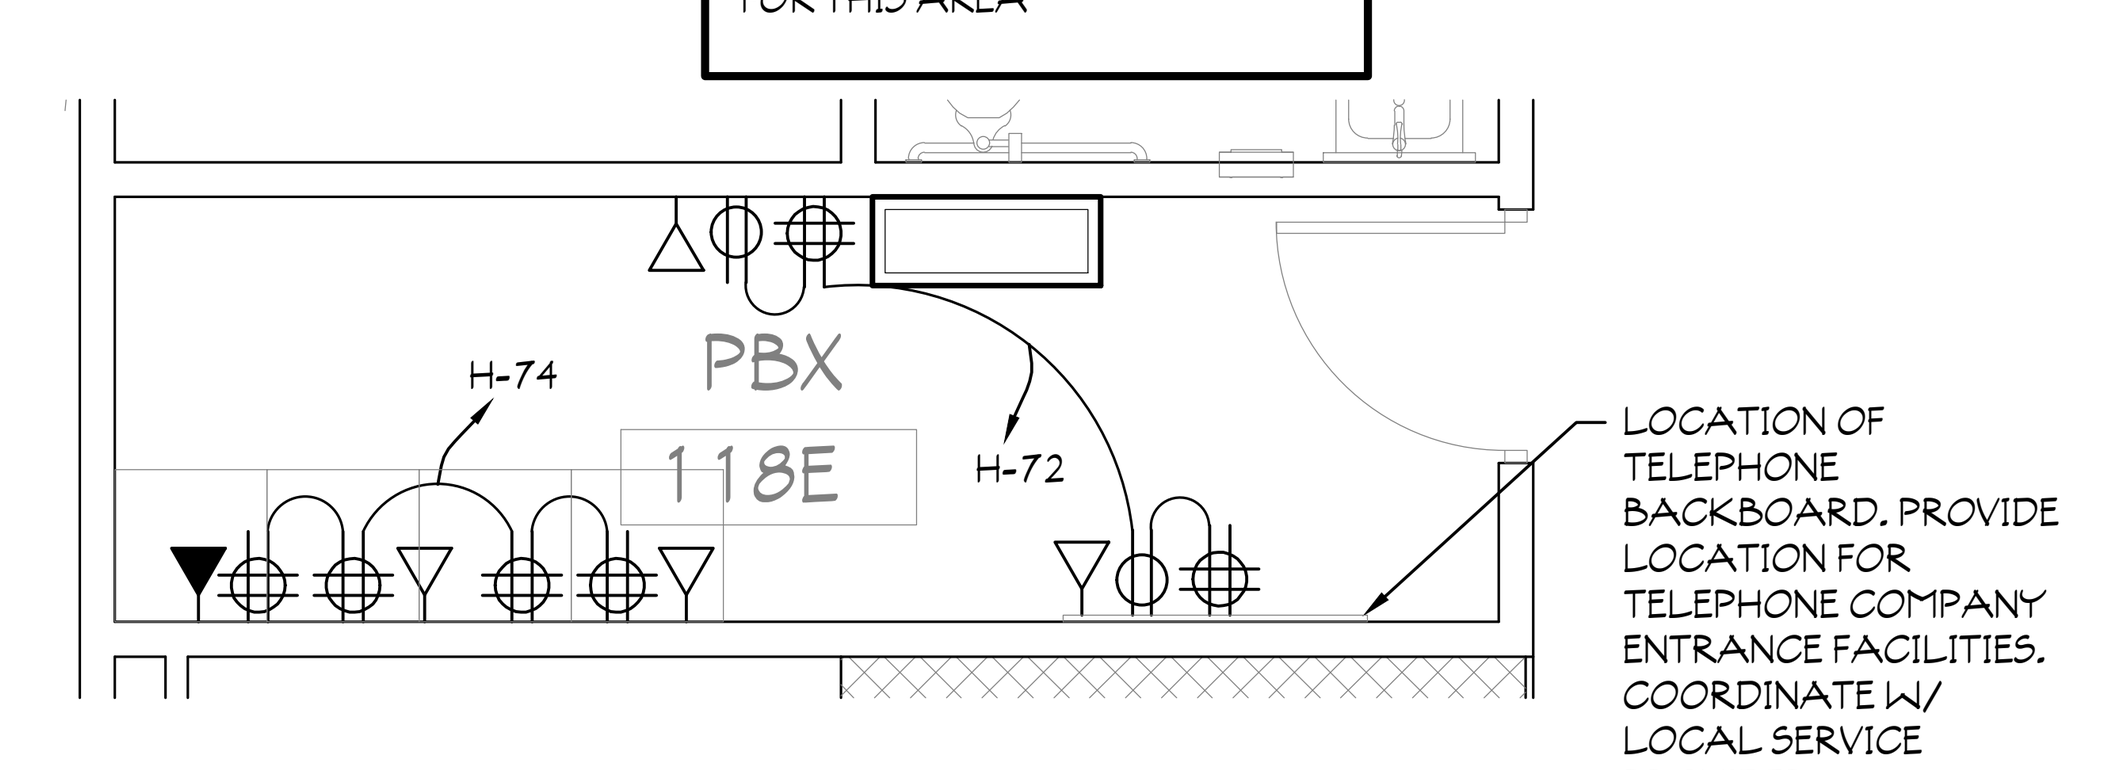

LOCATION OF TELEPHONE BACKBOARD, PROVIDE LOCATION FOR TELEPHONE COMPANY ENTRANCE FACILITIES. COORDINATE W/ LOCAL SERVICE PROVIDER.

2 ENLARGED PBX ROOM PLAN
SCALE: 1/4" = 1'-0"

GENERAL NOTES

-ALTHOUGH DRAWINGS ARE DRAWN TO SCALE, THE ACCURACY OF THE DRAWING CANNOT BE GUARANTEED DUE TO DISCREPANCIES IN THE METHODS OF REPRODUCTION. DIMENSIONS SHOULD BE DERIVED FROM DIMENSIONED PLANS.

-ALL DIMENSIONS, ROUGH OPENING SIZES, AND ELEVATION MARKERS MUST BE FIELD VERIFIED BY THE GENERAL CONTRACTOR. MAUST ARCHITECTURAL SERVICES SHALL NOT BE HELD RESPONSIBLE FOR ANY DIMENSIONAL DISCREPANCIES WHICH HAVE NOT BEEN BROUGHT TO THEIR ATTENTION PRIOR TO CONSTRUCTION.

MAUST ARCHITECTURAL SERVICES
DIVISION OF L.E.M., INC.
112 NORTH MAIN STREET
GOSHEN, INDIANA 46526
* Architects
* Planners
* Consultants
* Construction Mgmt.
* Rule 5 and MS4 Filing
PHONE (574) 537-8500
FAX (574) 537-0808

These drawings are the property of Maust Architectural Services and may not be reprinted, copied or reused in any manner without the expressed written consent of Maust Architectural Services.

HOME2 SUITES BY HILTON

SHEET SIZE 24x36

FT. WAYNE, INDIANA

REVISIONS :

PRELIMINARY - NOT FOR CONSTRUCTION

DATE: 05/01/26

JOB NO.: MAS-26-105

NAME: FIRST FLOOR POWER PLAN

SHEET: E101