

LIGHTING AND CEILING LEGEND:	
	(R11) RECESSED DOWNLIGHT
	(R20) RECESSED DOWNLIGHT W/ SHATTER PROOF LENS -UL WET LABELED
	DECORATIVE WALL SCONCE
	BATHROOM EXHAUST

NOTE:
-AIRC FAULT BREAKERS ARE TO BE USED PER CODE
-SMALL APPLIANCE BRANCH CIRCUITS REQUIRED BY CODE
-SEE E80X SERIES FOR ELECTRICAL PANEL CIRCUITS FOR THE GUEST ROOMS

ELECTRICAL LEGEND

	POWER OUTLET
	QUAD OUTLET
	QUAD OUTLET w/ USB CHARGING RECEPTACLE
	GFI OUTLET
	DATA OUTLET
	VOICE OUTLET
	TV OUTLET w/ CAT6 SEE NOTE 1 BELOW
	LIGHT SWITCH
	3-WAY LIGHT SWITCH
	MASTER LIGHT SWITCH
	OCCUPANCY SENSOR
	JUNCTION BOX
	WALL MOUNTED WIRED THERMOSTAT
	WALL MOUNTED WIRELESS ACCESS POINT
	DOORBELL: HARDWIRED TO DOORBELL LIGHT - MOUNT @ 46" AFF TO CENTER OF BUTTON (FOR C.F. ROOMS ONLY)

- NOTE:
- AT EVERY GUESTROOM TV, PROVIDE THE FOLLOWING: ONE DUPLEX ELECTRICAL RECEPTACLE (POWER FOR THE TV AND EDGE CONTROLLER), ONE CAT6 OUTLET (HOMERUN TO IDF ROOM), AND ONE COAXIAL OUTLET (ALL AT 42" AFF) THESE SHOULD ALL BE IN (3) SEPARATE BOXES, WHEN POSSIBLE, TO MITIGATE ANY NEED FOR SPACERS, SHOULD THE WAP OR EDGE CONTROLLER EVER BE WALL MOUNTED
 - THAT A HARDWIRED, ELECTRONIC DIGITAL THERMOSTAT SPECIFICALLY DESIGNED FOR GUESTROOM APPLICATIONS MUST BE PROVIDED. BATTERY POWERED THERMOSTATS ARE NOT ACCEPTABLE. FOR FURTHER GUIDANCE, AND APPROVED DEVICES, REFER TO THE BRAND STANDARDS DOCUMENTS (2510.07.C.1), AS WELL AS THE CONNECTED ROOM PAGE.
 - IMPORTANT NOTE REGARDING (CAT 6) DATA REQUIREMENTS: PROVIDE A CAT 6 HOMERUN AT TH WORKING WALLS BELOW THE DESK (3-GANG BOX, MOUNTED VERTICALLY).
 - ALL LIGHT SWITCHES REQUIRE A NEUTRAL WIRE, FOR FUTURE ADAPTABILITY.

KEY NOTES:	
1	PTAC UNIT
3	IN BATHROOM LOCATIONS ONLY, LIGHT SWITCH EQUIPPED WITH NIGHTLIGHT, MOUNTED 50 TOP OF SWITCH IS 48" MAX A.F.F.
4	MANUAL BLACK OUT ROLLER SHADE TO EXTEND 6" BEYOND WINDOW OPENING; SHEER ROLLER SHADE TO BE MOUNTED INSIDE WINDOW OPENING
5	SHOWER ENCLOSURE WITH TEMPERED GLASS DOOR
6	FLOOR DRAIN
7	PRE-MANUFACTURED SHOWER PAN
8	CEILING MOUNTED DRAPERY ROD - PROVIDE BLOCKING AS REQUIRED
9	ALTERNATE LOCATION OF DOOR FOR CONNECTING ROOMS TO ACCESSIBLE ROOMS - REFER TO OVERALL PLANS FOR LOCATION OF ACCESSIBLE ROOMS
10	DEDICATED CIRCUIT FOR DISHWASHER
11	RANGE TOP STYLE MICROWAVE AFFIXED TO WALL
12	MIRROR
13	BEGIN CARPET TILE THIS SIDE WITH FULL TILE - FIRST TWO ROWS OF TILE TO BE INSTALLED AROUND BUILT-IN CASEGOODS
14	SWITCH CONTROLLING GARBAGE DISPOSAL GANGED WITH DUPLEX REFER TO HADG FOR ACCESSIBLE ROOM REQUIREMENTS.
15	DEDICATED CIRCUIT FOR GARBAGE DISPOSAL
16	FIRE HORN IN STANDARD ROOMS. FIRE HORN/STROBE IN COMMUNICATION FEATURES ROOMS
17	LAYOUT AND CONSTRUCTION IS TO START AT REFRIGERATOR HOLD DIM. & PROCEED UP THE WALL FROM THAT END-FINAL INSTALLATION IS ROD AT CLOSET, TO BE SCRIBED AT WALL AS REQUIRED. END OF KITCHEN MUST TERMINATE AT OUTSIDE FACE OF BATHROOM WALL.
18	RECESSED CEILING LIGHT FOR WET LOCATIONS WITH SHATTER PROOF LENS
19	TOILET EXHAUST GRILLE
20	MAKE-UP AIR DIFFUSER
21	EXTENT OF SLEEPER SOFA
22	APPROXIMATE LOCATIONS OF MILLWORK SUPPORTS ON FLOOR. PROVIDE SHIMS OR LEVELERS UNDER SUPPORTS TO PREVENT CARPET CRUSHING
23	ROOM SIGNAGE
24	HARD WIRED THERMOSTAT FOR PTAC, MOUNTED 48" MAX TO TOP OF DEVICE. COMMUNICATION BETWEEN THERMOSTAT AND PTAC MAY BE WIRELESS.
25	EXTEND J-BOX, DEVICE AND COVER PLATE FLUSH WITH MILLWORK BACK PANEL
26	DROPPED GYPSUM BOARD BULKHEAD @ ROUGH OPENING - WHERE PRE-MANUFACTURED SHOWER INSERT IS INDICATED MEASURE ROUGH OPENING FROM FACE OF GYPSUM BOARD
28	DOORBELL ON/OFF SWITCH (COMMUNICATION FEATURES ROOMS ONLY) SIGNAGE AS REQ'D.
30	EDGE OF PTAC ABOVE CARPET TILES
31	MIN. CEILING HEIGHT MUST BE MAINTAINED - REFER TO HOME 2 SUITES BY HILTON STANDARDS MANUAL
32	FRAMING SUBCONTRACTOR TO PROVIDE 3/4" F.T. PLYWOOD BLOCKING TO RECEIVE ITEM INDICATED - EXTEND FULL LENGTH OF OBJECT
33	GENERAL CONTRACTOR TO COORDINATE WITH FIXTURE FABRICATOR WHERE NECESSARY TO PROVIDE PROPER HANGING IN WALL FOR ITEM KEYNOTED
34	BI-PASS SLIDING GLASS DOOR, BRUSHED ALUMINUM FINISH, CLEAR GLASS, WITH 24" BAR PULL HARDWARE
35	SWITCHES CONTROLLING MECHANICAL SHADES - REFER TO FFE MANUAL
36	OUTLET ABOVE FOR MICROWAVE - REFER TO ROOM ELEVATION MOUNT DEVICE HORIZONTALLY - FACE PLATE TO BE WHITE
37	REQUIRED ACCESSIBLE CLEAR FLOOR AREA DESIGNATION
39	CENTER ARTWORK OVER SOFA
40	COUNTERTOP MICROWAVE
41	GRAPHIC ART REFER TO ACCESSORIES LEGEND AND CONSTRUCTION PLAN
42	ACCESSIBLE VANITY; CLEAR AREA OF SINK/VANITY MUST BE ACCESSIBLE
43	ADDITIONAL HORN STROBE: LOCATED IN C.F. BATHROOMS ONLY
44	WAP IN 3-GANG BOX MOUNTED VERTICALLY UNDER DESK, MAINTAIN 6" BETWEEN ALL BOXES, TYP ALL GUESTROOMS. COORDINATE WALL LOCATION WITH CASEGOODS TO AVOID CONFLICTS. VISIT CONNECTED ROOM/HILTON.COM FOR CURRENT WIRELESS INTERNET REQ'S AND LIST OF APPROVED INTEGRATORS.
45	EACH CABLE MUST HOMERUN BETWEEN THE GUESTROOM AND THE IDF ON EACH FLOOR. VISIT CONNECTEDROOM/HILTON.COM FOR CURRENT REQUIREMENTS AND OPTIONS.
46	OPTION WIRELESS DATA CONNECTION FOR GUEST USE: A) ADD CAT6 RJ-45 CABLE JACK AND PATCH CORD THROUGH DESKTOP GROMMET - OR - B) PATCH CORD FROM WAP PORT THROUGH DESKTOP GROMMET, IF OUTLET IS LOCATED ABOVE THE DESK, REMOVE GROMMET AND PATCH CORD.
47	TV CONNECTIONS FOR FREE-TO-GUEST CONTENT: A) NO SMART TV: COAX CABLE BEHIND TV. CAT6 RJ-45 JACK BEHIND TV, RUN IN SHURF TUBE IN WALL TO WAP UNDER DESK. PATCH CORD TO EDGE CONTROLLER FOR CONNECTED ROOM. MIN. 6" CLEARANCE FROM WALL BOXES - OR - B) SMART TV: INTERNET PROTOCOL TELEVISION COAX NOT REQ'D. CAT6 RJ-45 JACK BEHIND TV RUN IN SHURF TUBE IN WALL TO WAP UNDER DESK. PATCH CORD TO EDGE CONTROLLER FOR CONNECTED ROOM. CAT6 RJ-45 JACK BEHIND TV IN ONE-BEDROOM TV, MIN. 6" CLEARANCE FROM WALL BOXES. VISIT HILTONHDTV.COM FOR ADDITIONAL INFORMATION.
48	PROVIDE HINGE STOP AT DOOR
49	HARDWIRED BLACK OUT ROLLER SHADE WITH NO EXPOSED WIRES
50	PROVIDE OUTLET FOR UNDER CABINET LIGHTING BY OTHERS, COORDINATE WITH ELECTRICAL AT ACC. GUESTROOMS; THE COOK LIGHT AT MOUNTED MICROWAVE FOR NON-ACC ROOMS WILL SUFFICE
51	ROLLER SHADE TO EXTEND PAST WINDOW FRAME TO REDUCE LIGHT LEAKAGE - REFER TO SPECIFICATION AND MANUFACTURER'S INSTALLATION REQUIREMENTS
52	DEDICATED CIRCUIT FOR INDUCTION BURNER

GENERAL NOTES

ALTHOUGH DRAWINGS ARE DRAWN TO SCALE, THE ACCURACY OF THE DRAWINGS CANNOT BE GUARANTEED. DIMENSIONS SHOWN ON DRAWINGS OF REPRODUCTION, DIMENSIONS SHOULD BE DERIVED FROM DIMENSIONED PLANS.
ALL DIMENSIONS UNLESS OTHERWISE NOTED.
SERVICES SHALL NOT BE HELD RESPONSIBLE FOR ANY CONSTRUCTION. GENERAL CONTRACTOR MUST BRING TO THE ATTENTION PRIOR TO CONSTRUCTION.

* Architects
* Plumbers
* Electricians
* Construction Mgmt.
* Rule 5 and MS4 Filing
L.E.M., INC.
PHONE: (574) 537-8500
FAX: (574) 537-0808
112 NORTH MAIN STREET
GOSHEN, INDIANA 46526

These drawings are the property of Maust Architectural Services and may not be reprinted, copied, or used in any manner without the express written consent of Maust Architectural Services.

HOME 2
SUITES BY HILTON


SHEET SIZE 24x36

FT. WAYNE, INDIANA


REVISIONS:

DATE: 05/01/26
JOB NO.: MAS-26-105
NAME: GUESTROOM ELECTRICAL PLANS
SHEET:

E702

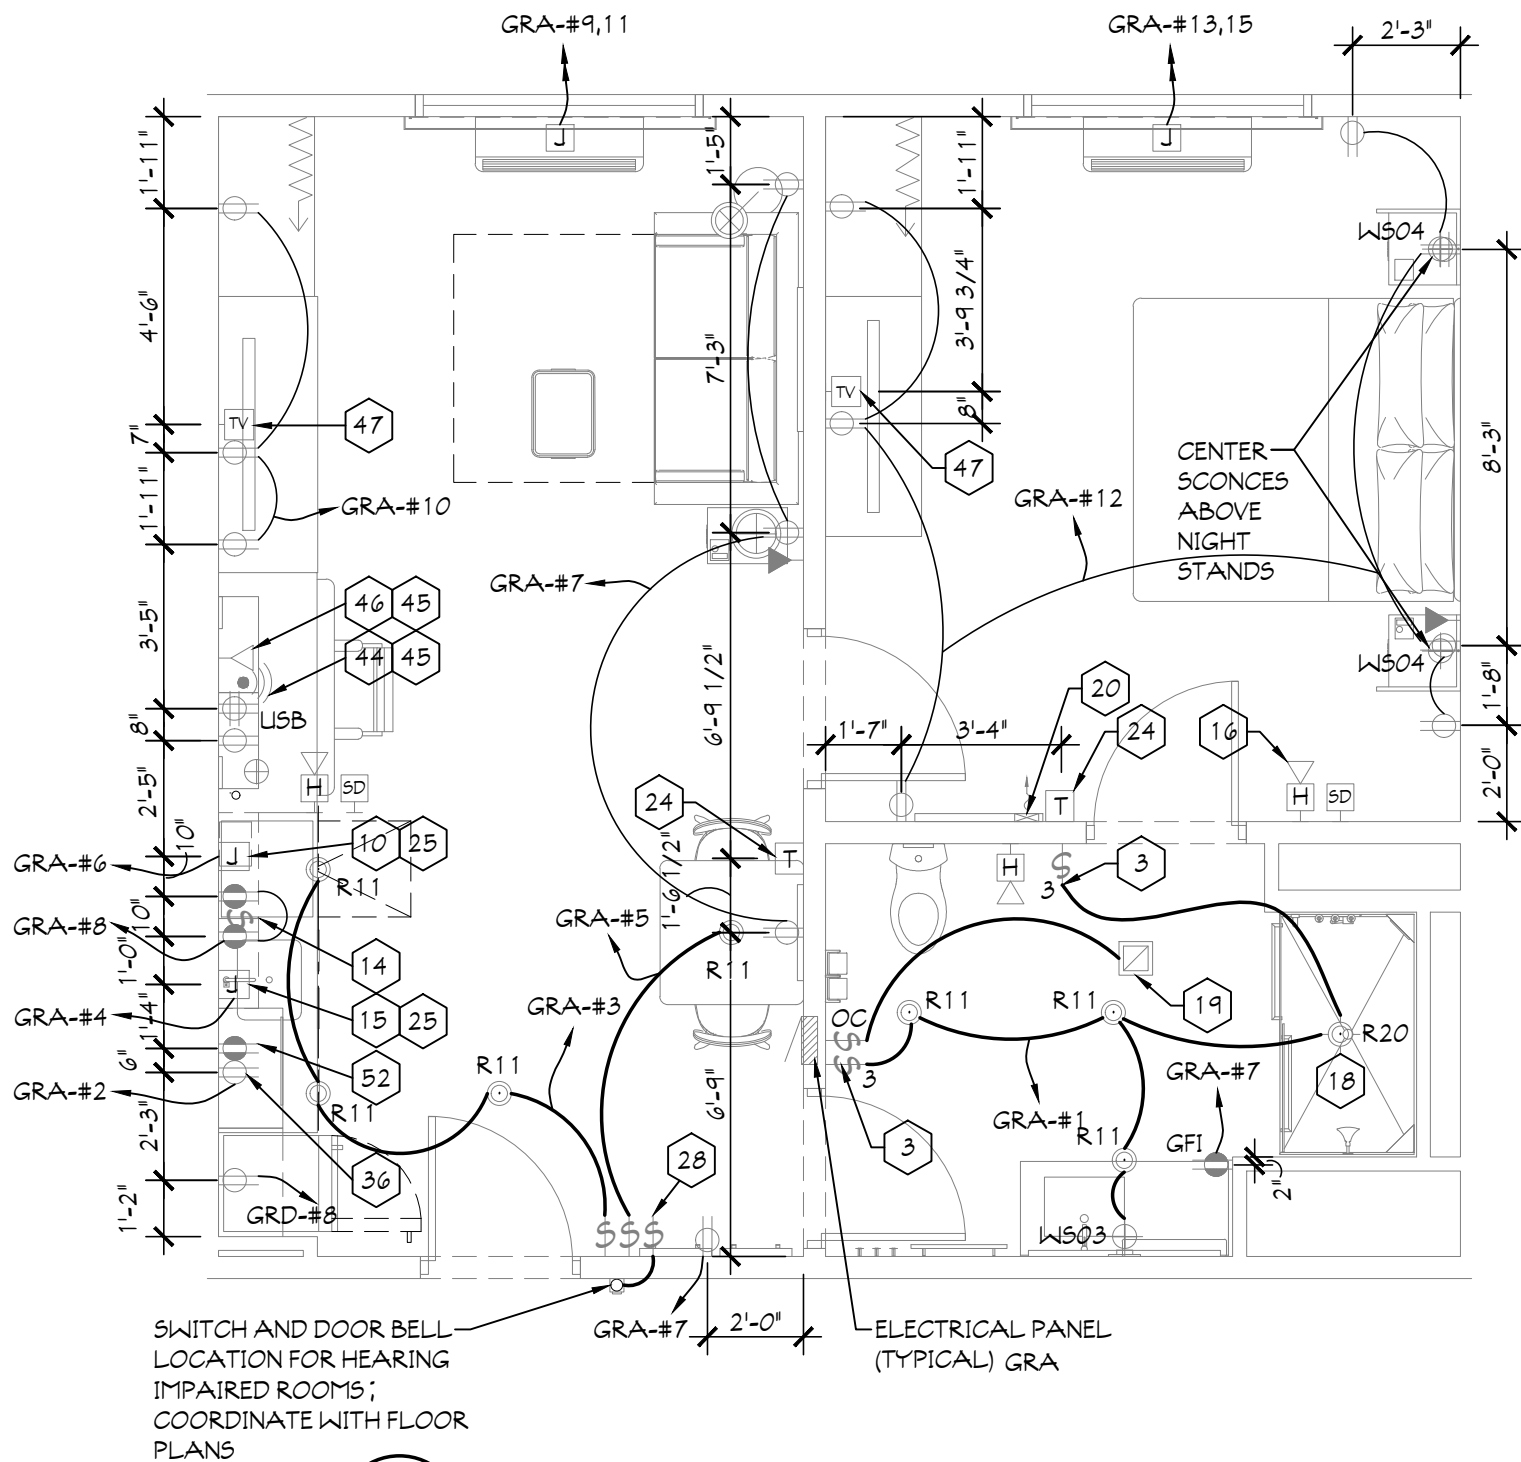

NOTE:
AT AUTOMATIC SHADES IN ACCESSIBLE/ADA GUESTROOMS, PROVIDE DEDICATED AND CONCEALED POWER, BATTERY-OPERATED UNITS AND EXPOSED RECEPTACLES/ CORDS ARE NOT APPROVED

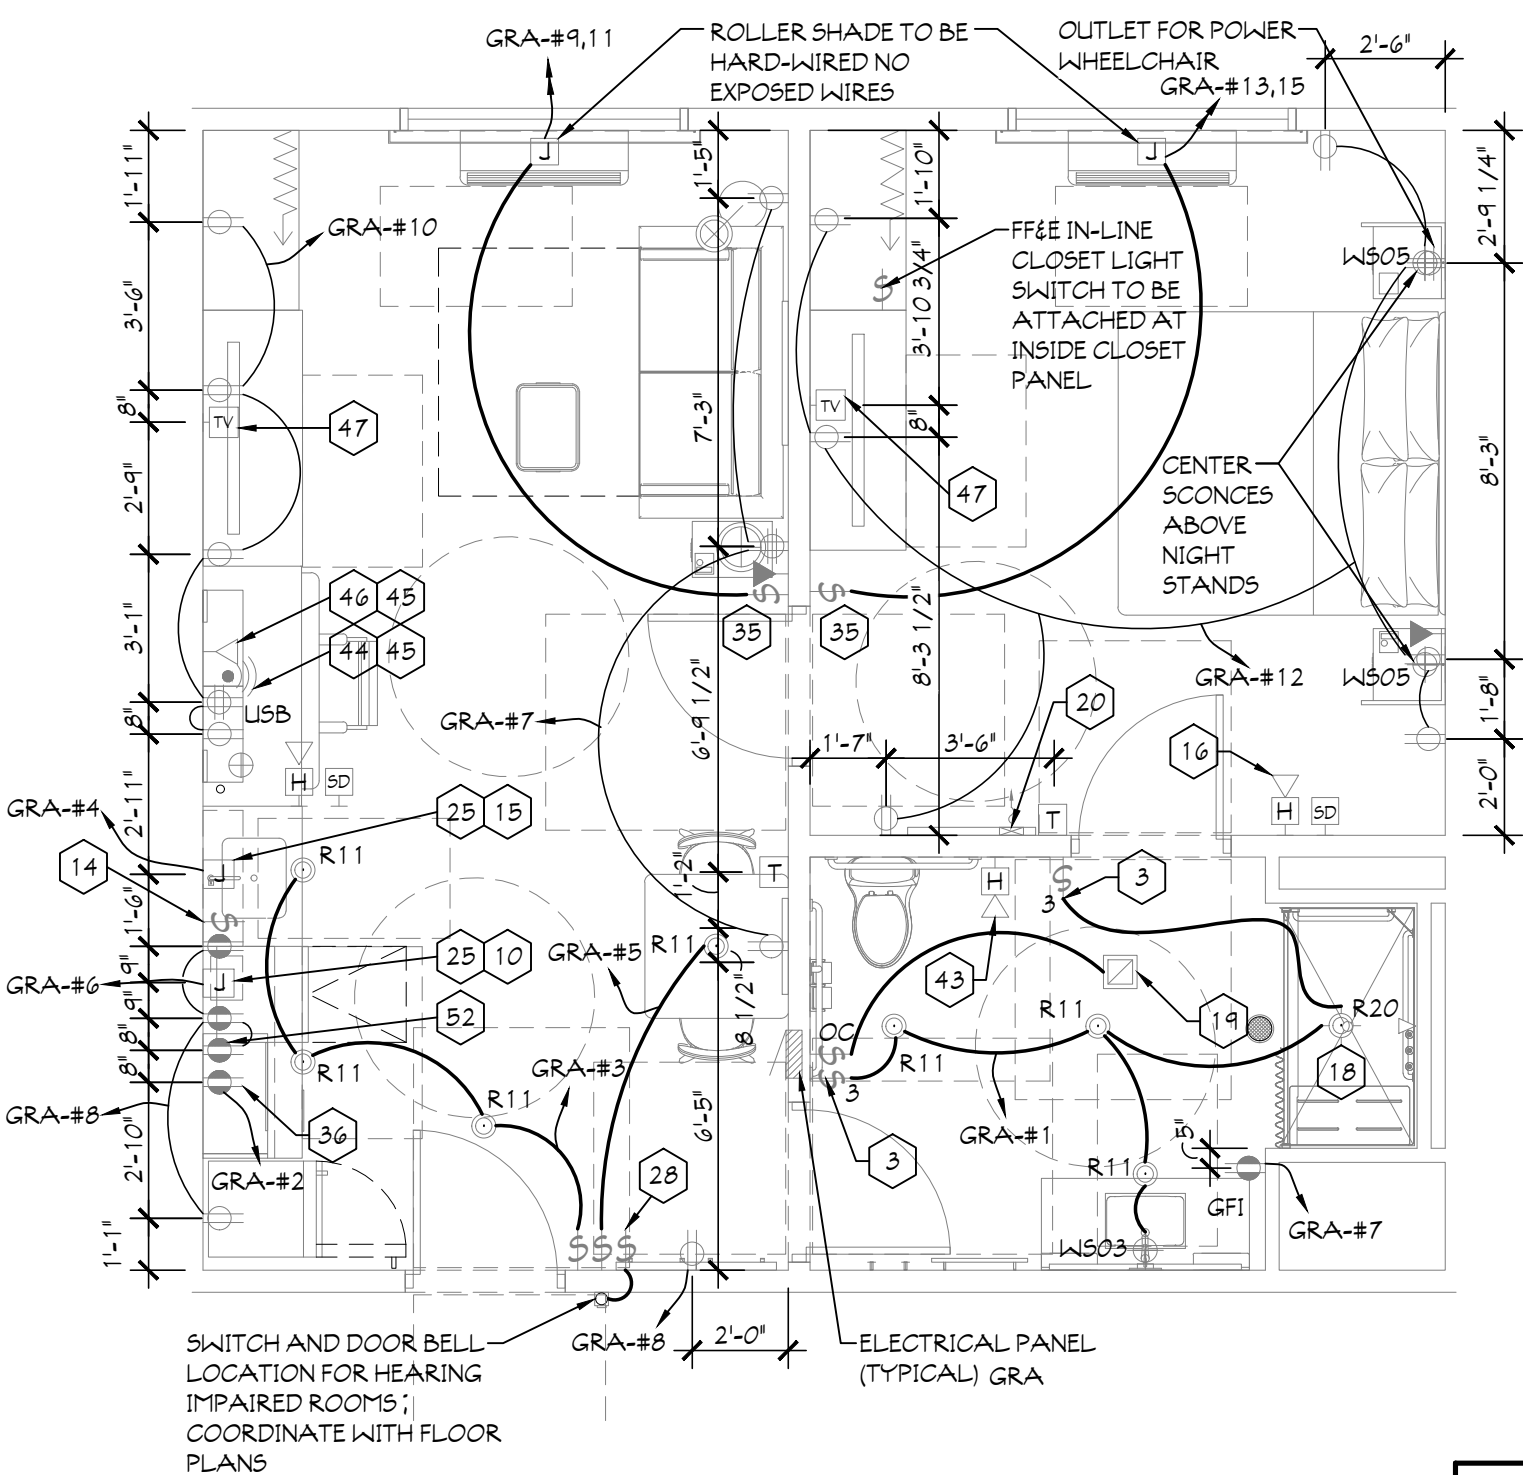

NOTE:
PROVIDE UNDER-CABINET LIGHTING @ ACCESSIBLE ROOMS

