





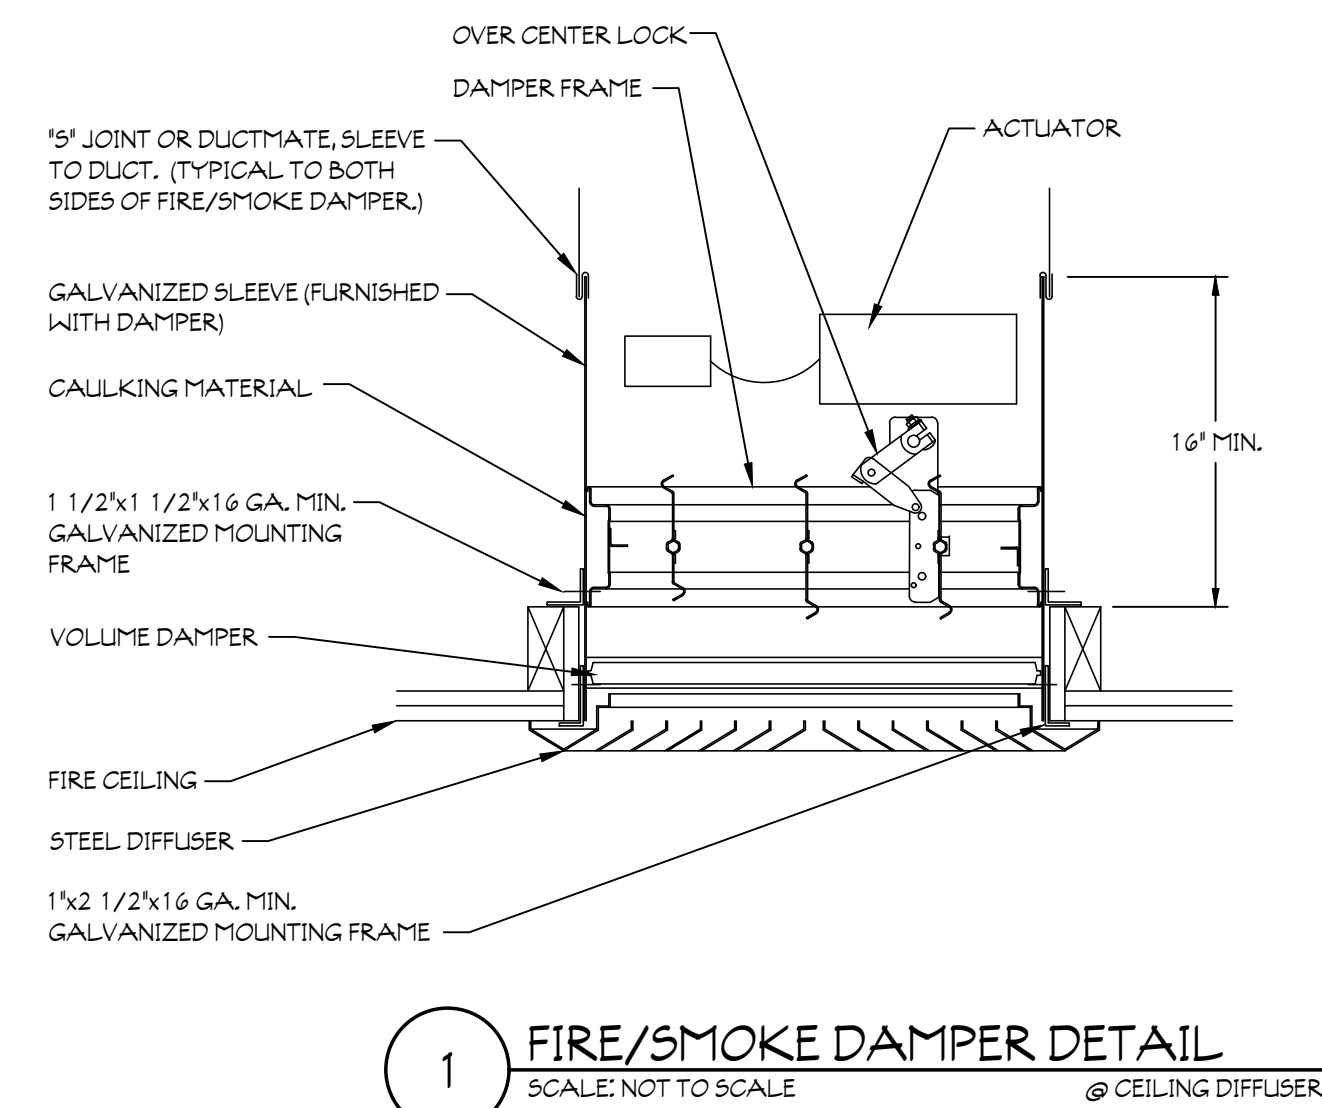


- NOTE:

1. FIRE/SMOKE DAMPER INSTALLATION SHALL MEET U.L. REQUIREMENTS
2. FIRE/SMOKE DAMPER BASED ON RUSKIN MODEL F5D60FA FRONT ACCESS OR APPROVED EQUAL
3. FURNISH COMPLETE WITH 120 VOLT DAMPER ACTUATOR
FURNISHED COMPLETE WITH SMOKE DAMPER FOR A U.L. RATED SMOKE DAMPER.

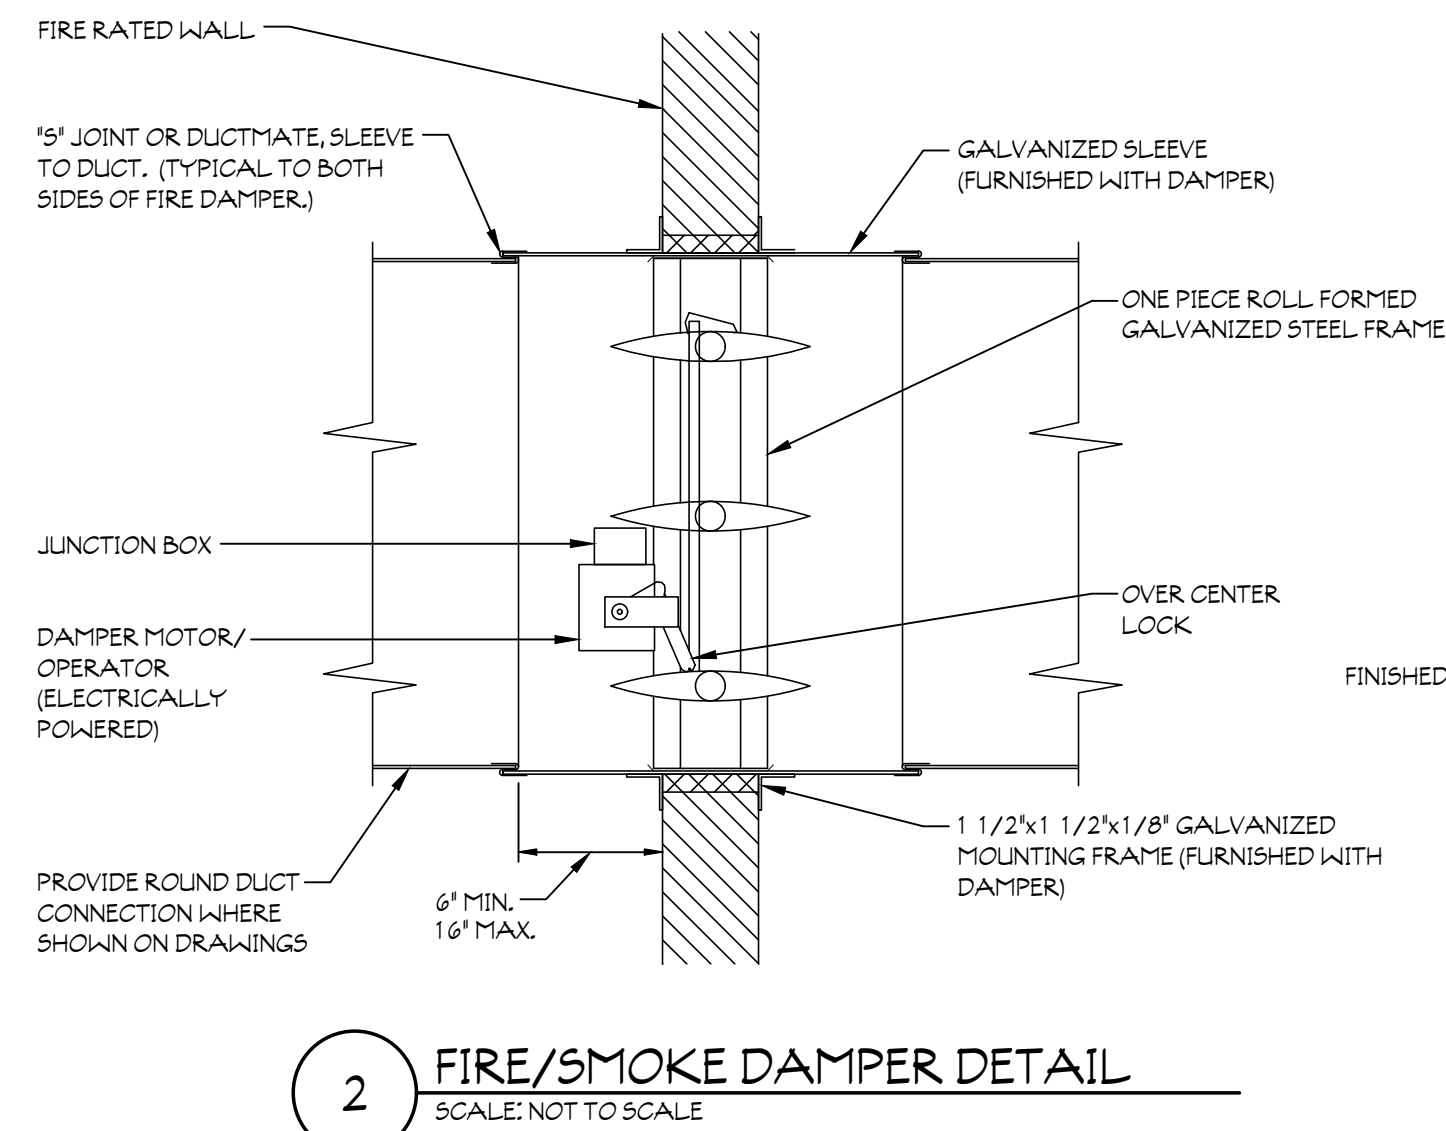


4. SMOKE DAMPER SHALL BE ACTIVATED FROM SMOKE DETECTOR TO CLOSE UPON SMOKE DETECTION.
5. PROVIDE FAIL SAFE DESIGN WHICH WILL ENABLE THE DAMPER TO AUTOMATICALLY CLOSE DUE TO LOSS OF POWER.

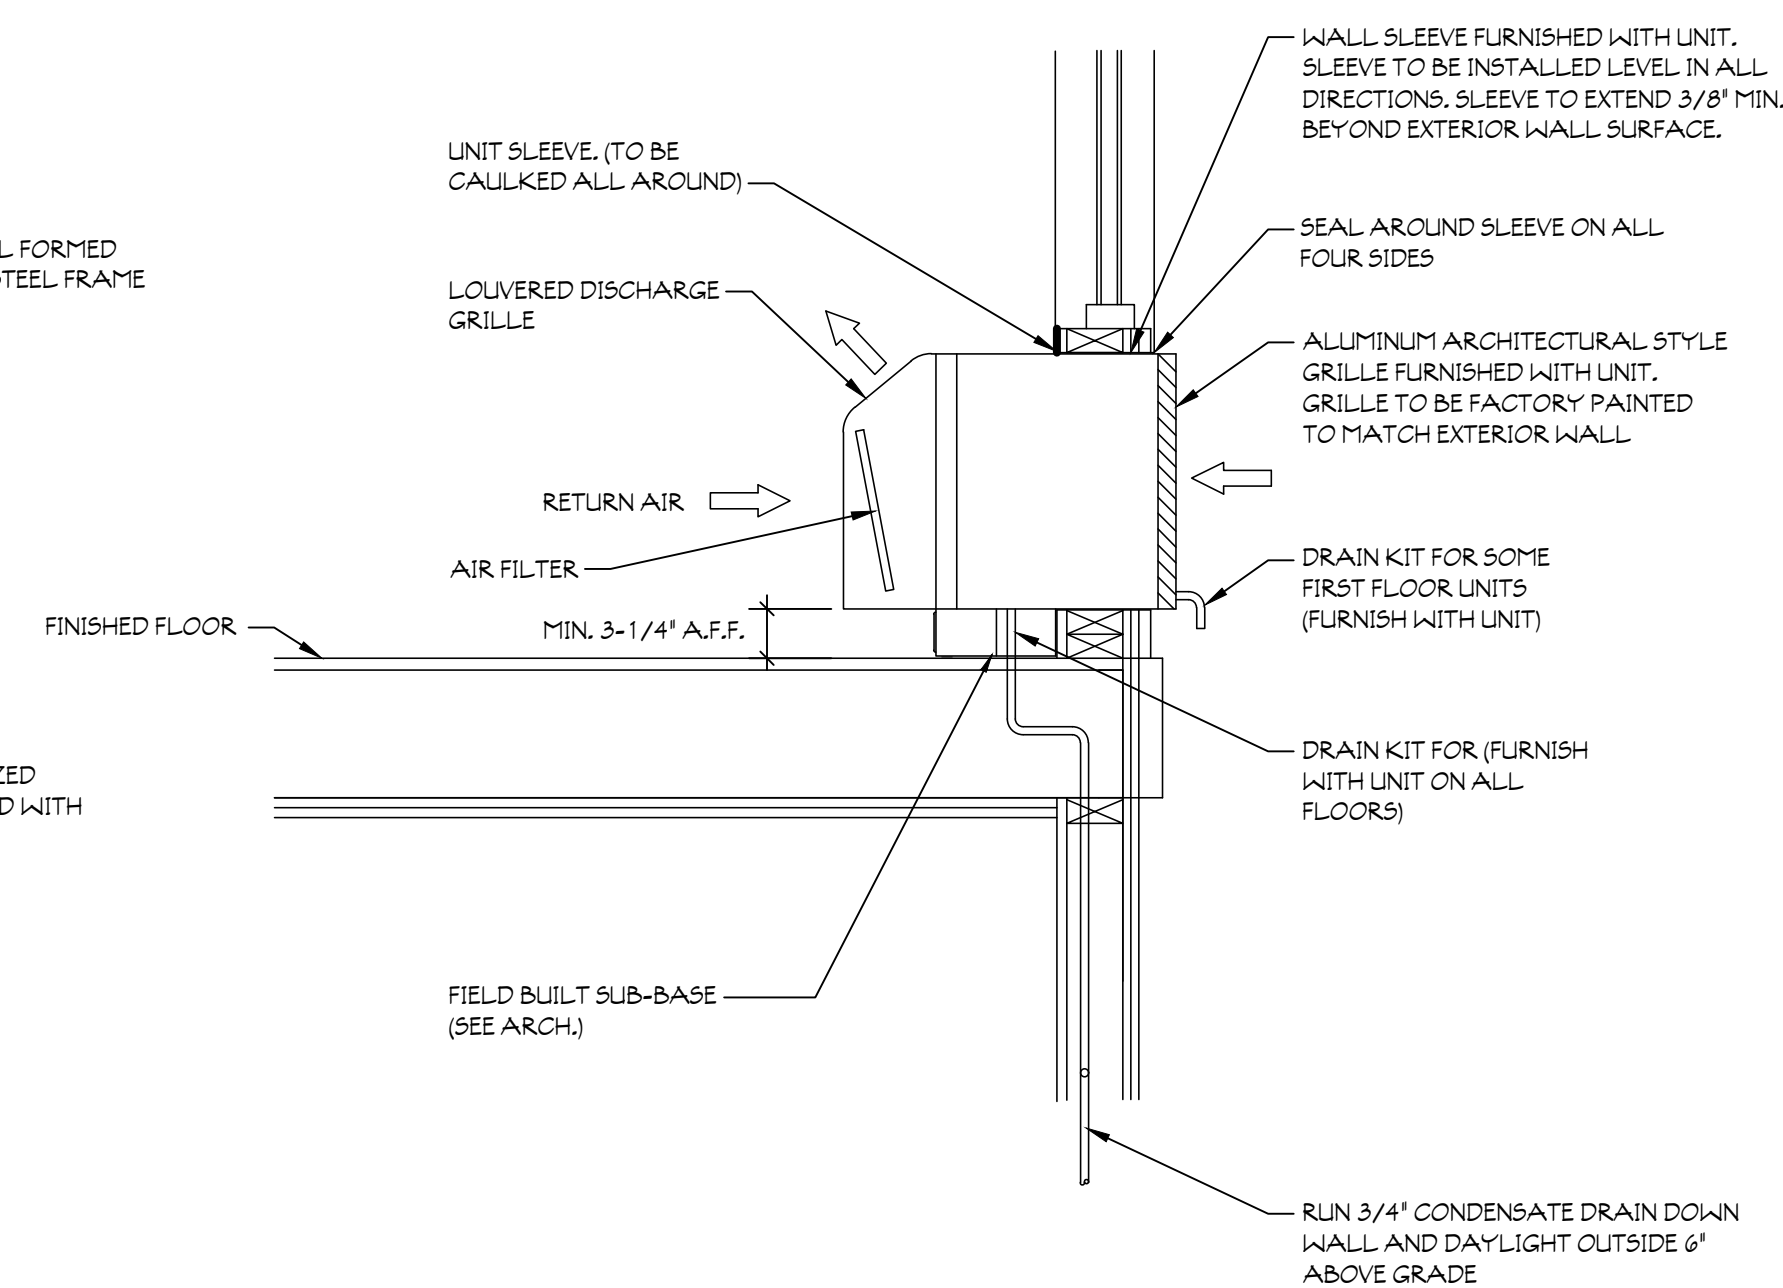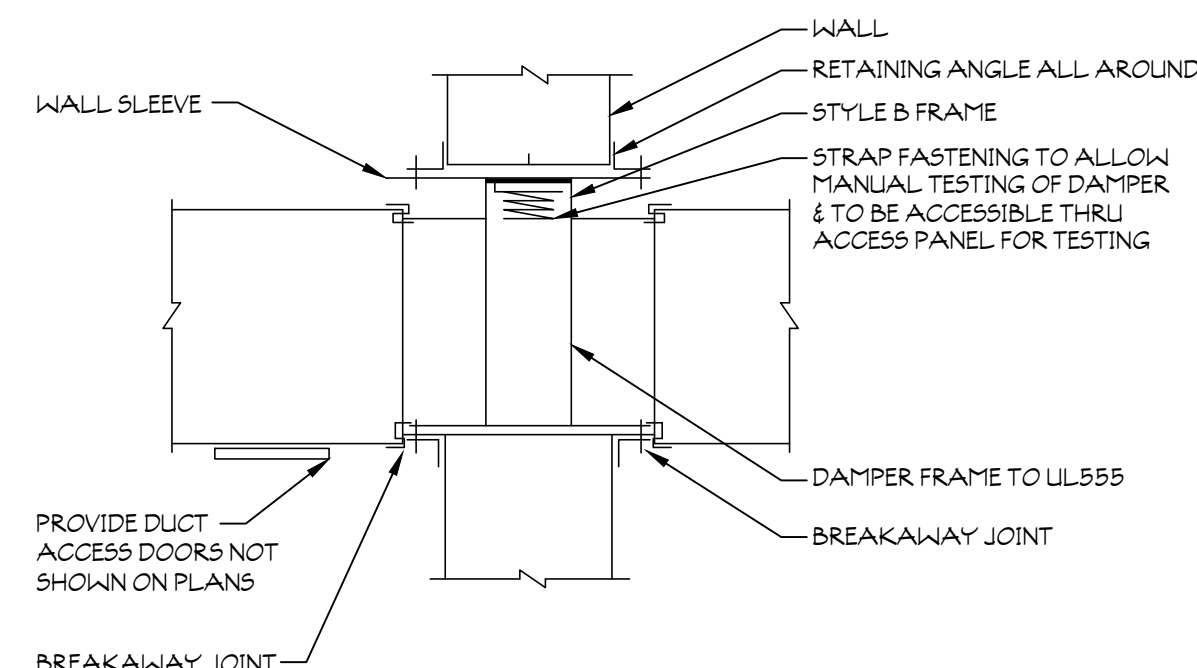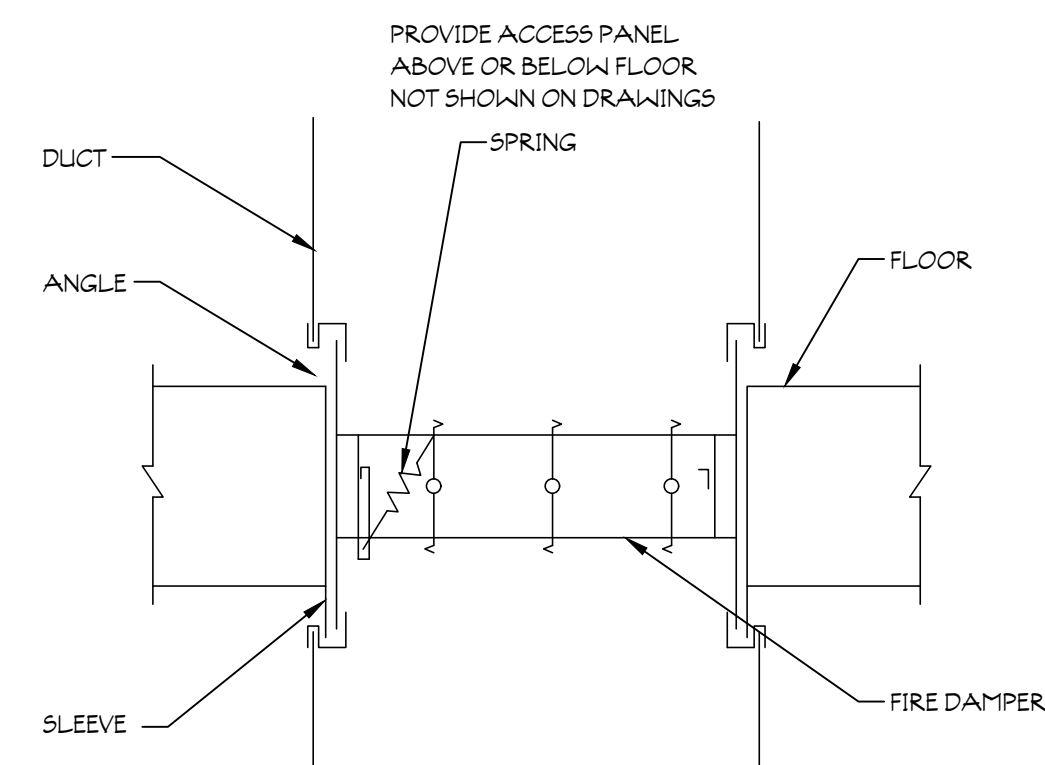


NOTE:

PROVIDE CLOSED-CELL ELASTOMERIC INSULATION ON ALL METAL CONDENSATE DRAIN PIPES.



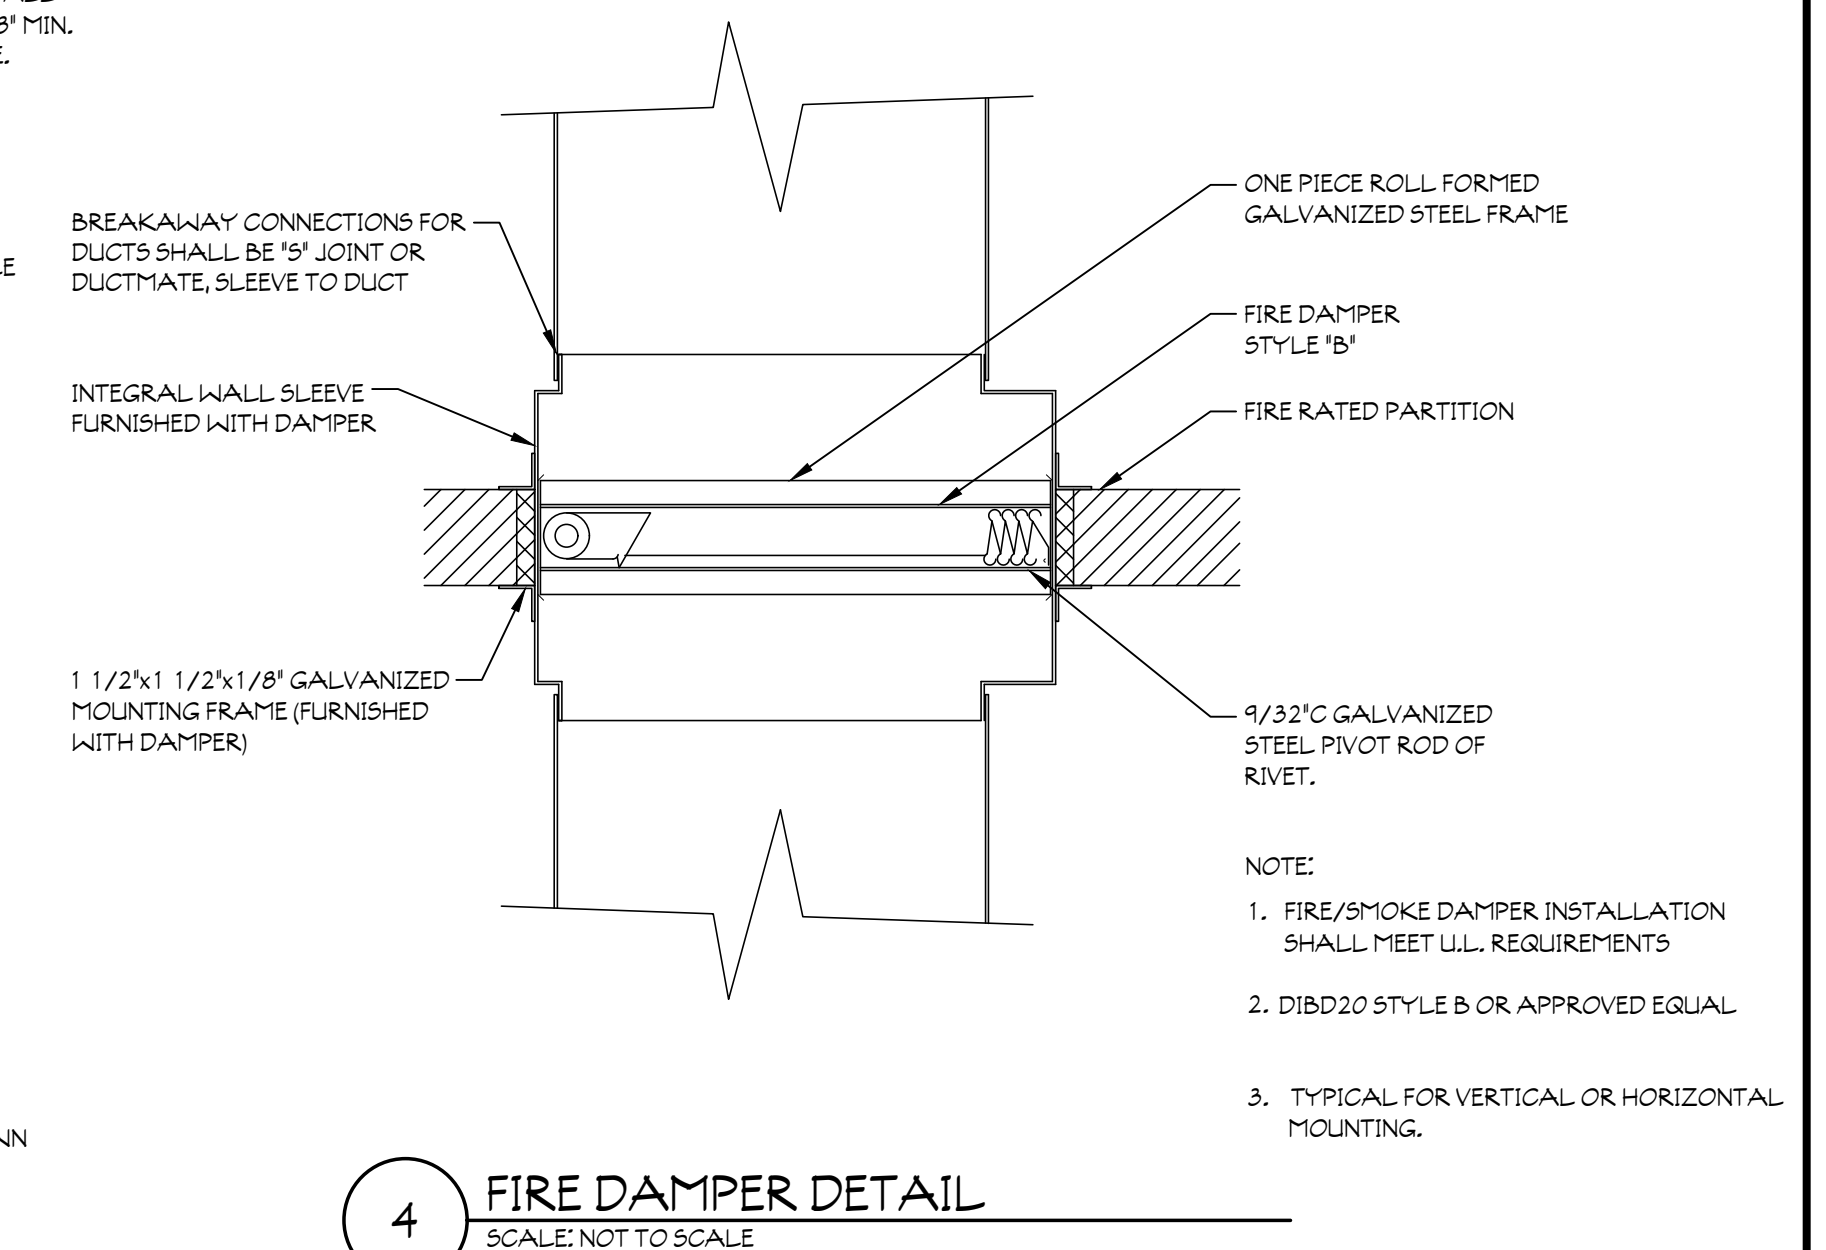


- NOTE:
1. FIRE/SMOKE DAMPER INSTALLATION SHALL MEET U.L. REQUIREMENTS
 2. DIBD20 STYLE B OR APPROVED EQUAL
 3. TYPICAL FOR VERTICAL OR HORIZONTAL MOUNTING.

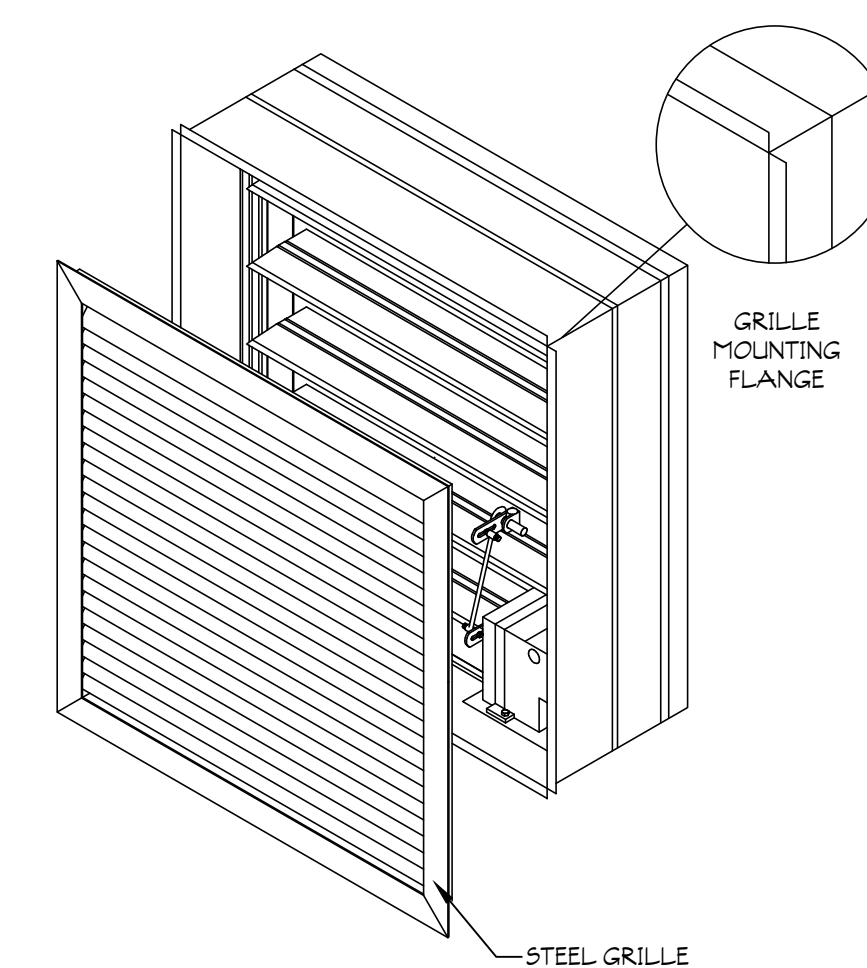

- NOTE:

1. FIRE/SMOKE DAMPER INSTALLATION SHALL MEET U.L. REQUIREMENTS
2. FIRE/SMOKE DAMPER BASED ON RUSKIN MODEL FSD60A FRONT ACCESS OR APPROVED EQUAL
3. FURNISH COMPLETE WITH 120 VOLT DAMPER ACTUATOR OR FURNISHED COMPLETE WITH SMOKE DAMPER FOR A U.L. RATED SMOKE DAMPER.
4. SMOKE DAMPER SHALL BE ACTIVATED FROM SMOKE DETECTOR OR TO CLOSE UPON SMOKE DETECTION.
5. PROVIDE FAIL SAFE DESIGN WHICH WILL ENABLE THE DAMPER TO AUTOMATICALLY CLOSE DUE TO LOSS OF POWER.

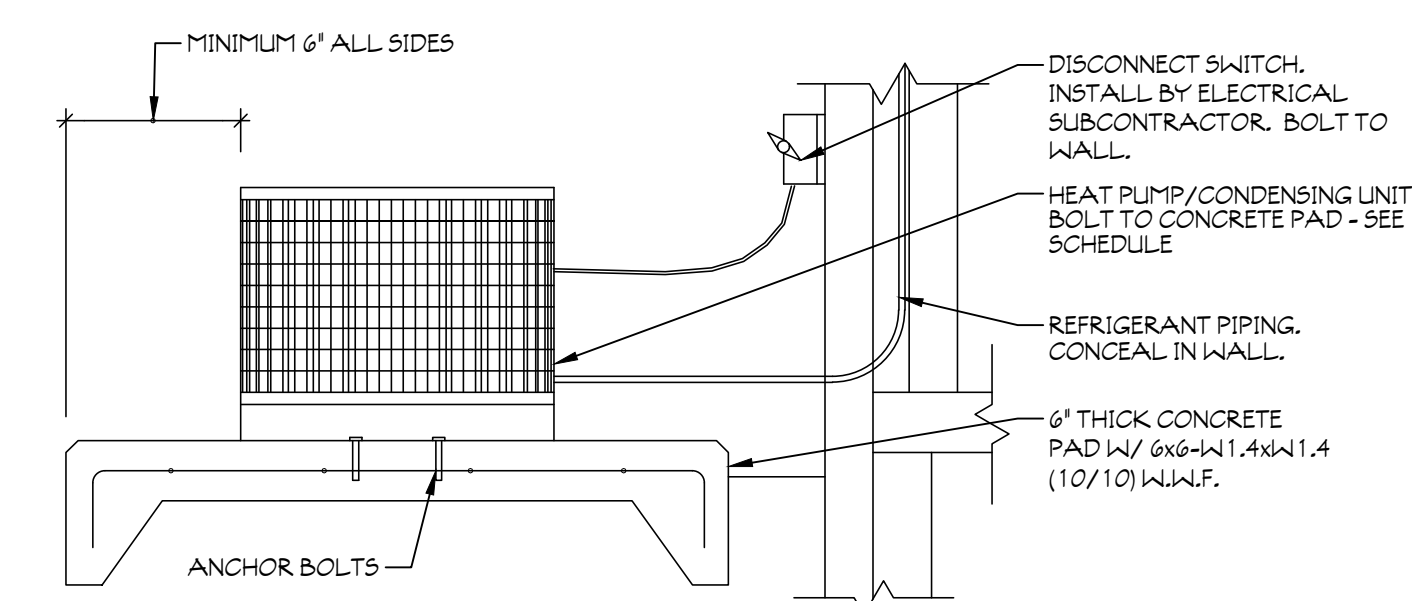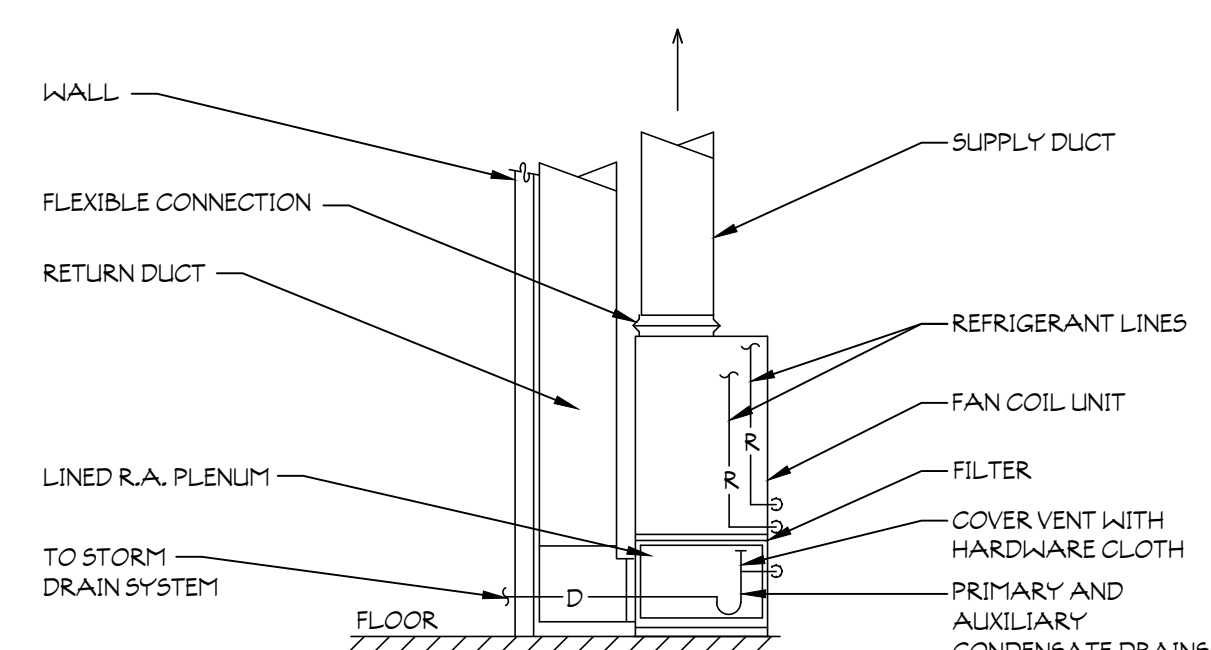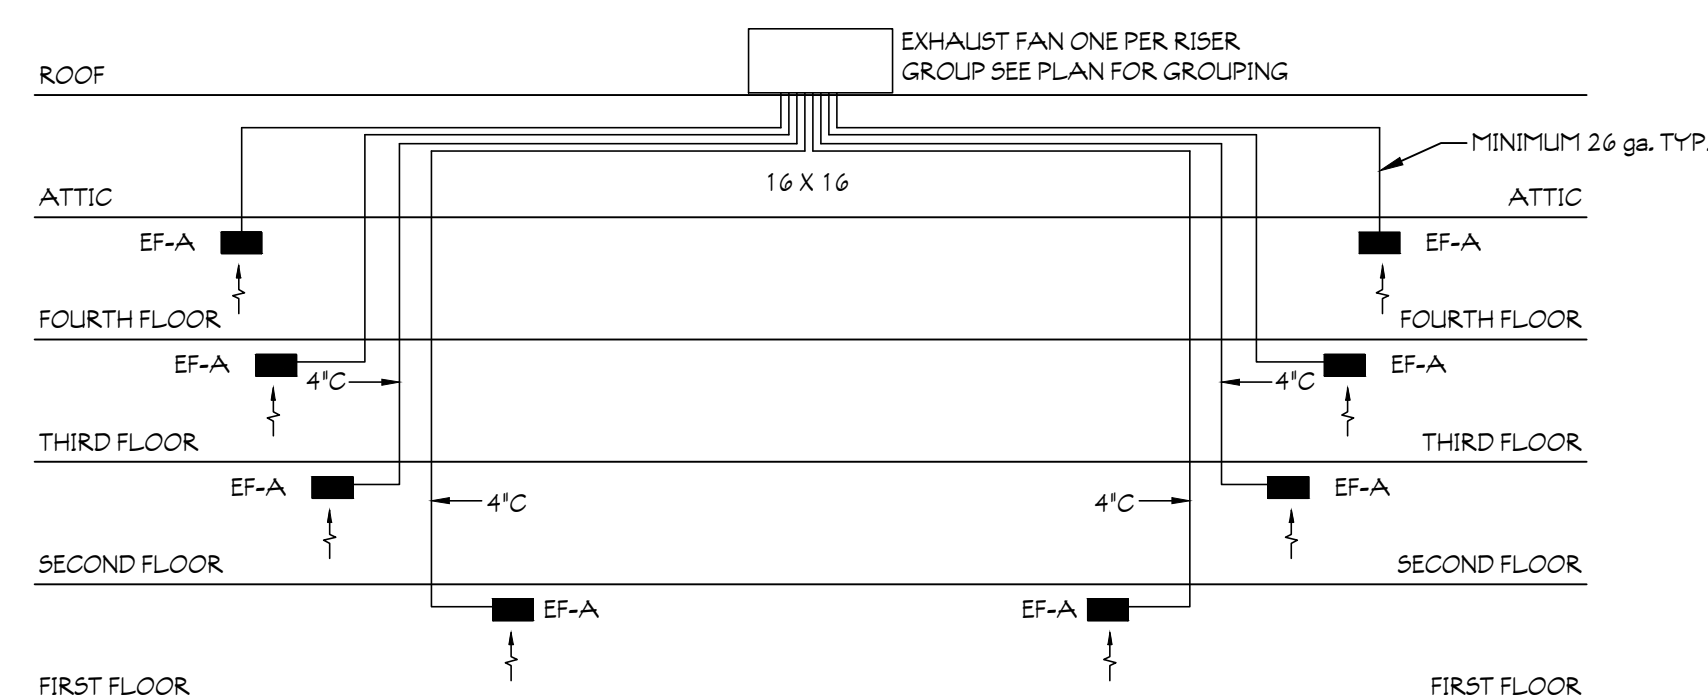

WH DRRAWINGS ARE DRAWN TO SCALE
OF THE DRAWING CANNOT BE

M
MAST
ARCHITECTURAL
SERVICES
DIVISION OF
L.E.M., INC.
112 NORTH MAIN STREET,
GOSHEN, INDIANA 46526

* Planners
* Consultants
* Construction Mgmt.
* Rule 5 and MS4 Filing

PHONE (574) 537-8500
FAX (574) 537-0808



SHEET SIZE 24x36

FT. WAYNE, INDIANA

REVISIONS:

PRELIMINARY - NOT
FOR CONSTRUCTION

DATE: 05/01/26
JOB NO.: MAS-26-105
NAME:
MECHANICAL DETAILS
SHEET:

M002