


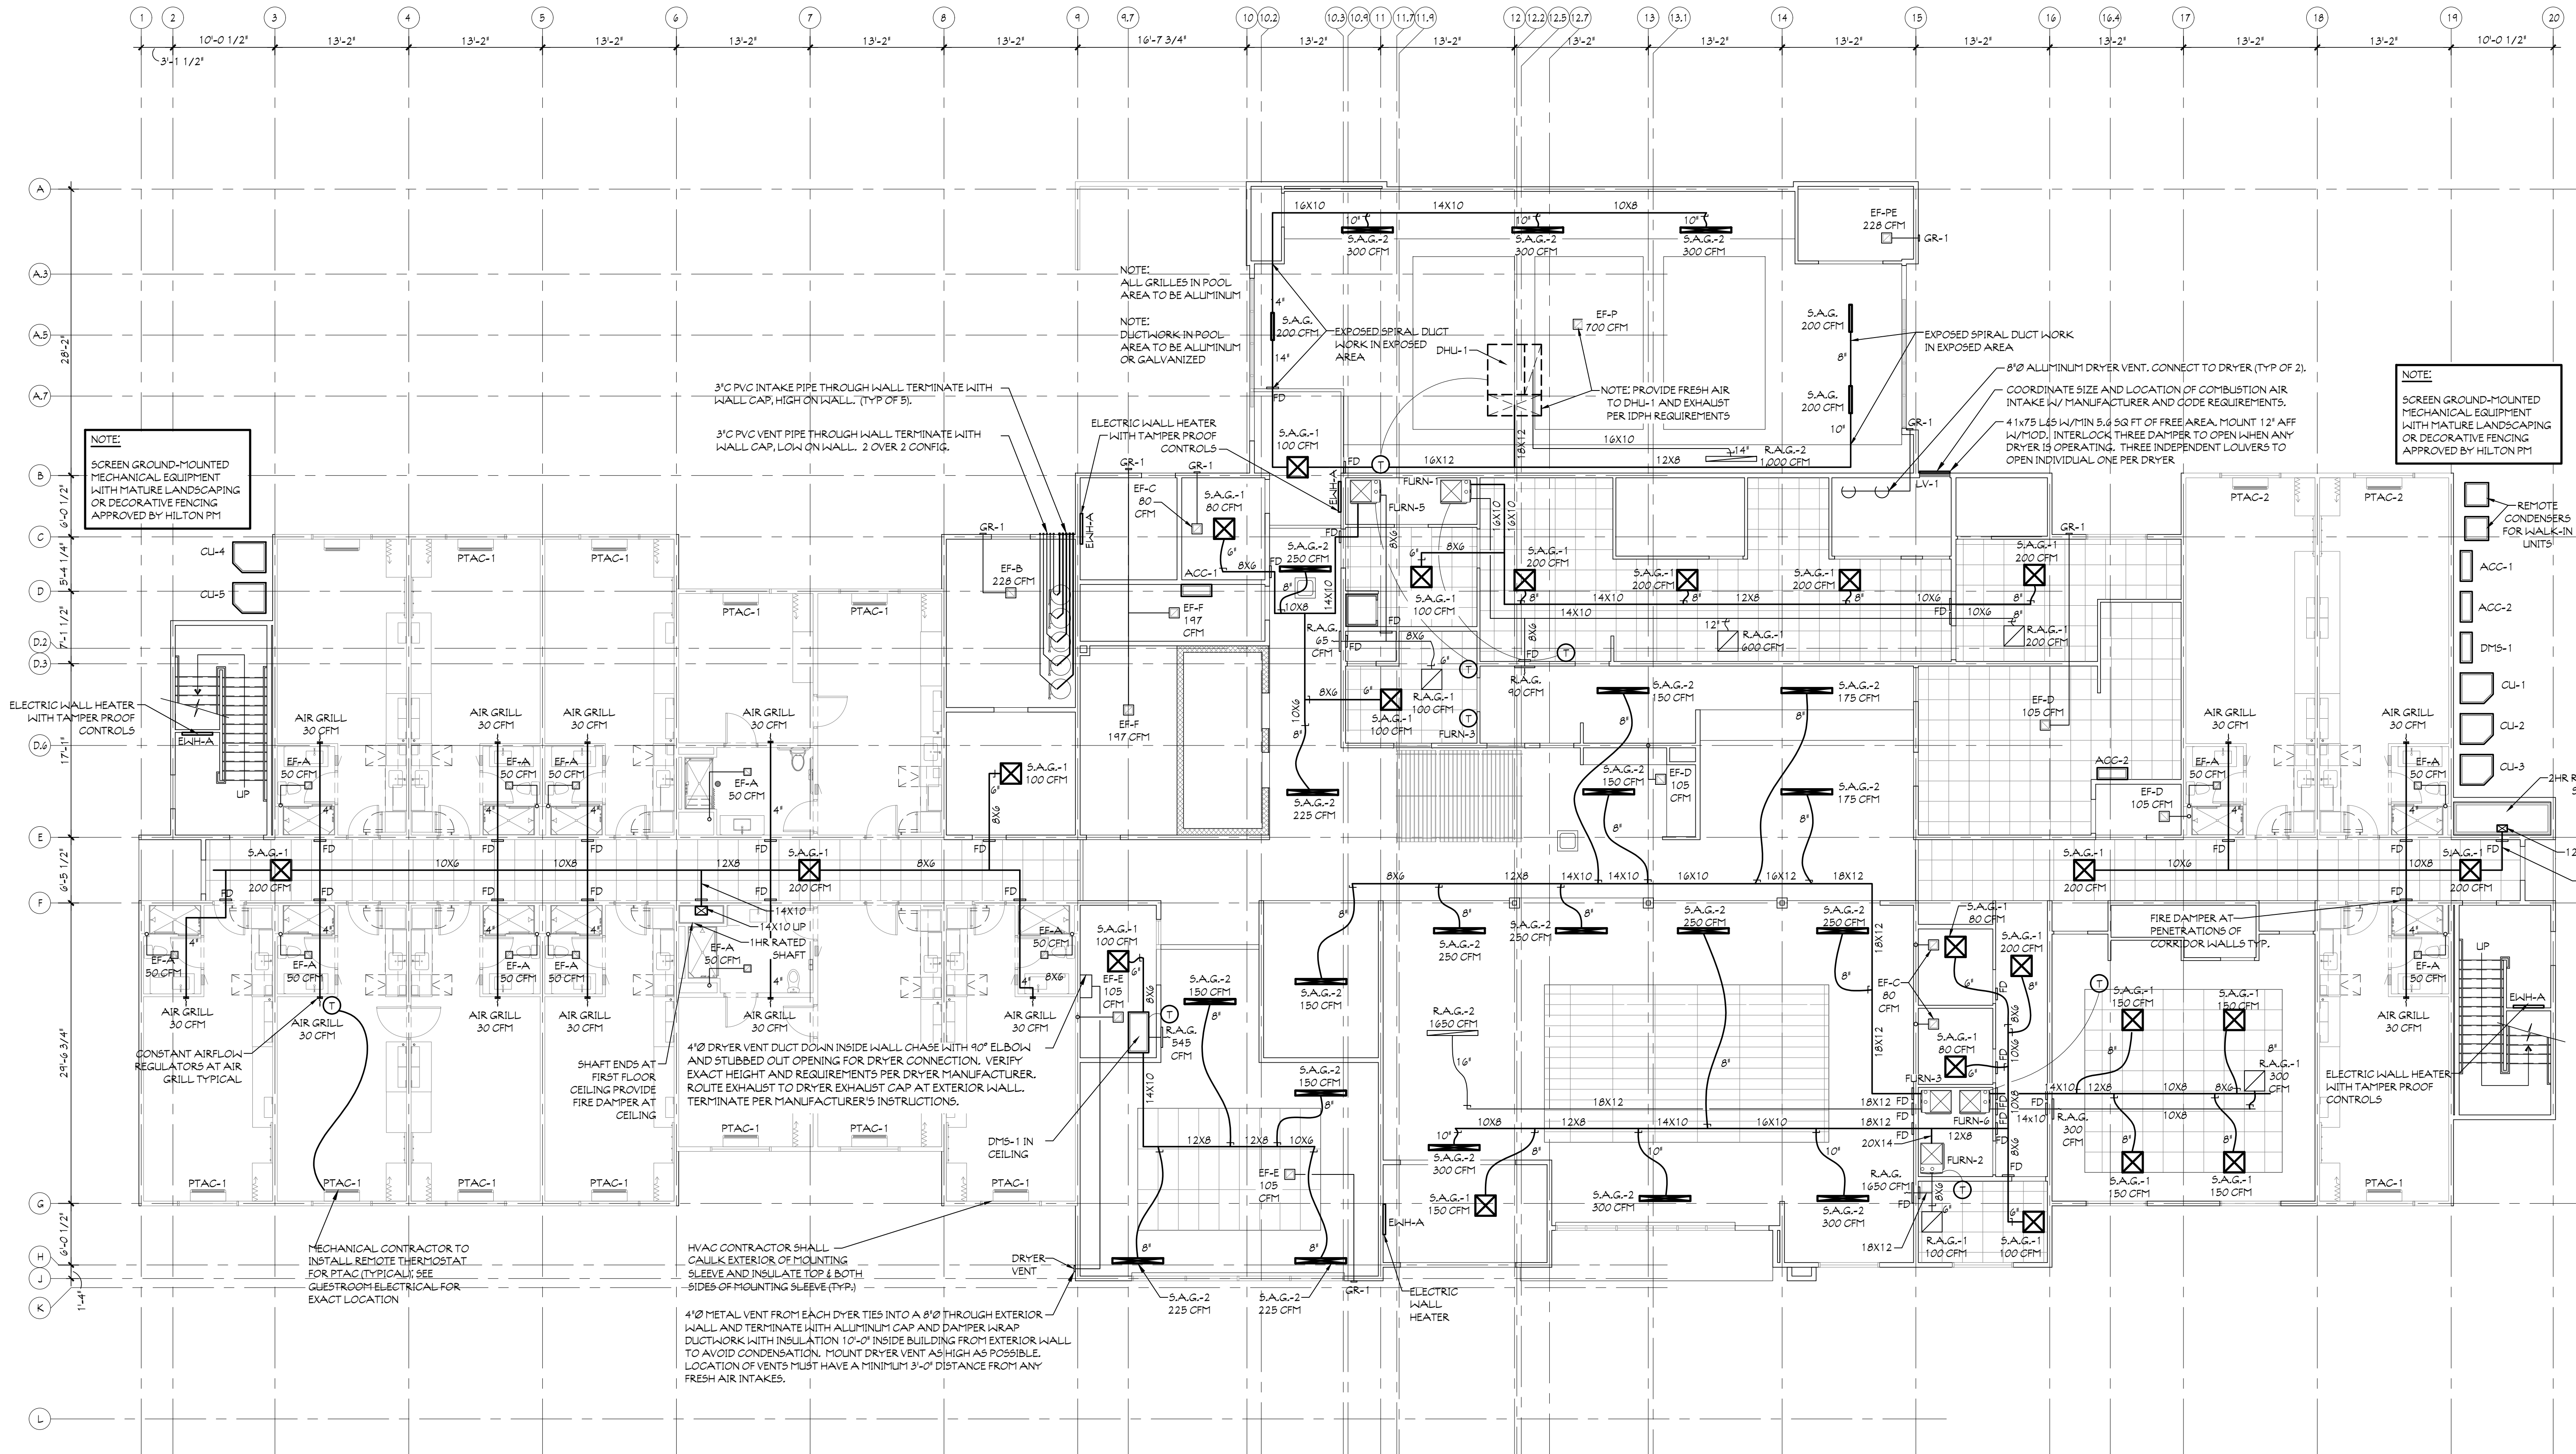

NOTE:
SCREEN GROUND-MOUNTED MECHANICAL EQUIPMENT WITH MATURE LANDSCAPING OR DECORATIVE FENCING APPROVED BY HILTON PM

3/4" PVC INTAKE PIPE THROUGH WALL TERMINATE WITH WALL CAP, HIGH ON WALL. (TYP OF 3).
3/4" PVC VENT PIPE THROUGH WALL TERMINATE WITH WALL CAP, LOW ON WALL. 2 OVER 2 CONFIG.

NOTE:
ALL GRILLES IN POOL AREA TO BE ALUMINUM
NOTE:
DUCTWORK IN POOL AREA TO BE ALUMINUM OR GALVANIZED

NOTE: PROVIDE FRESH AIR TO DHU-1 AND EXHAUST PER IDPH REQUIREMENTS

8"Ø ALUMINUM DRYER VENT. CONNECT TO DRYER (TYP OF 2).
COORDINATE SIZE AND LOCATION OF COMBUSTION AIR INTAKE W/ MANUFACTURER AND CODE REQUIREMENTS.
4"X75 LBS W/MIN 5.6 SQ FT OF FREE AREA. MOUNT 12" AFF W/100". INTERLOCK THREE DAMPER TO OPEN WHEN ANY DRYER IS OPERATING. THREE INDEPENDENT LOUVERS TO OPEN INDIVIDUAL ONE PER DRYER

NOTE:
SCREEN GROUND-MOUNTED MECHANICAL EQUIPMENT WITH MATURE LANDSCAPING OR DECORATIVE FENCING APPROVED BY HILTON PM

- NOTES:
- THE MECHANICAL CONTRACTOR SHALL VERIFY ALL DUCT SIZING AND COORDINATE LAY OUT WITH STRUCTURAL SYSTEM
 - COORDINATE DUCT LOCATIONS WITH PLUMBING CONTRACTOR
 - ALL GRILLES WITHOUT VOLUME DAMPERS SHALL BE FURNISHED WITH APPROVED BLADE LOUVERS
 - ALL DUCT WORK THAT PENETRATES THE GYPSUM CEILING SHALL HAVE A FIRE DAMPER
 - ALL DUCT WORK THAT PENETRATES A RATED ASSEMBLY SHALL HAVE A FIRE DAMPER
 - PROVIDE UV PROTECT COATING/COVERING ON ALL ELECTROMETRIC PIPE INSULATION WHERE EXPOSED TO LIGHT
 - EXHAUST FANS SHALL HAVE FIRE DAMPERS AT EACH UNIT
 - PROVIDE A TEMPERATURE/RELATIVE HUMIDITY ALARM DEVICE IN THE PBX ROOM TO NOTIFY HOTEL STAFF OF TEMP/RH ISSUE VIA CHIME, BELL, LIGHT, ETC. EXAMPLE: EXTECH INSTRUMENTS HUMIDITY ALARM 111 MODEL 445815 WITH ALARM & REMOTE PROBE
 - PROVIDE A CO2 SENSOR IN GUESTROOMS WHERE GAS EQUIPMENT IS BELOW OR BESIDE, SUCH AS DRYERS IN LAUNDRY, WATER ROOM AND IN ALL ROOMS WITH GAS FIRED EQUIP.
 - ALL GUESTROOM PTAC UNITS MUST HAVE A HARDWIRED SUB-BASE DISCONNECT
 - EACH FURNACE WILL HAVE A THERMOSTAT VERIFY LOCATION
 - ALL MECHANICAL GRILLES AND LOUVERS TO BE PAINTED TO MATCH THE SURROUNDING MATERIAL COLOR

GENERAL NOTES:
ALL TRADES NEED TO FIRE CAULK THEIR OWN PENETRATIONS PER CODE.
ANY DAMAGE TO FINISHED DRY-WALL OR FINISHED SURFACE WILL BE THE RESPONSIBILITY OF THE SUB CONTRACTOR
ALL SUBCONTRACTORS ARE RESPONSIBLE TO CLEAN UP ALL DEBRIS AND MATERIALS AT THE END OF EACH DAY

GENERAL NOTES:
ALL BUILDING REQUIREMENTS TO FOLLOW SPECIFICATIONS PER HILTON LATEST STANDARDS FOR HOME 2 BY HILTON. CONTRACTOR MUST MAKE THEIR COMPANY FAMILIAR WITH THOSE STANDARDS SET FORTH BY HILTON HOTEL. ALL DRAWINGS SUBJECT TO CHANGE IF DRAWINGS CONFLICT WITH HILTON HOTEL STANDARDS.

NOTE:
(FD) FIRE DAMPER AT PENETRATIONS OF RATED WALLS TYP.

NOTE:
ALL FIRE DAMPER LOCATIONS TO BE LABELED 50 FIRE INSPECTORS CAN IDENTIFY LOCATION. ALL FIRE DAMPERS TO HAVE ACCESS FOR TESTING


NOTE:
MECHANICAL CONTRACTOR TO VERIFY ALL DUCT SIZES

NOTE:
PROVIDE GUEST-ACCESSIBLE THERMOSTAT AT FITNESS ROOM THAT IS NOT LOCKED OFF OR COVERED

1 FIRST FLOOR MECHANICAL PLAN
SCALE: 1/8" = 1'-0"

GENERAL NOTES
ALTHOUGH DRAWINGS ARE PREPARED TO SCALE, THE ACCURACY OF THE DRAWINGS CANNOT BE GUARANTEED. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO CONSTRUCTION. DIMENSIONS SHALL BE DELETED FROM DIMENSIONED PLANS.
ALL DIMENSIONS UNLESS OTHERWISE NOTED.
GENERAL CONTRACTOR, "HILTON ARCHITECTURAL SERVICES" SHALL NOT BE HELD RESPONSIBLE FOR ANY CONSTRUCTION DEFECTS OR DAMAGE TO THE BUILDING OR ITS CONTENTS BROUGHT TO THEIR ATTENTION PRIOR TO CONSTRUCTION.

Architects
Planners
Construction Mgmt
* Rule 5 and MS4 Filing
MAUIST ARCHITECTURAL SERVICES
DIVISION OF L.E.M., INC.
112 NORTH MAIN STREET
GOSHEN, INDIANA 46526
PHONE: (574) 537-8500
FAX: (574) 537-0808
These drawings are the property of Maui Architectural Services and may not be reprinted, copied or used in any manner without the written consent of Maui Architectural Services.

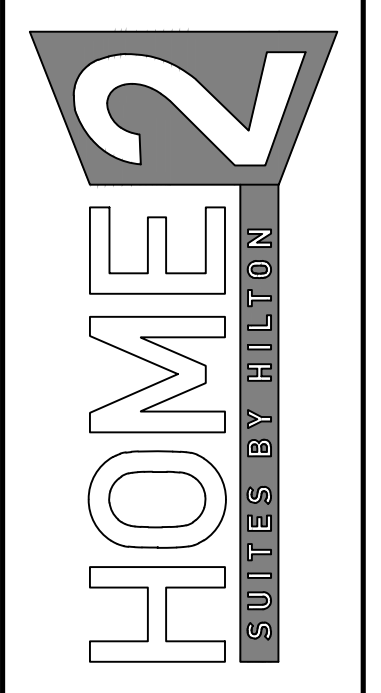

SHEET SIZE 24x36

FT. WAYNE, INDIANA

REVISIONS:
PRELIMINARY - NOT FOR CONSTRUCTION

DATE: 05/01/26
JOB NO.: MAS-26-105
NAME: FIRST FLOOR MECHANICAL PLAN
SHEET:

M101