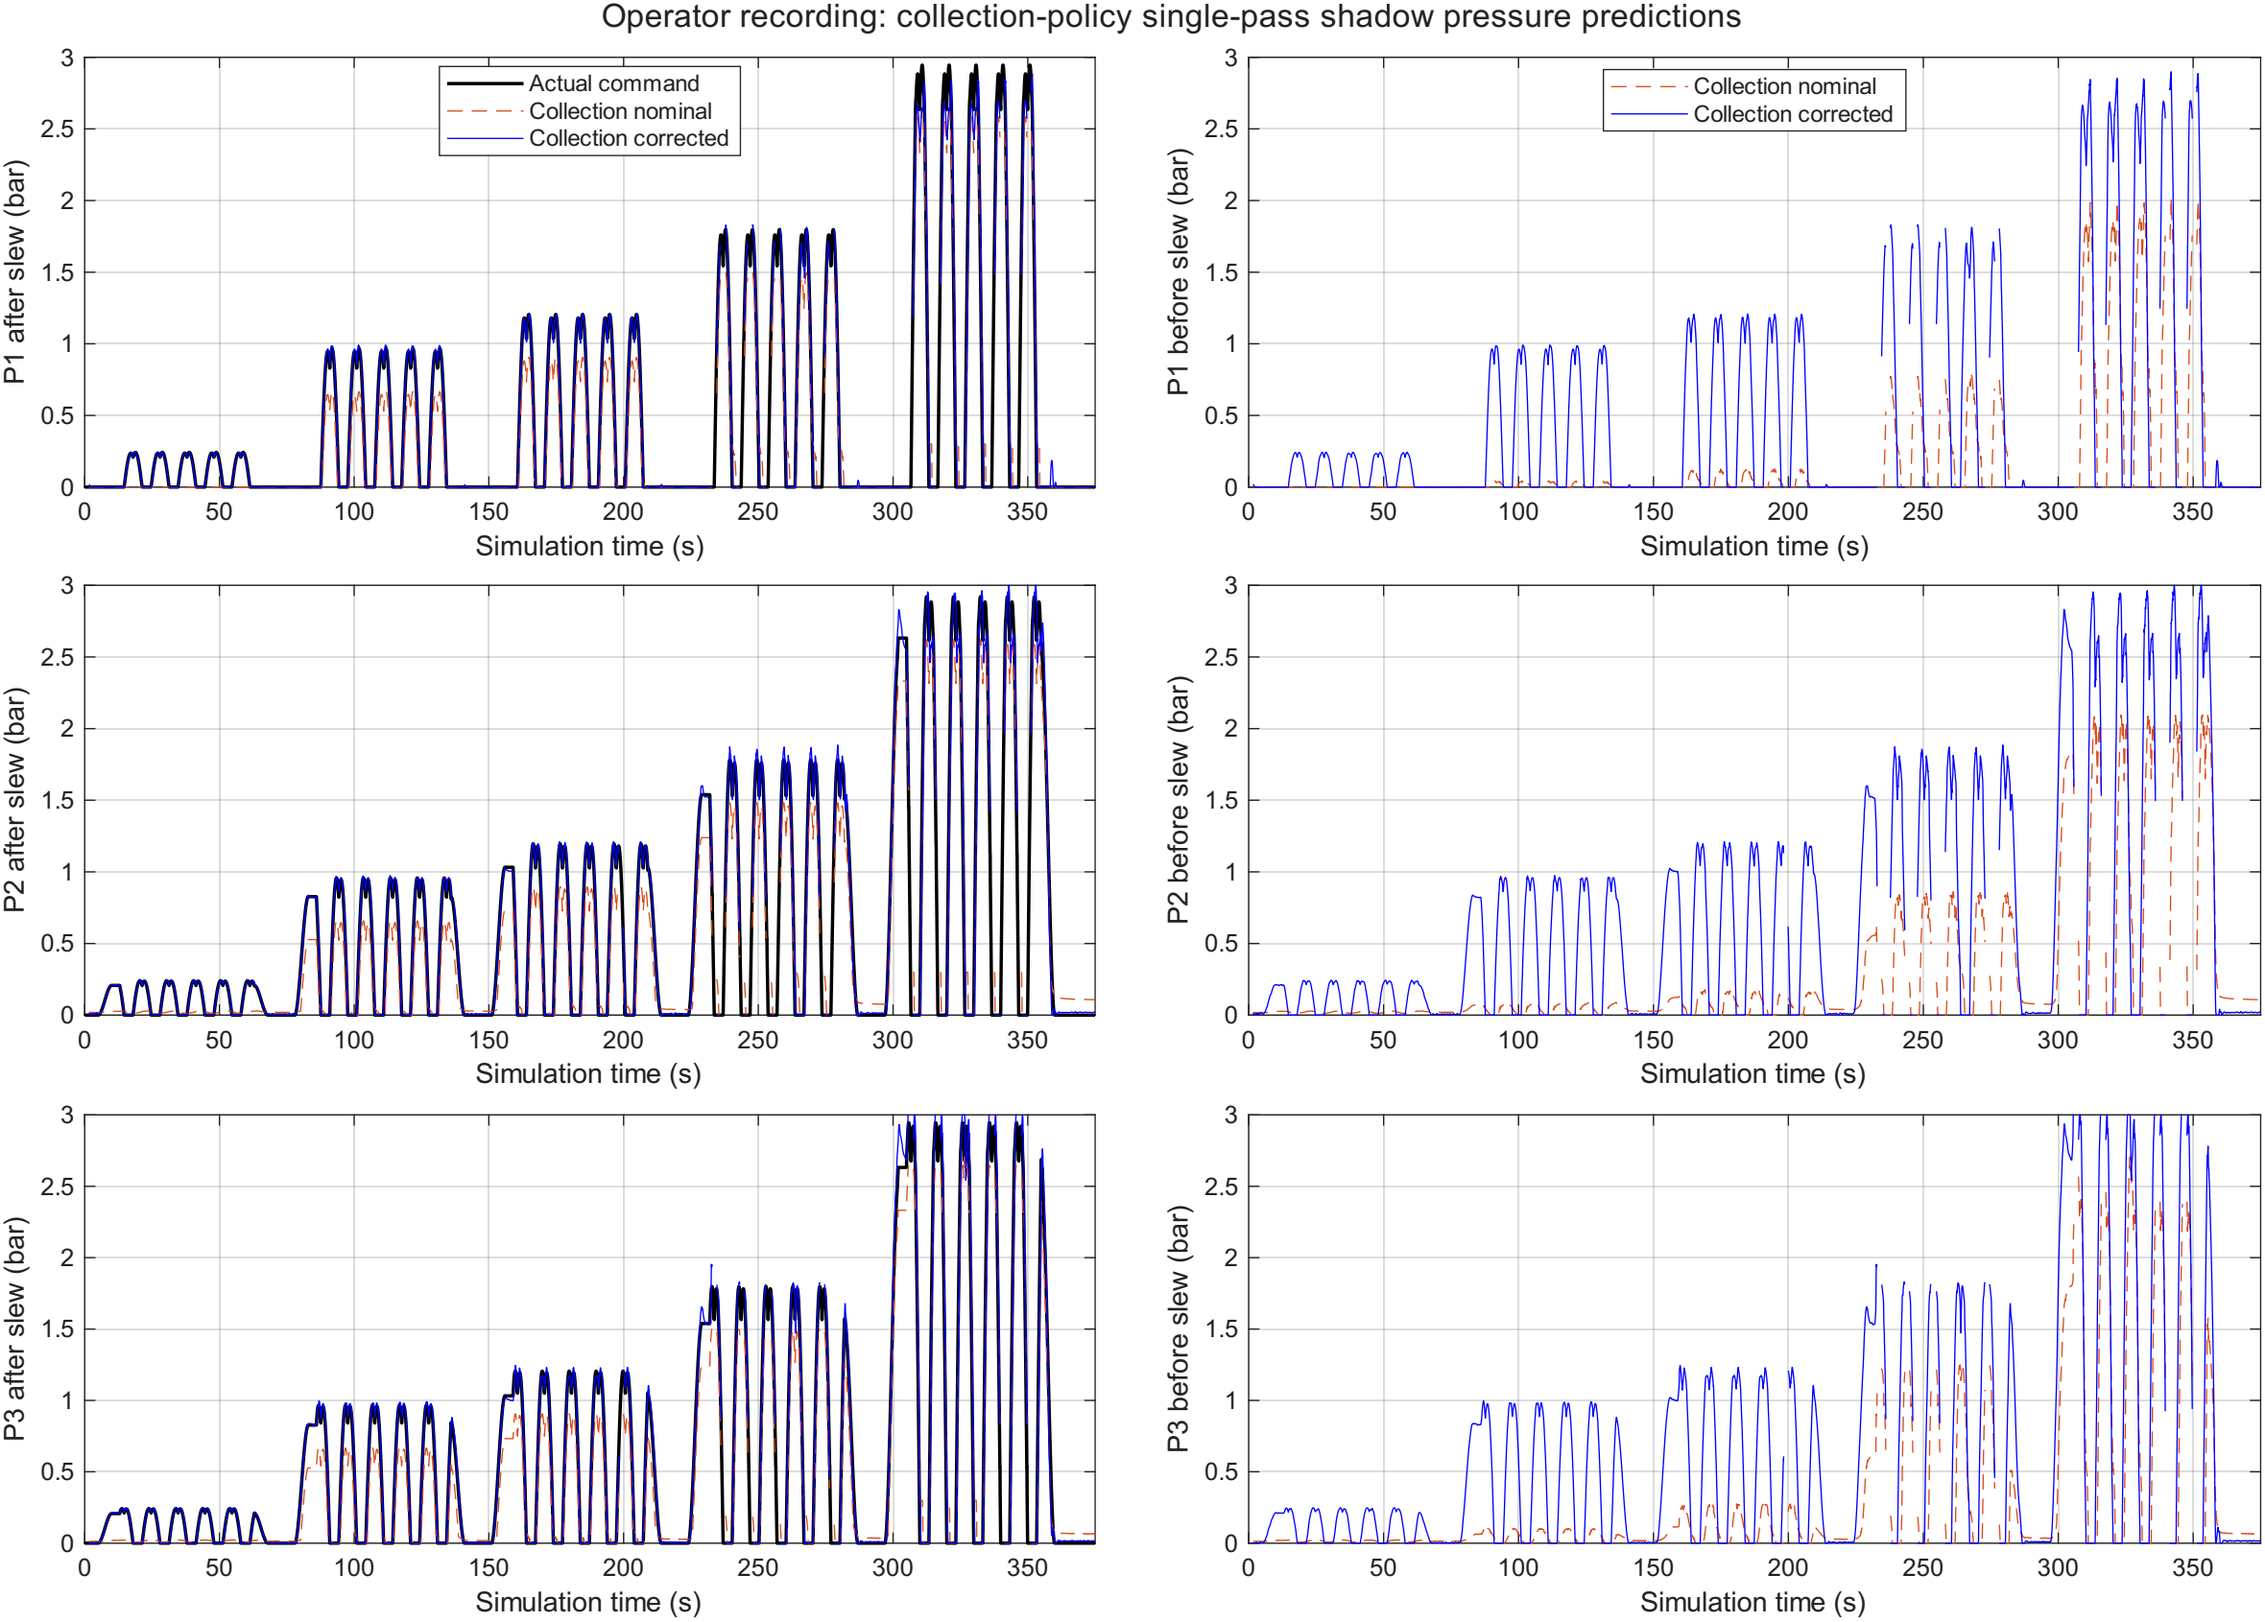

Operator recording: collection-policy single-pass shadow pressure predictions
Actual command
Collection nominal
Collection corrected
P1 after slew (bar)
P1 before slew (bar)
P2 after slew (bar)
P2 before slew (bar)
P3 after slew (bar)
P3 before slew (bar)
Simulation time (s)
0
50
100
150
200
250
300
350
0
0.5
1
1.5
2
2.5
3