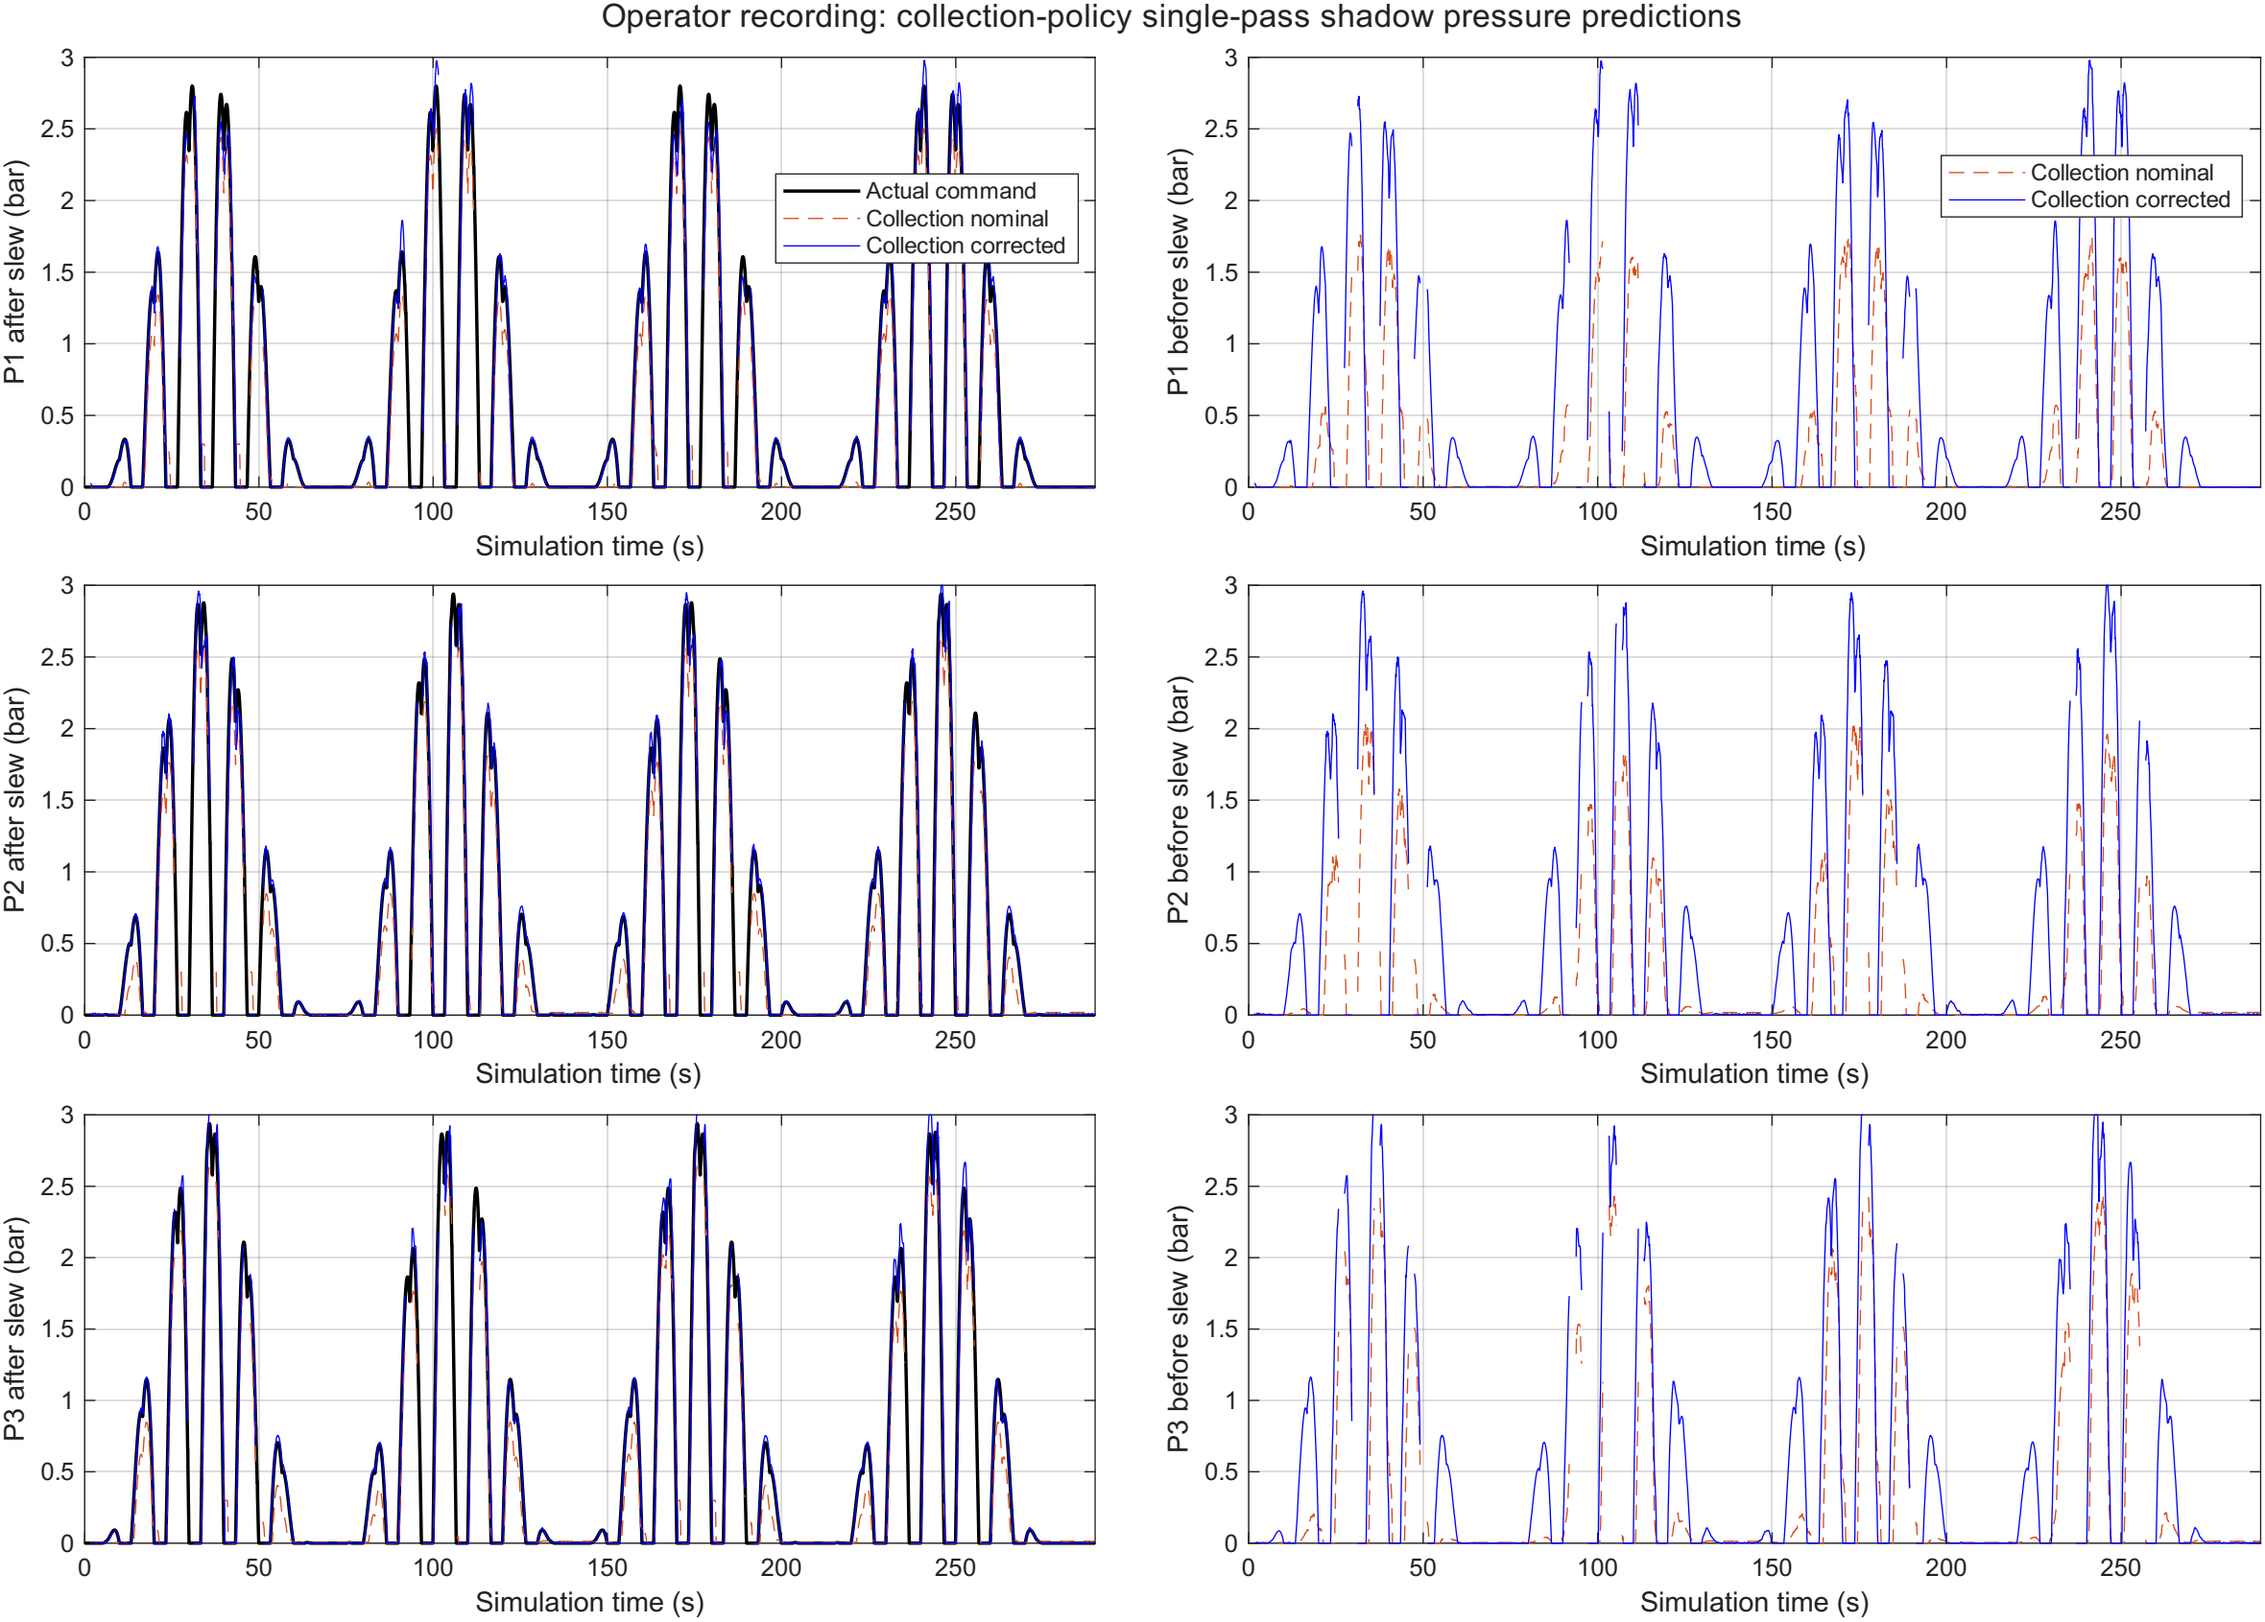

Operator recording: collection-policy single-pass shadow pressure predictions
P1 after slew (bar)
P1 before slew (bar)
P2 after slew (bar)
P2 before slew (bar)
P3 after slew (bar)
P3 before slew (bar)
Simulation time (s)
Actual command
Collection nominal
Collection corrected
0
0.5
1
1.5
2
2.5
3
0
50
100
150
200
250