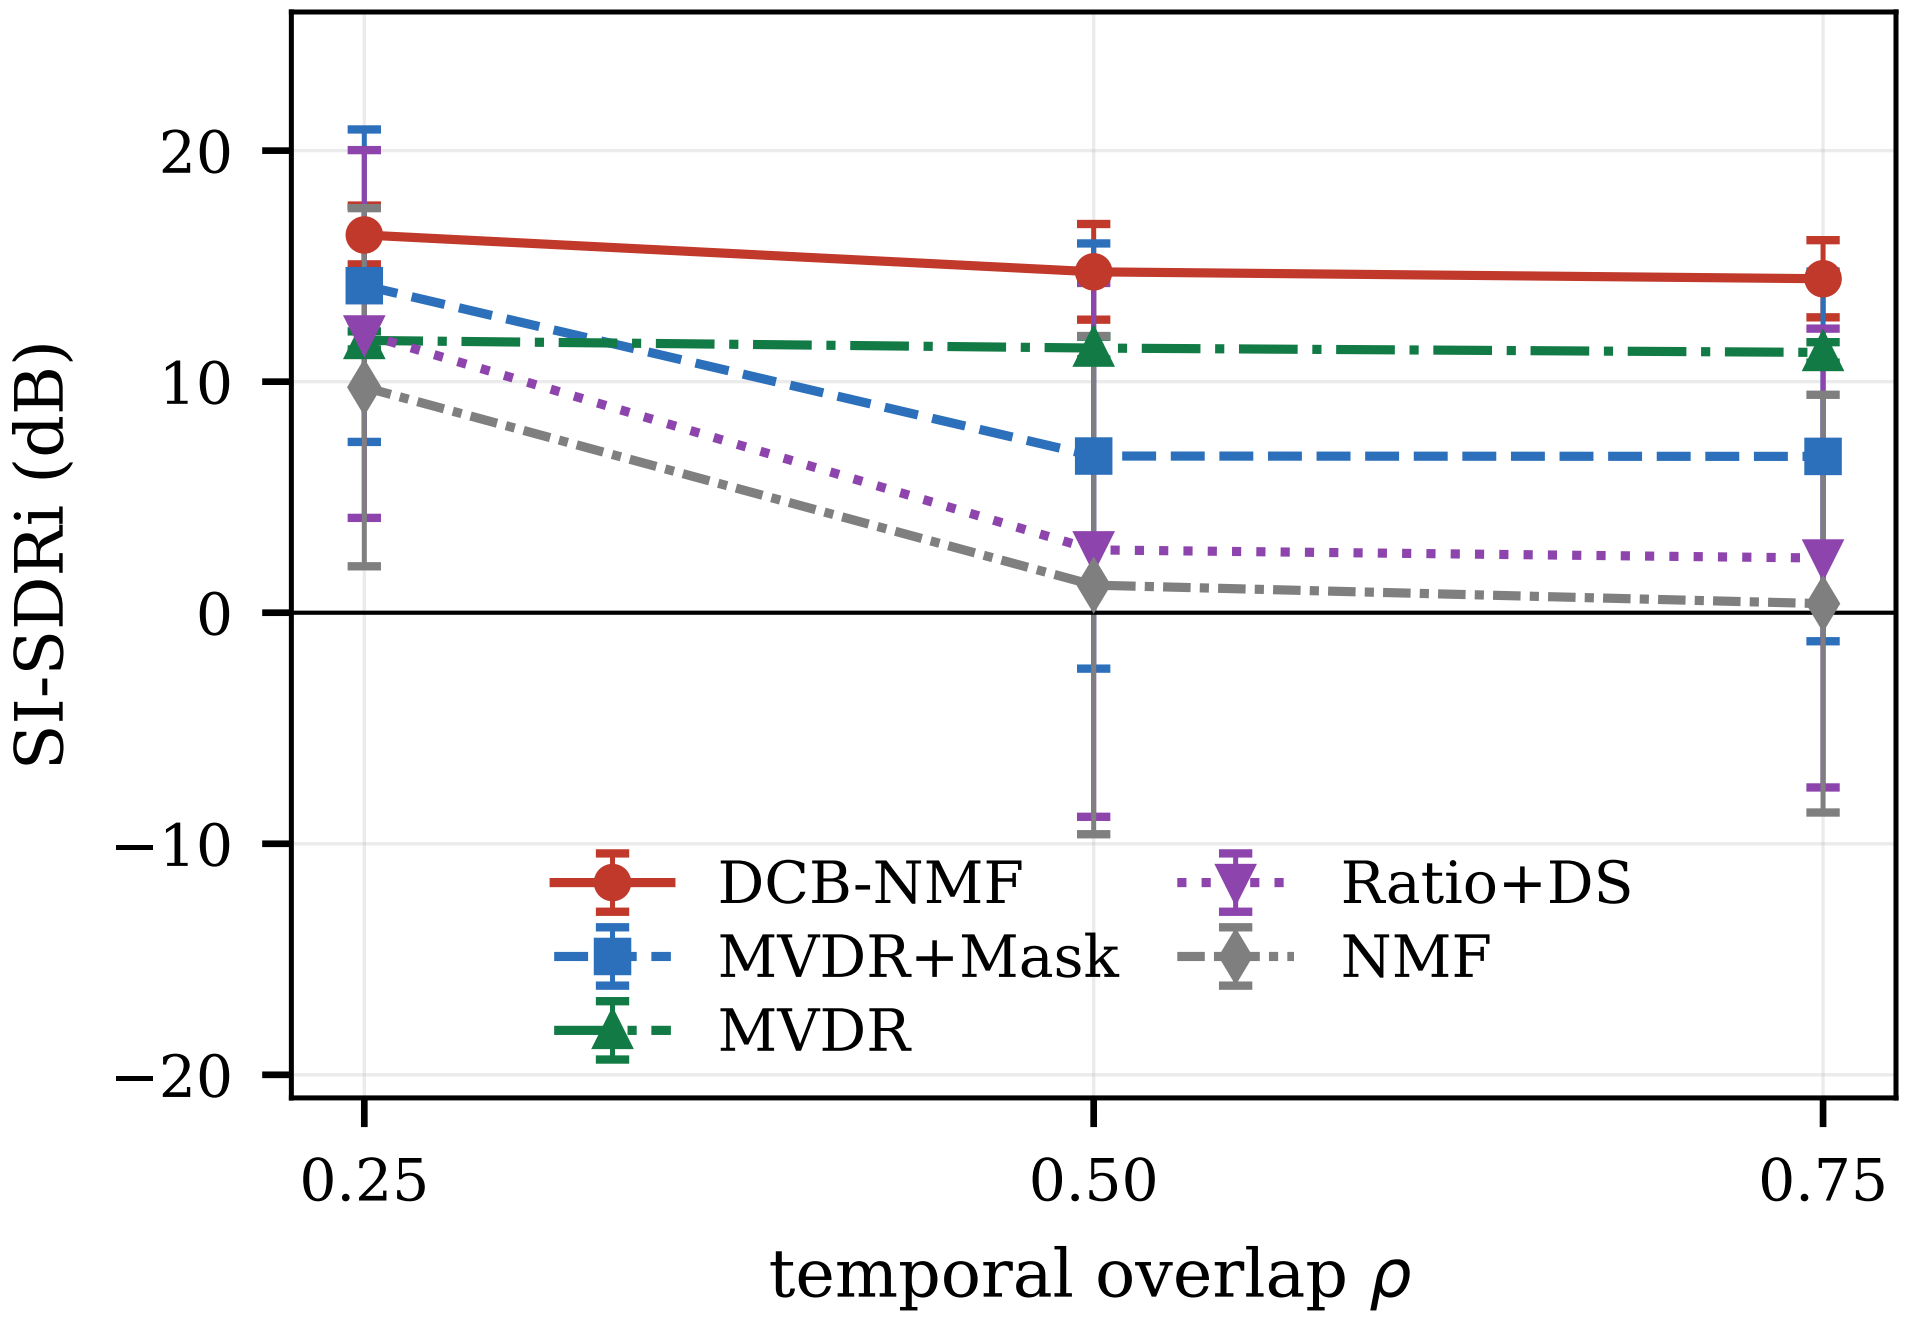
20
10
0
−10
−20
SI-SDRi (dB)
0.25
0.50
0.75
temporal overlap $\rho$
DCB-NMF
MVDR+Mask
MVDR
Ratio+DS
NMF