


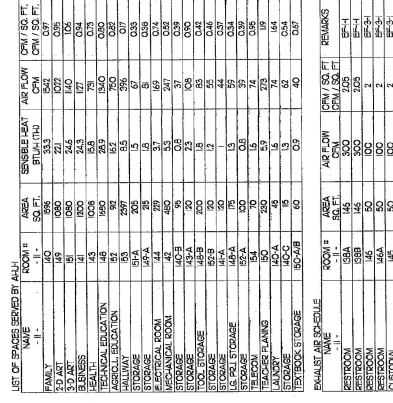

BUILDING 1 - EAST SIDE FIRST FLOOR PLAN - HVAC:

SCALE: 1/8" = 1'-0"

Age Group	Number of Respondents
18-24	28
25-34	25
35-44	22
45-54	18
55-64	15
65-74	12
75-84	10
85-94	8
95-104	5

NOTE:

1. SEE ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT LOCATION OF A/C DIFFUSERS AND RETURN AIR OR EXHAUST GRILLS. COORDINATE WORK ACCORDINGLY.
2. PROVIDE MINIMAL LENGTH OF 5'-0" AND MAX. 7'-0" OF FLEXIBLE DUCT CONNECTION.

CHILLED WATER PIPING		
PIPE Ø (IN.)	MAX. P.S.D. H ₂ O (FOOT)	MAXIMUM VELOCITY FPM
1/2	4	8
3/4	25	4

HVAC SYSTEM DUCTWORK		
LOW PRESSURE SYSTEM - 0.5" I.D. PRESSURE DROP		
MAXIMUM VELOCITY - 1,000 FEET PER MINUTE		
MEDIUM PRESSURE SYSTEM - 0.3" I.D. PRESSURE DROP		
MAXIMUM VELOCITY - 2,000 FEET PER MINUTE		

NOTE:
ANY EQUIPMENT, DEVICE, SYSTEM COMPONENT, OR PART PROVIDED OR INSTALLED BY CONTRACTOR CONTAINING OR USING DATA PROCESSING SHALL BE YEAR 2000 IT/KO COMPLIANT.