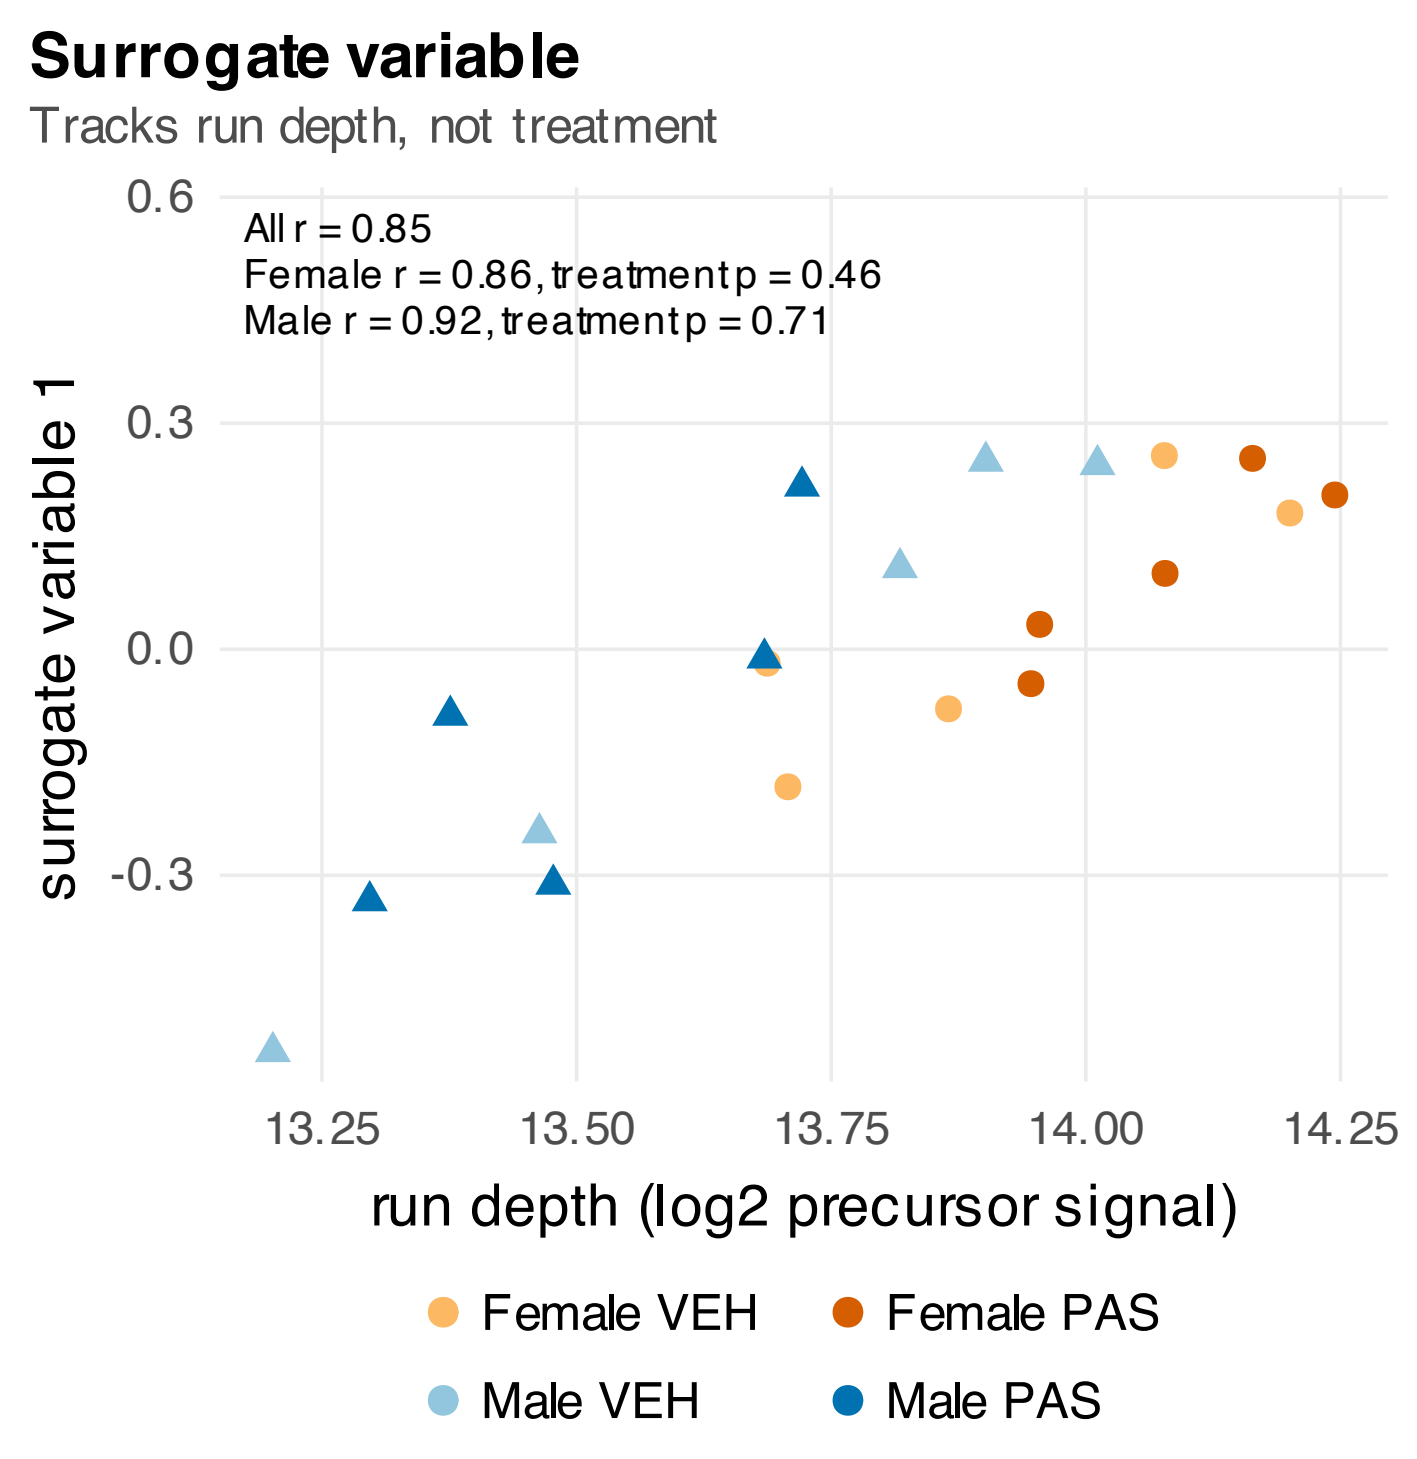
Surrogate variable
Tracks run depth, not treatment
All r = 0.85
Female r = 0.86, treatment p = 0.46
Male r = 0.92, treatment p = 0.71
surrogate variable 1
0.6
0.3
0.0
-0.3
13.25
13.50
13.75
14.00
14.25
run depth (log2 precursor signal)
Female VEH
Female PAS
Male VEH
Male PAS