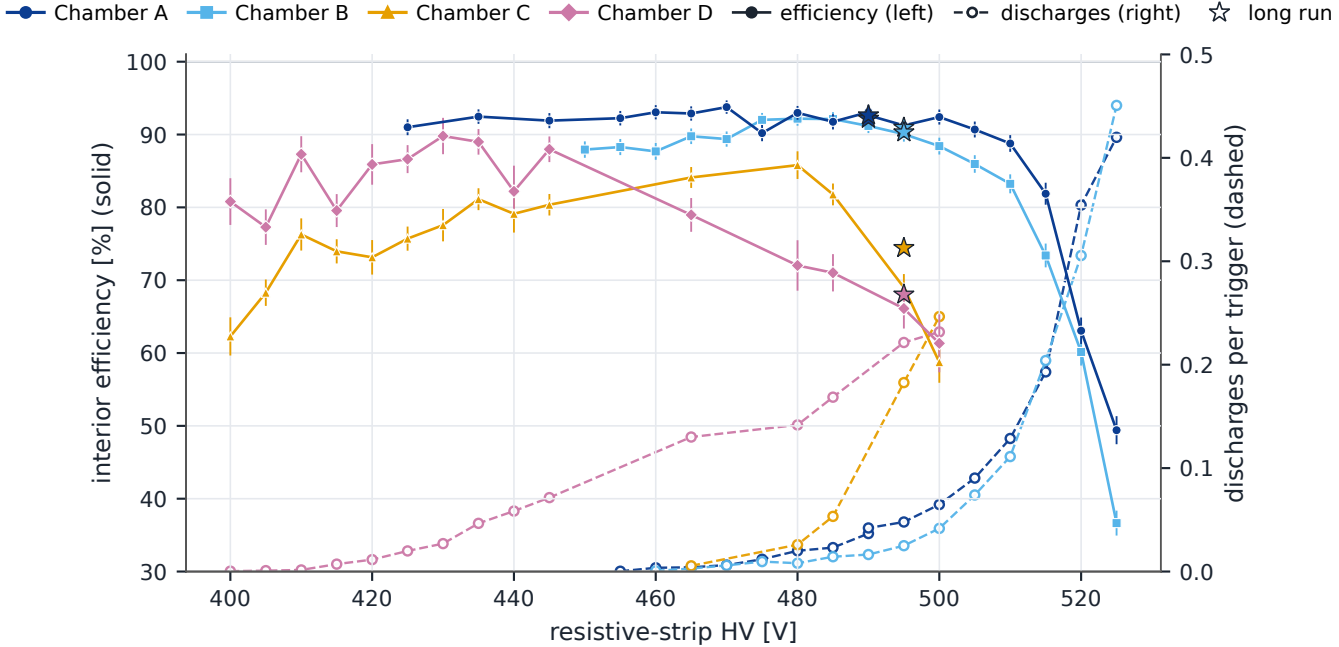
Chamber A
Chamber B
Chamber C
Chamber D
efficiency (left)
discharges (right)
long run
interior efficiency [%] (solid)
discharges per trigger (dashed)
resistive-strip HV [V]
100
90
80
70
60
50
40
30
0.5
0.4
0.3
0.2
0.1
0.0
400
420
440
460
480
500
520