



FR

N POWER EQUIPMENT

A


N.T.S.

DISTRIBUTION POWER

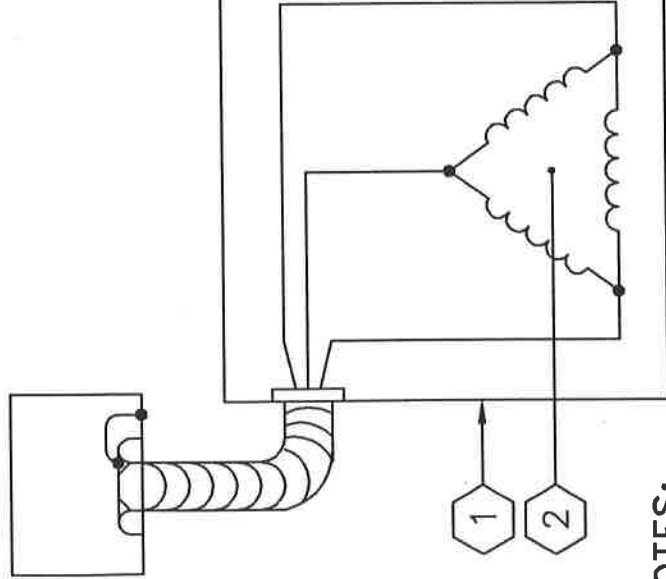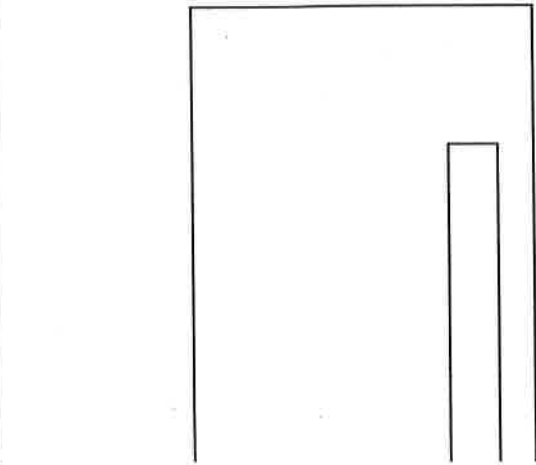

NOTES:

- 1 ENCLOSURE
- 2 PRIMARY WINDING
- 3 SECONDARY WINDING
- 4 BOND TO ENCLOSURE
- 5 GROUNDING ELECTRODE CONDUCTOR

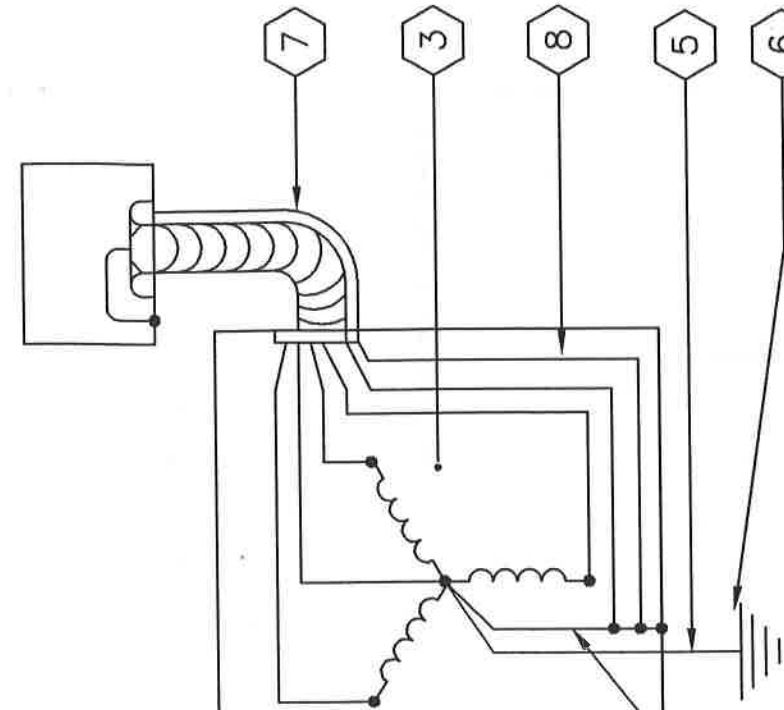

- 6 GROUNDING ELECTRODE - TO GROUND BAR UNDER RAISED FLOOR BUILDING STEEL
- 7 FLEXIBLE CONDUIT WITH GROUNDING ELECTRODE CONDUCTOR
- 8 1G WIRE, MINIMUM # 3G. BOND TO NEUTRAL (GROUNDED) TERMINAL OF TRANSFORMER. THIS WILL SERVE AS THE ISOLATED GROUND, TAKEN FROM THE SEPARATELY DERIVED SYSTEM, PER NEC 250-26.

IL GROUNDING

D

N.T.S.

TRANSFORMER GROUNDING

(Δ Y)

W/MT WITH A SWITCH
SIDE WITH LED FOOT LIGHT

NOT INDICATED

