


CONTROL ROOM 406

NOTE:

WIREMOLD IN THIS ROOM SHALL BE G4000 TO MATCH EXISTING CONTROL ROOM 406 WITH OUTLETS 12" ON CENTER. PROVIDE ISOLATED GROUND AND NON-ISOLATED GROUND WIREMOLD AS INDICATED.

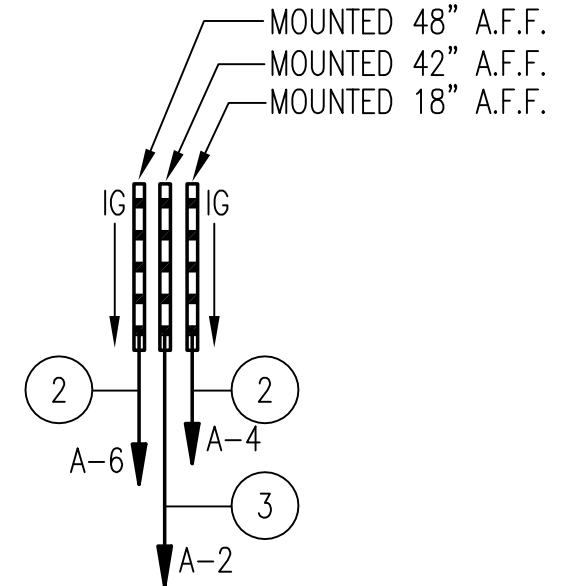

AUDIO BOOTH

416 ERL

SOUND BOOTH

ALL WIRING DEVICES ARE PROVIDED AS PART OF SOUND BOOTH PACKAGE

PROVIDE #4 COPPER GROUND STUD ABOVE SOUND BOOTH AND CONNECT TO BUILDING STEEL. COORDINATE WITH SOUND BOOTH MANUFACTURER.

PANEL "A" AND DISCONNECT SWITCH REFER TO PARTIAL RISER DIAGRAM.