


Installed Capacity Angola - baseline [MW]

- Generation
- Cacula Cabasa: 2100 MW
 - Candidate_PV_Angola: 2000 MW
 - Baynes: 430 MW
 - Candidate_CCGT_Gas_Angola: 209 MW
 - Calengue (Catumbela): 200 MW
 - Vuka: 121 MW
 - Kiwaba: 104 MW
 - Cafunfo: 40 MW
 - Cambulo: 37 MW
 - Lubango: 35 MW
 - Quilemba: 35 MW
 - Luena: 27 MW
 - Caraculo: 25 MW
 - Kuito: 15 MW
 - Cuango: 11 MW
 - Catete: 8 MW
 - Cunene: 8 MW
 - Bailundo: 8 MW
 - Lucapa: 7 MW
 - Transmission
 - Angola-DRC: 500 MW

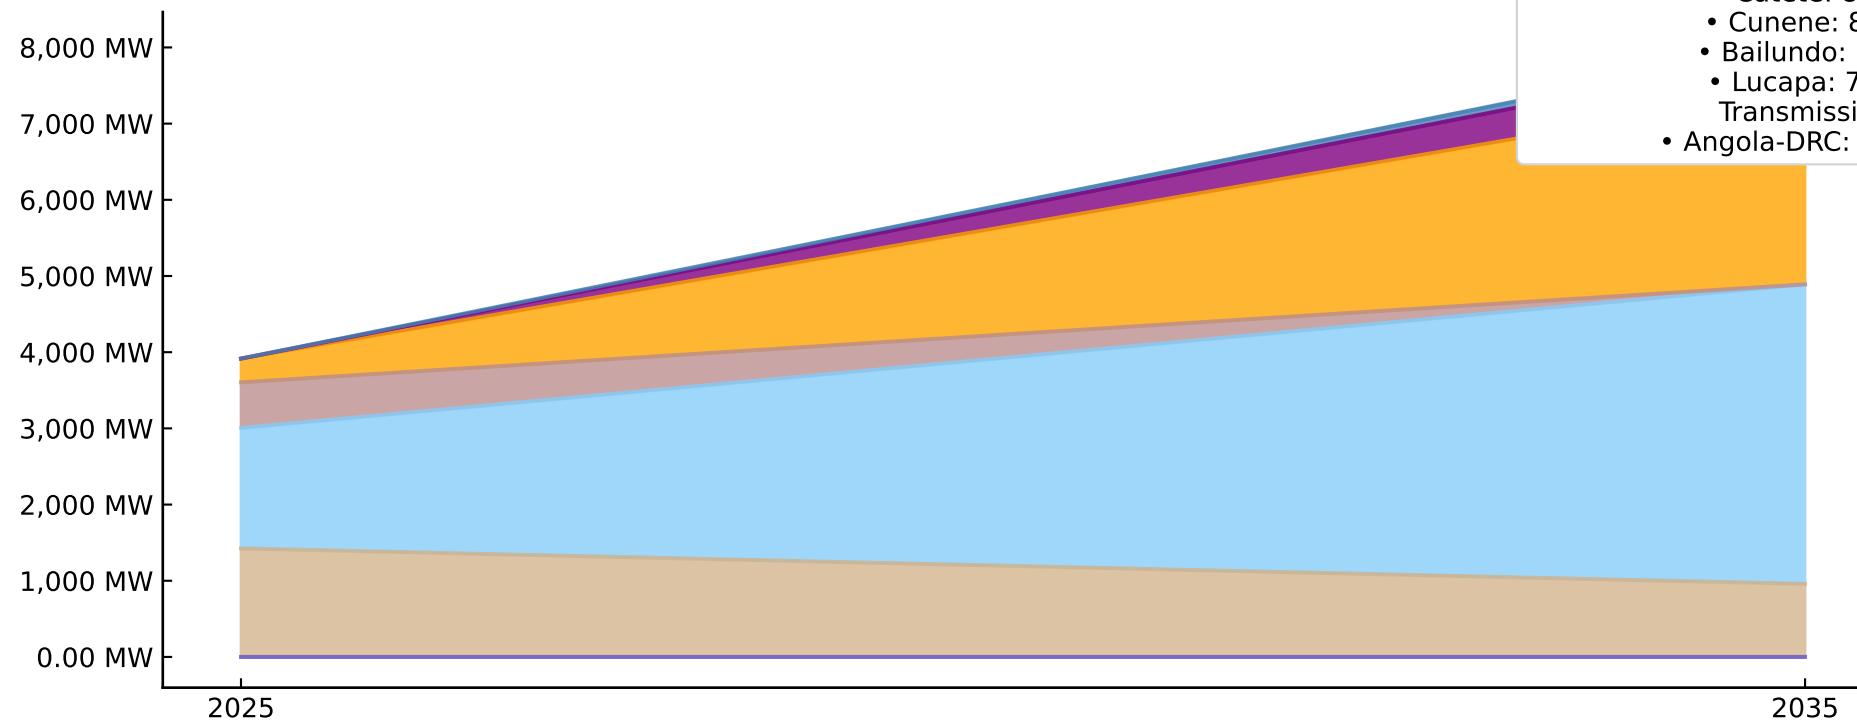

Battery Storage
Gas
Hydro
Oil
Solar
Transmission
Wind