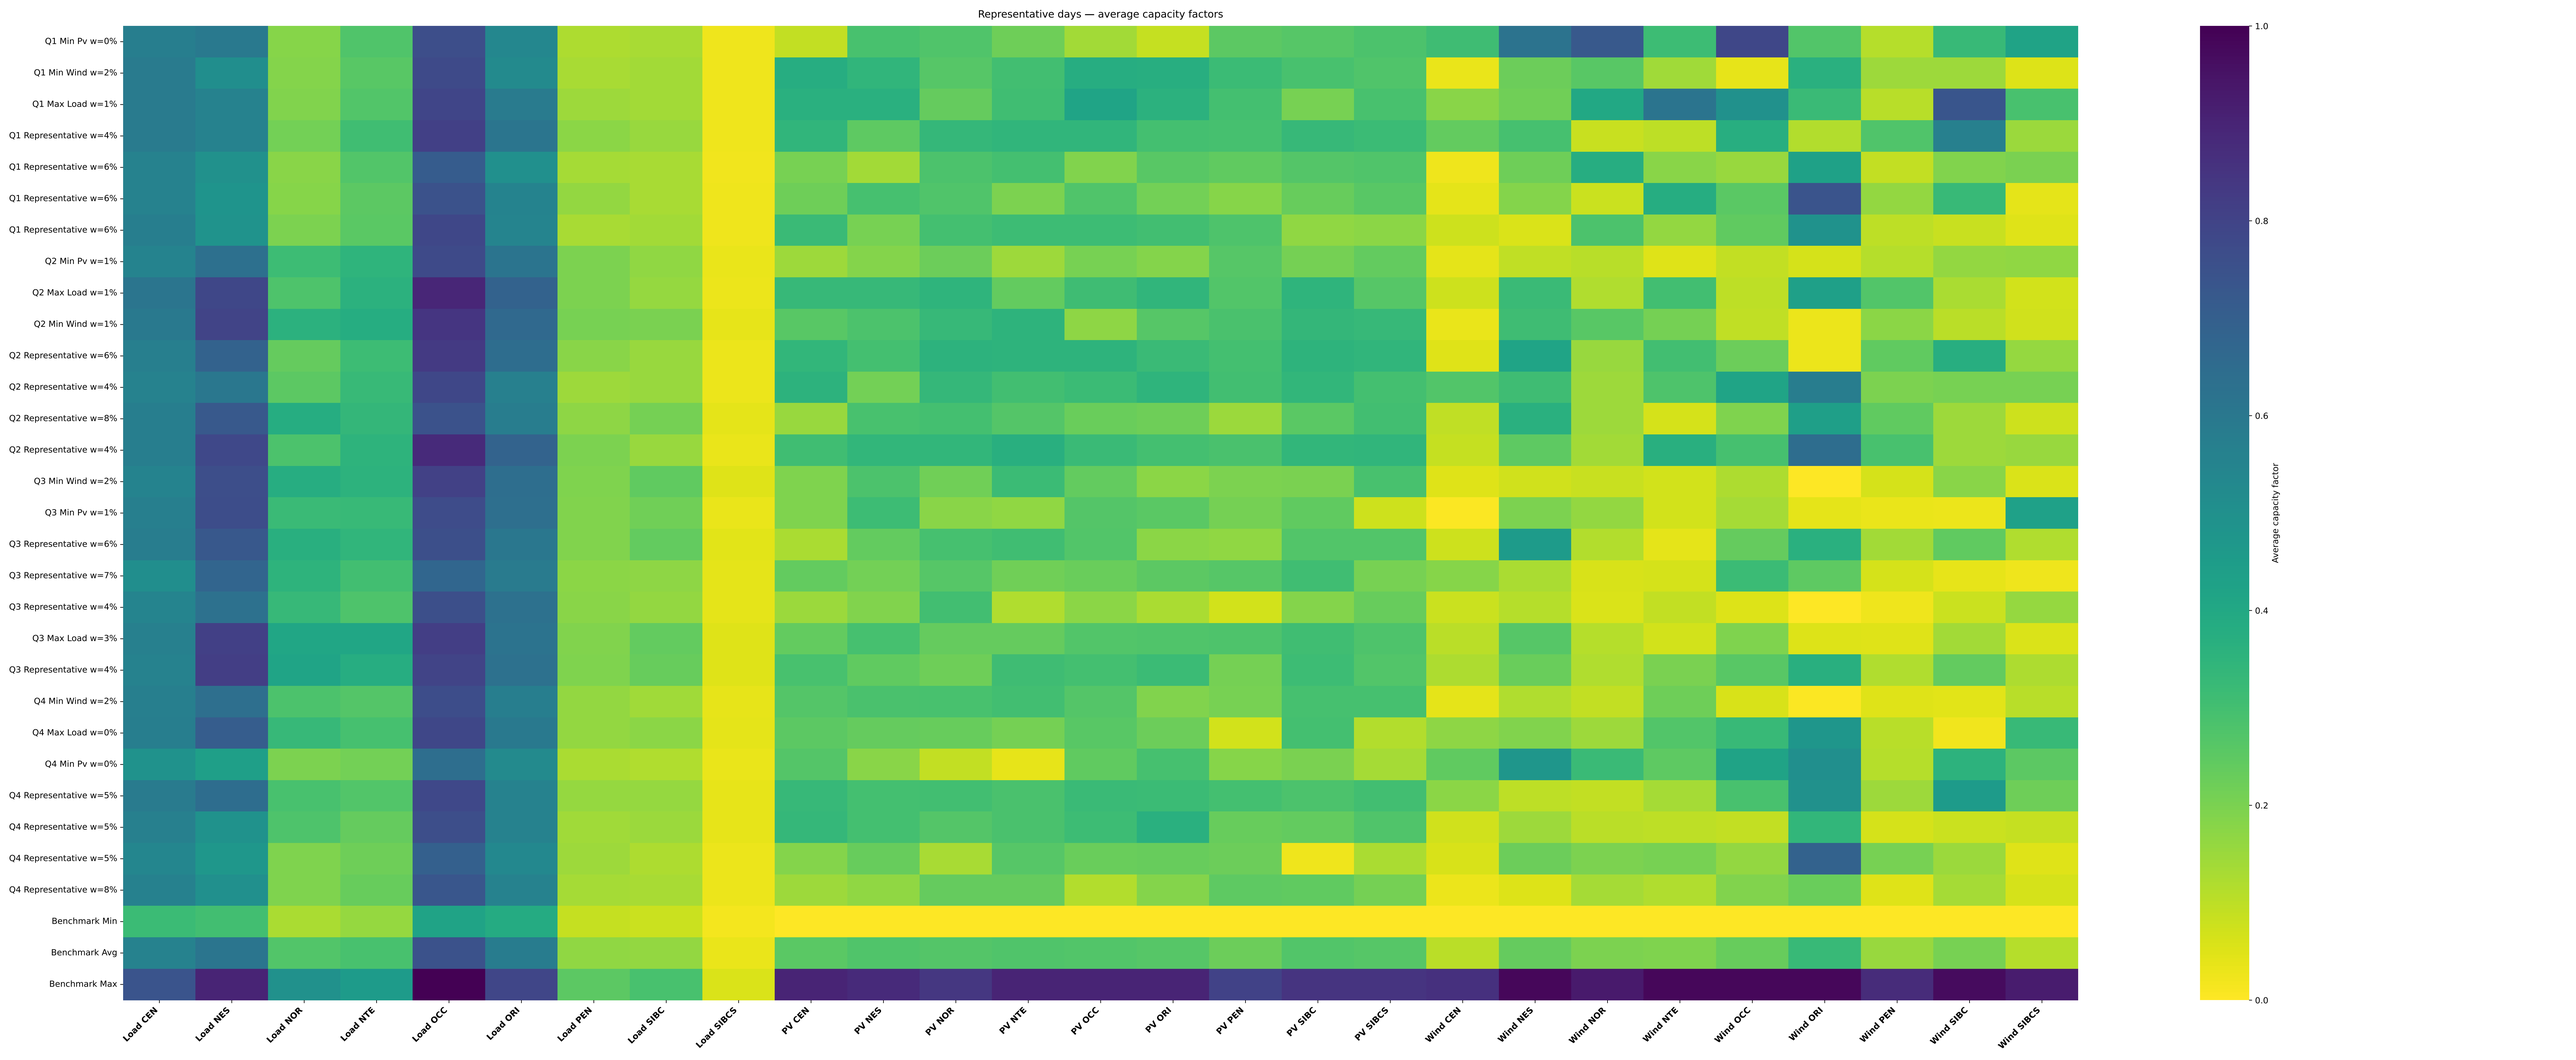
Representative days — average capacity factors
Q1 Min Pv w=0%
Q1 Min Wind w=2%
Q1 Max Load w=1%
Q1 Representative w=4%
Q1 Representative w=6%
Q1 Representative w=6%
Q1 Representative w=6%
Q2 Min Pv w=1%
Q2 Max Load w=1%
Q2 Min Wind w=1%
Q2 Representative w=6%
Q2 Representative w=4%
Q2 Representative w=8%
Q2 Representative w=4%
Q3 Min Wind w=2%
Q3 Min Pv w=1%
Q3 Representative w=6%
Q3 Representative w=7%
Q3 Representative w=4%
Q3 Max Load w=3%
Q3 Representative w=4%
Q4 Min Wind w=2%
Q4 Max Load w=0%
Q4 Min Pv w=0%
Q4 Representative w=5%
Q4 Representative w=5%
Q4 Representative w=5%
Q4 Representative w=8%
Benchmark Min
Benchmark Avg
Benchmark Max
Load CEN
Load NES
Load NOR
Load NTE
Load OCC
Load ORI
Load PEN
Load SIBC
Load SIBCS
PV CEN
PV NES
PV NOR
PV NTE
PV OCC
PV ORI
PV PEN
PV SIBC
PV SIBCS
Wind CEN
Wind NES
Wind NOR
Wind NTE
Wind OCC
Wind ORI
Wind PEN
Wind SIBC
Wind SIBCS
Average capacity factor
1.0
0.8
0.6
0.4
0.2
0.0