




Workflow in v1.4.0 (and earlier)

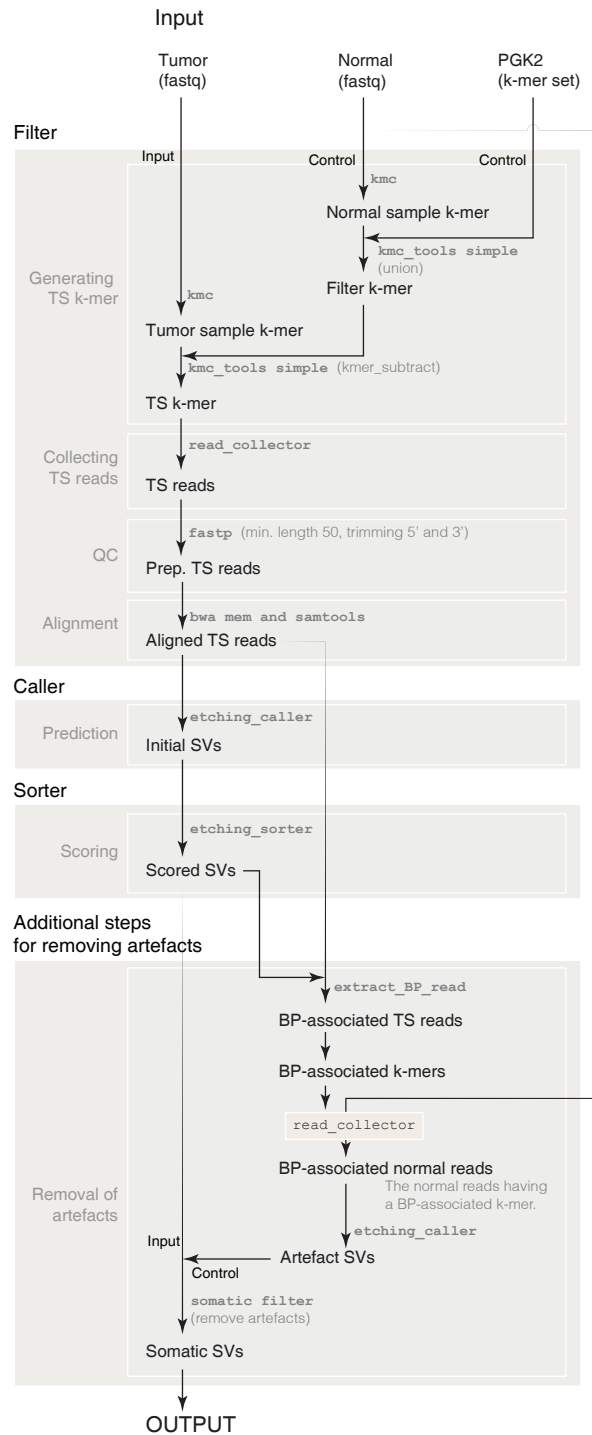

Revised workflow in v1.4.2

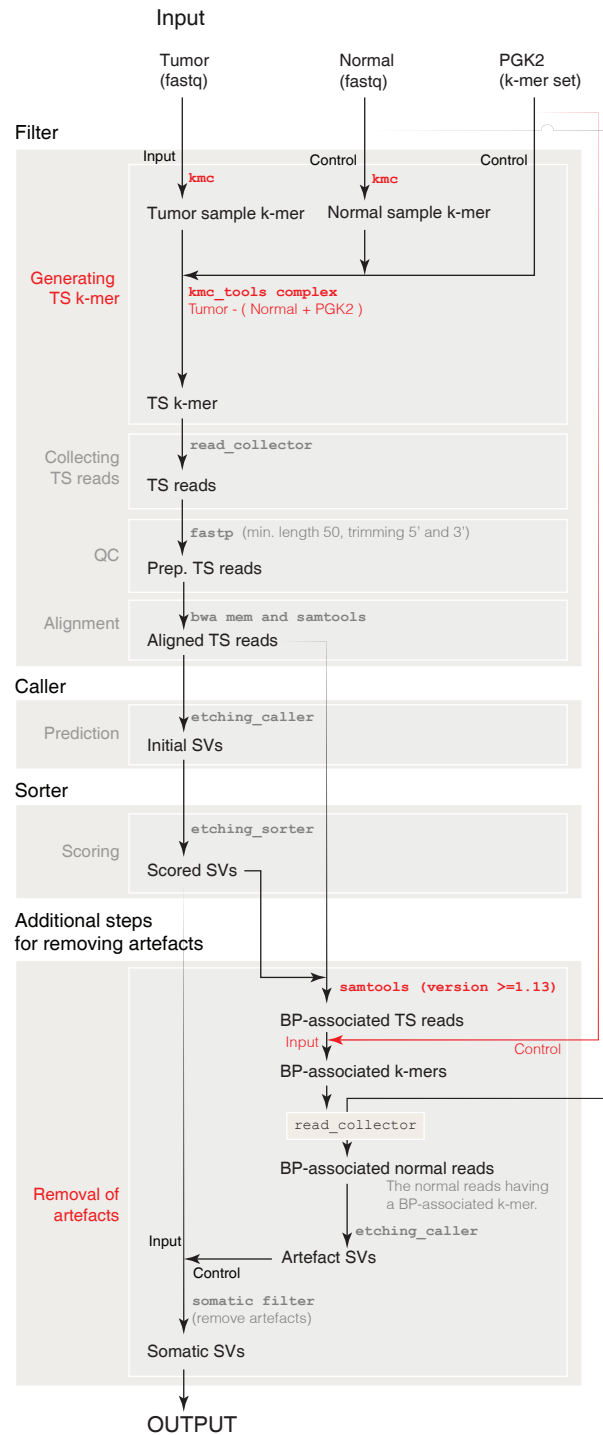

BAM input (CRAM support) in v1.4.2

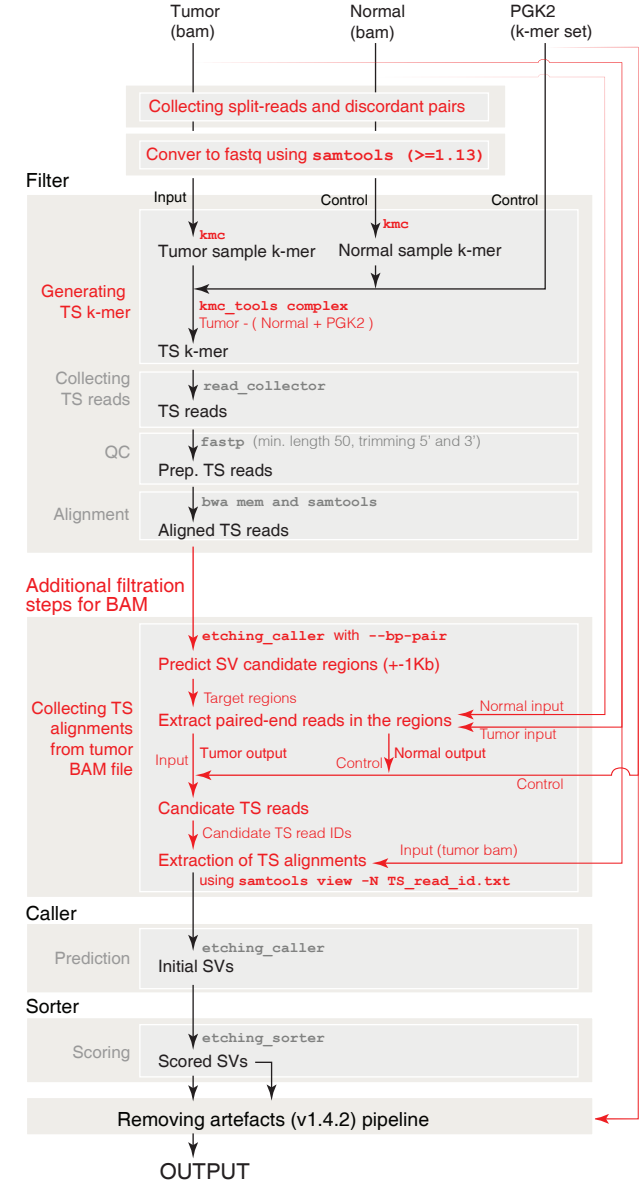

* Note: TS refers to tumor-specific.