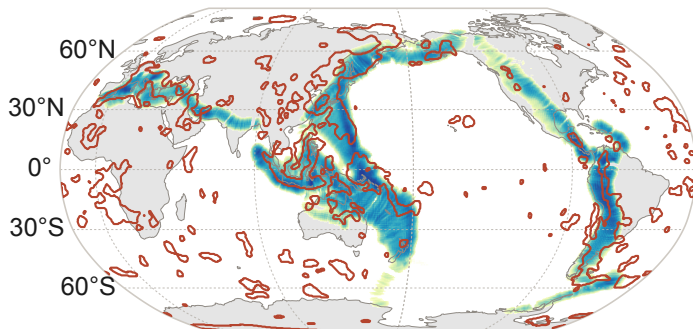
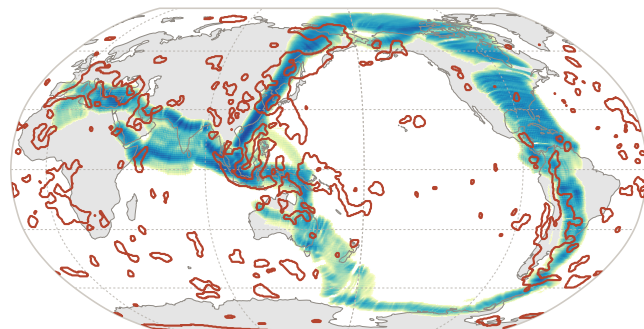


a 8–50 Ma


5% of the water

**b 50–100 Ma**



6% of the water

**c 100–200 Ma**

30% of the water

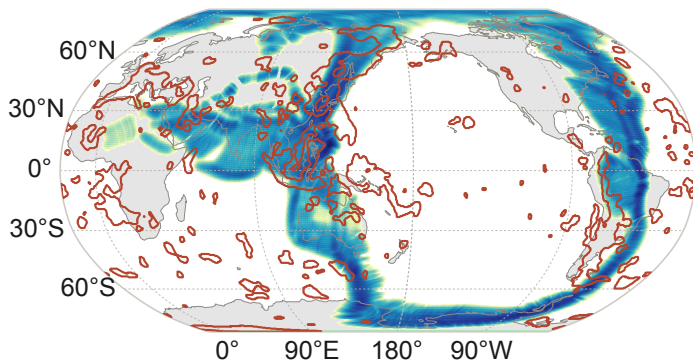**d 200–400 Ma**

59% of the water

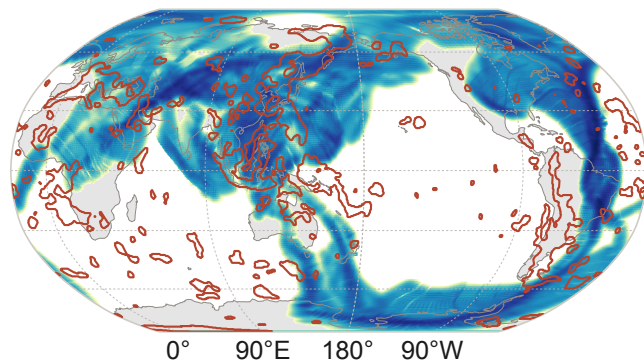

Water delivered to the transition zone (per cent of the maximum)

— Observed fast transition zone