
1000 Clogging trajectories - HL at  $z_{max}$ .

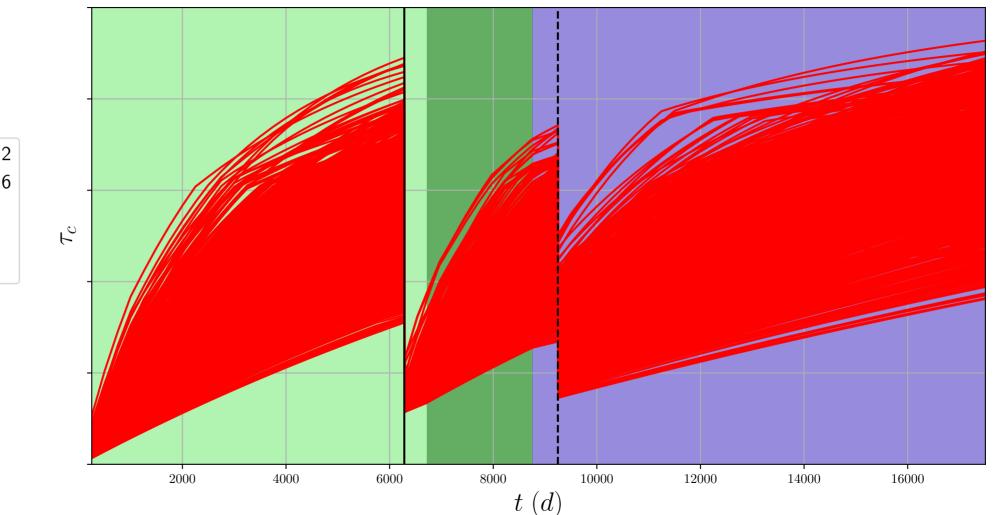

Morpholine, pH= 9.2

Morpholine, pH= 9.6

ETA, pH= 9.6

Curative cleaning

Preventive cleaning