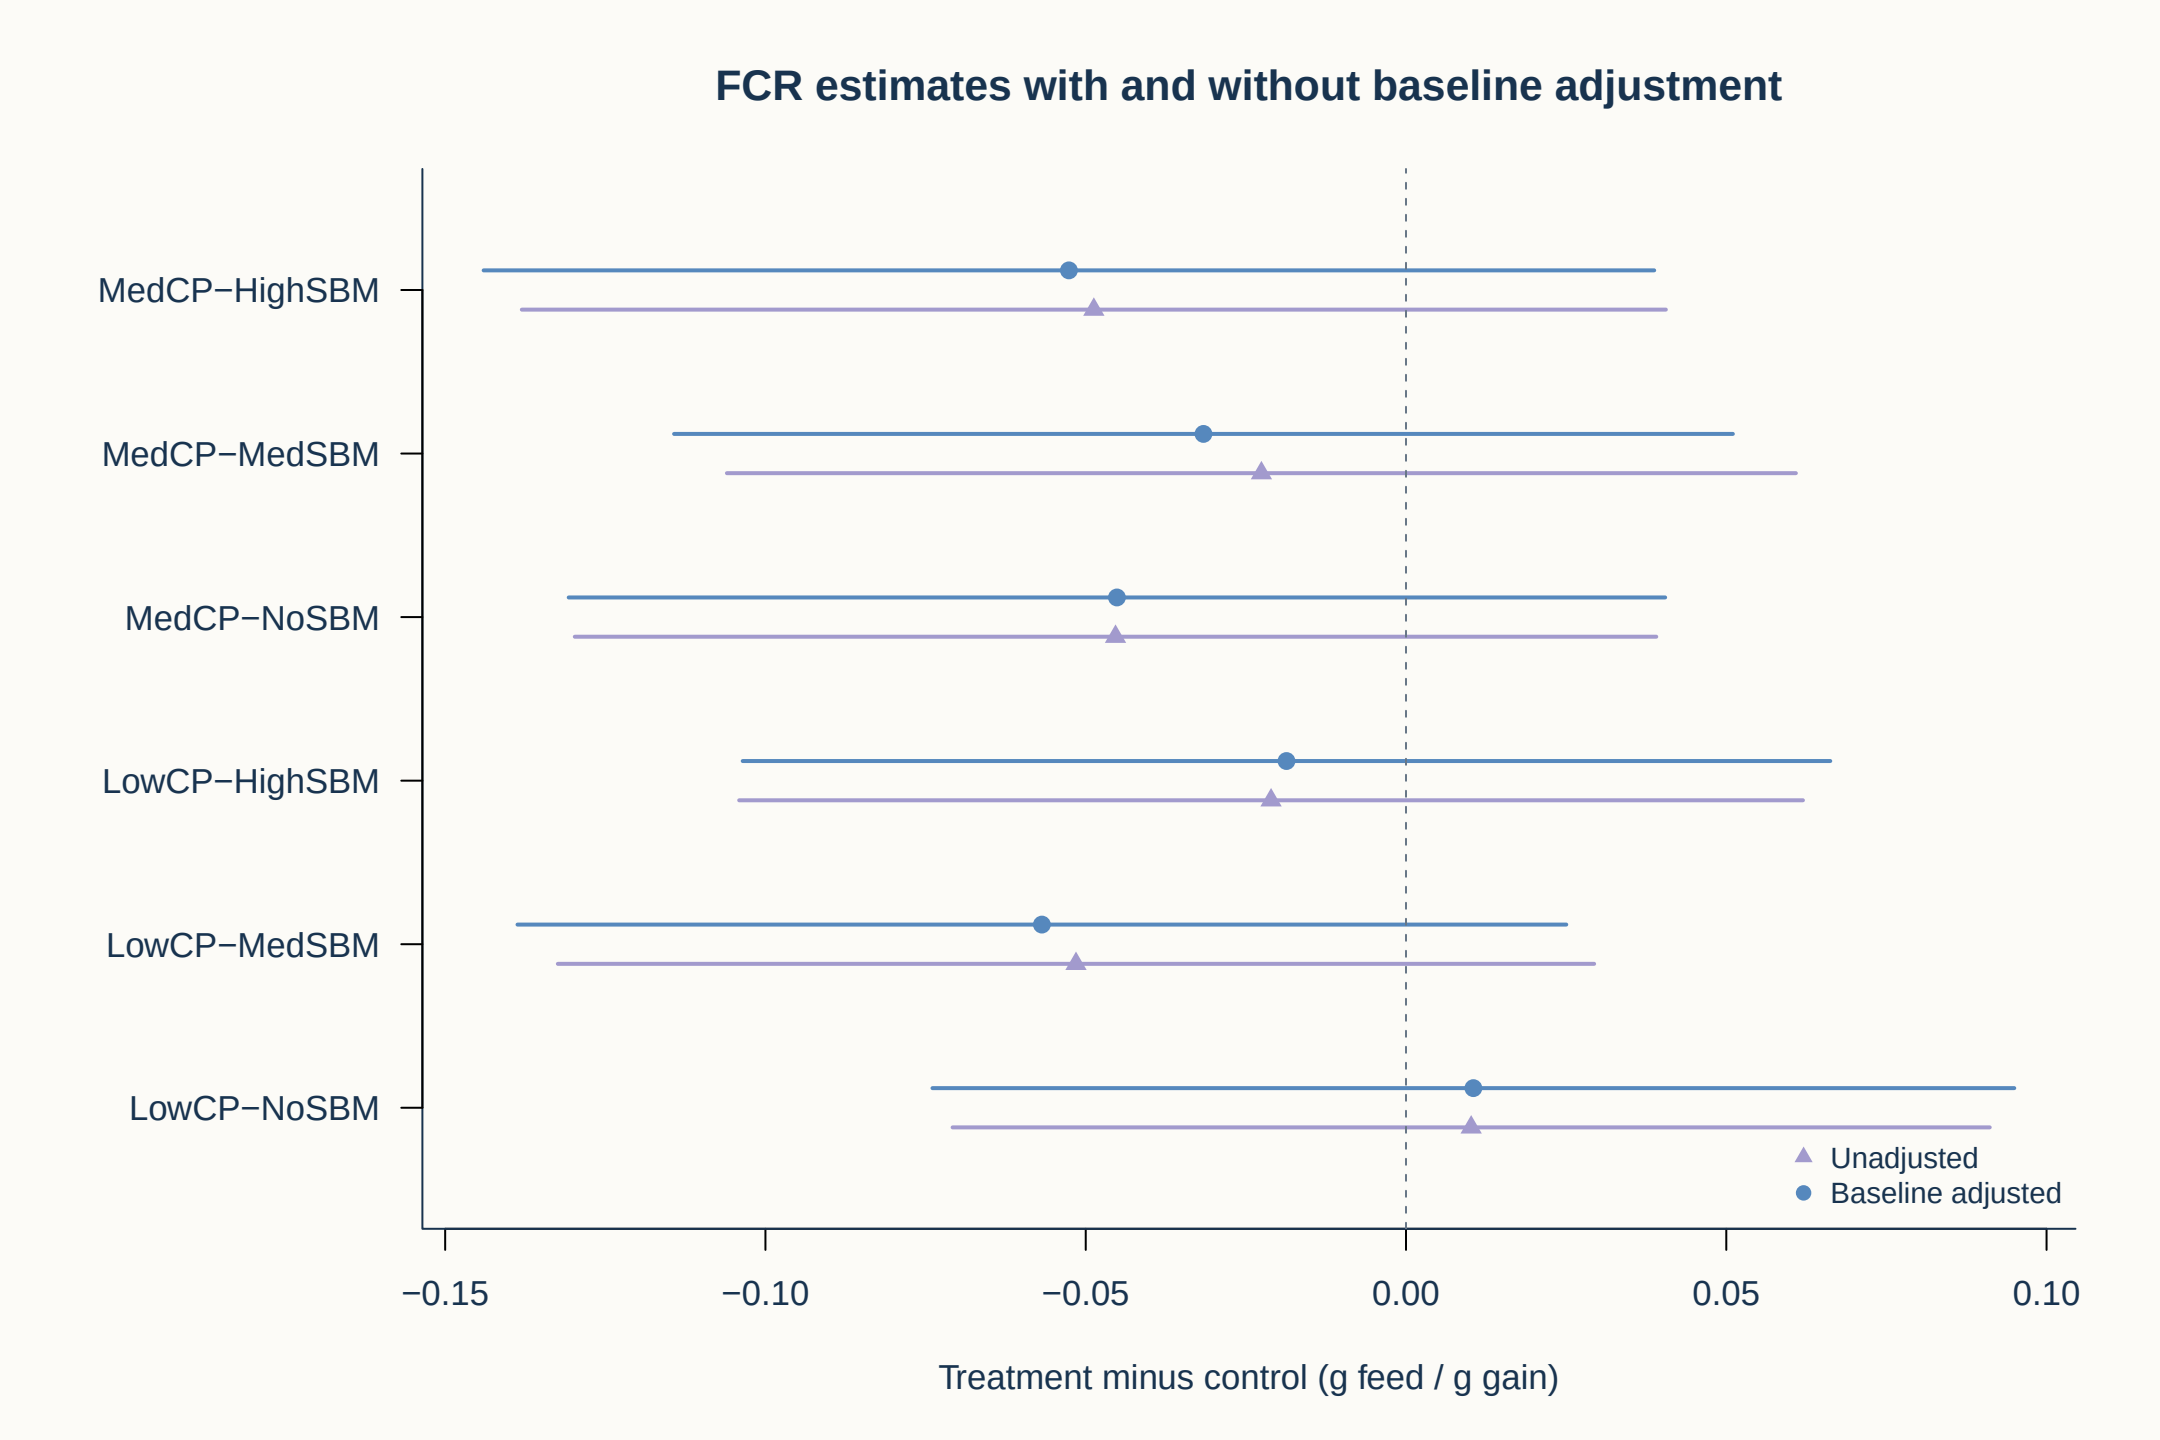
FCR estimates with and without baseline adjustment
MedCP−HighSBM
MedCP−MedSBM
MedCP−NoSBM
LowCP−HighSBM
LowCP−MedSBM
LowCP−NoSBM
Unadjusted
Baseline adjusted
−0.15
−0.10
−0.05
0.00
0.05
0.10
Treatment minus control (g feed / g gain)