



Subtype pipeline: error towers - row-normalised confusion without the diagonal (summed over held-out magnifications and seeds; LOMO, image-level split)


MagScan-Mamba
largest: LC -> DC (38%)

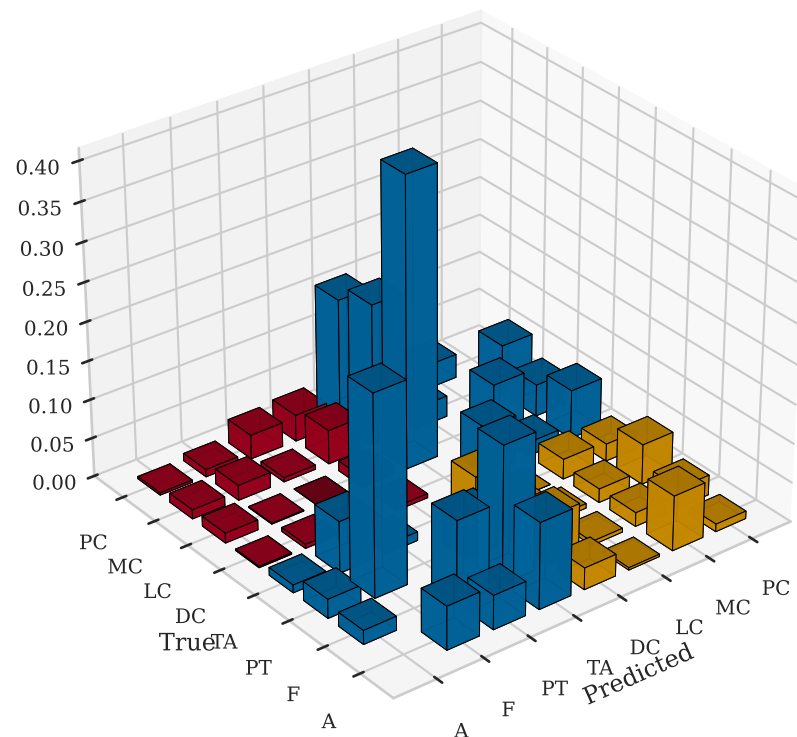


Phikon (frozen FM)
largest: LC -> DC (38%)

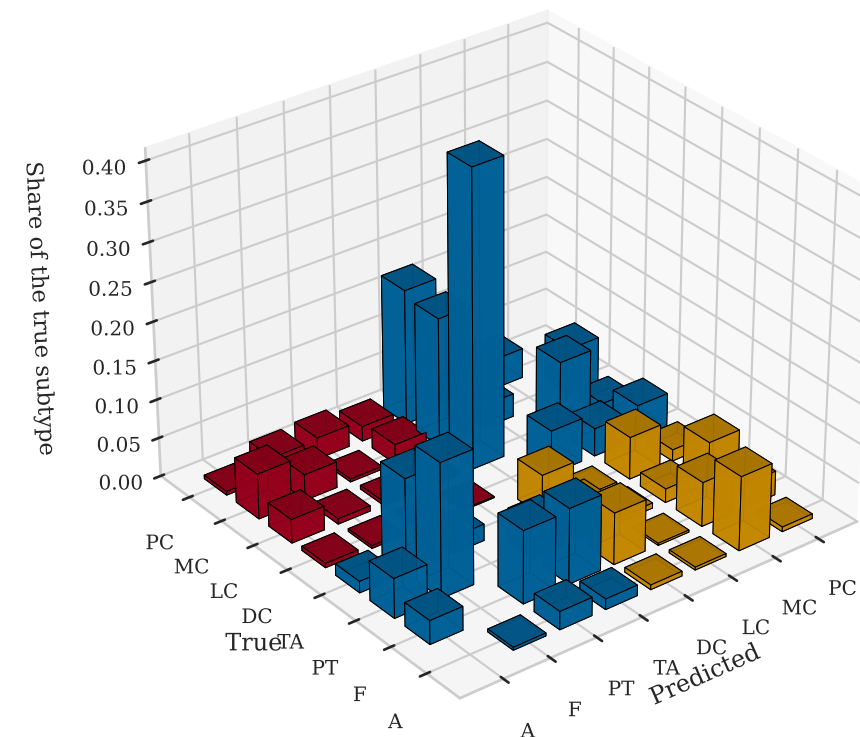


ConvNeXt-T
largest: PT -> F (37%)

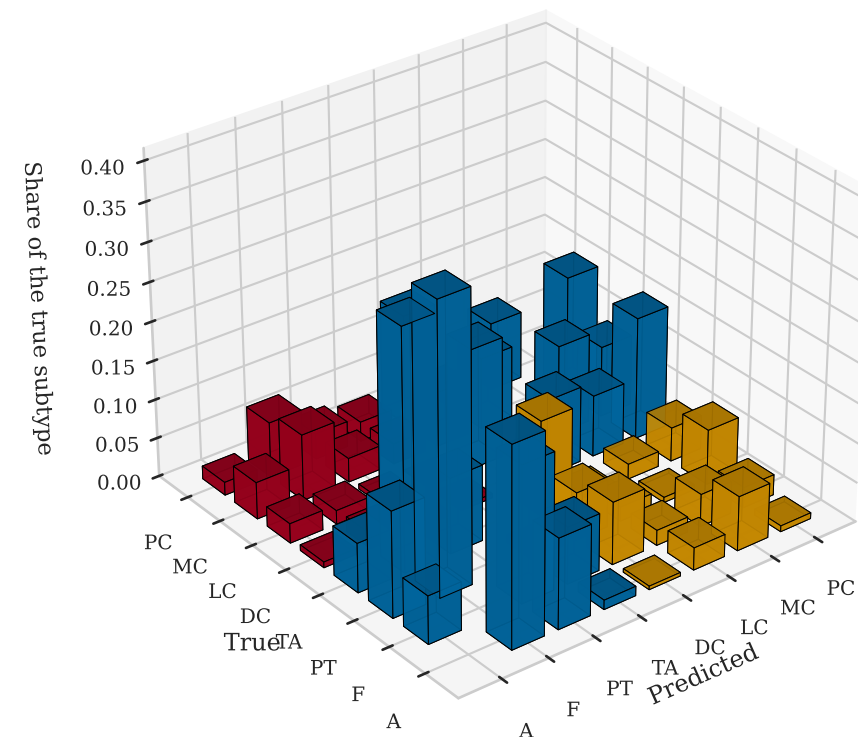

Swin-T
largest: PC -> MC (17%)

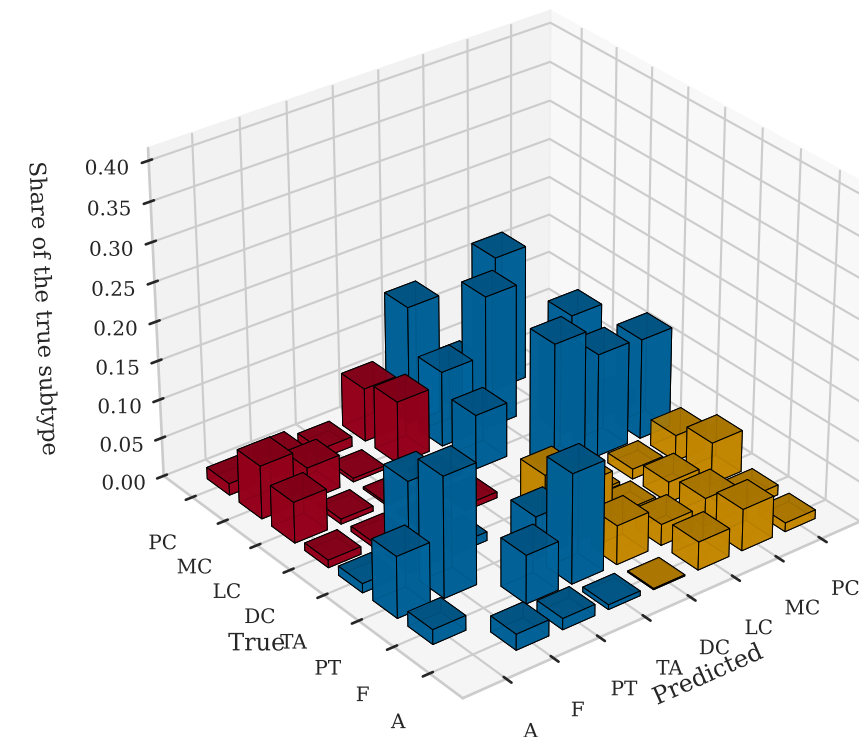

MedMamba
largest: PT -> F (21%)

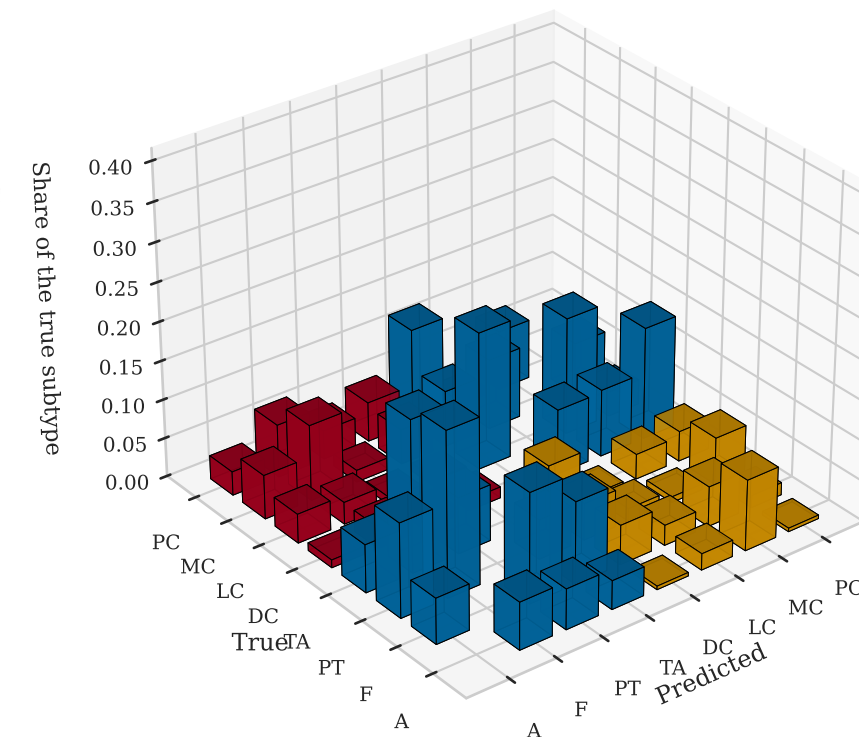

missed cancer (malignant -> benign branch) false alarm (benign -> malignant branch) wrong subtype in the right branch