
3D analytic verification: non-lifting ellipsoid

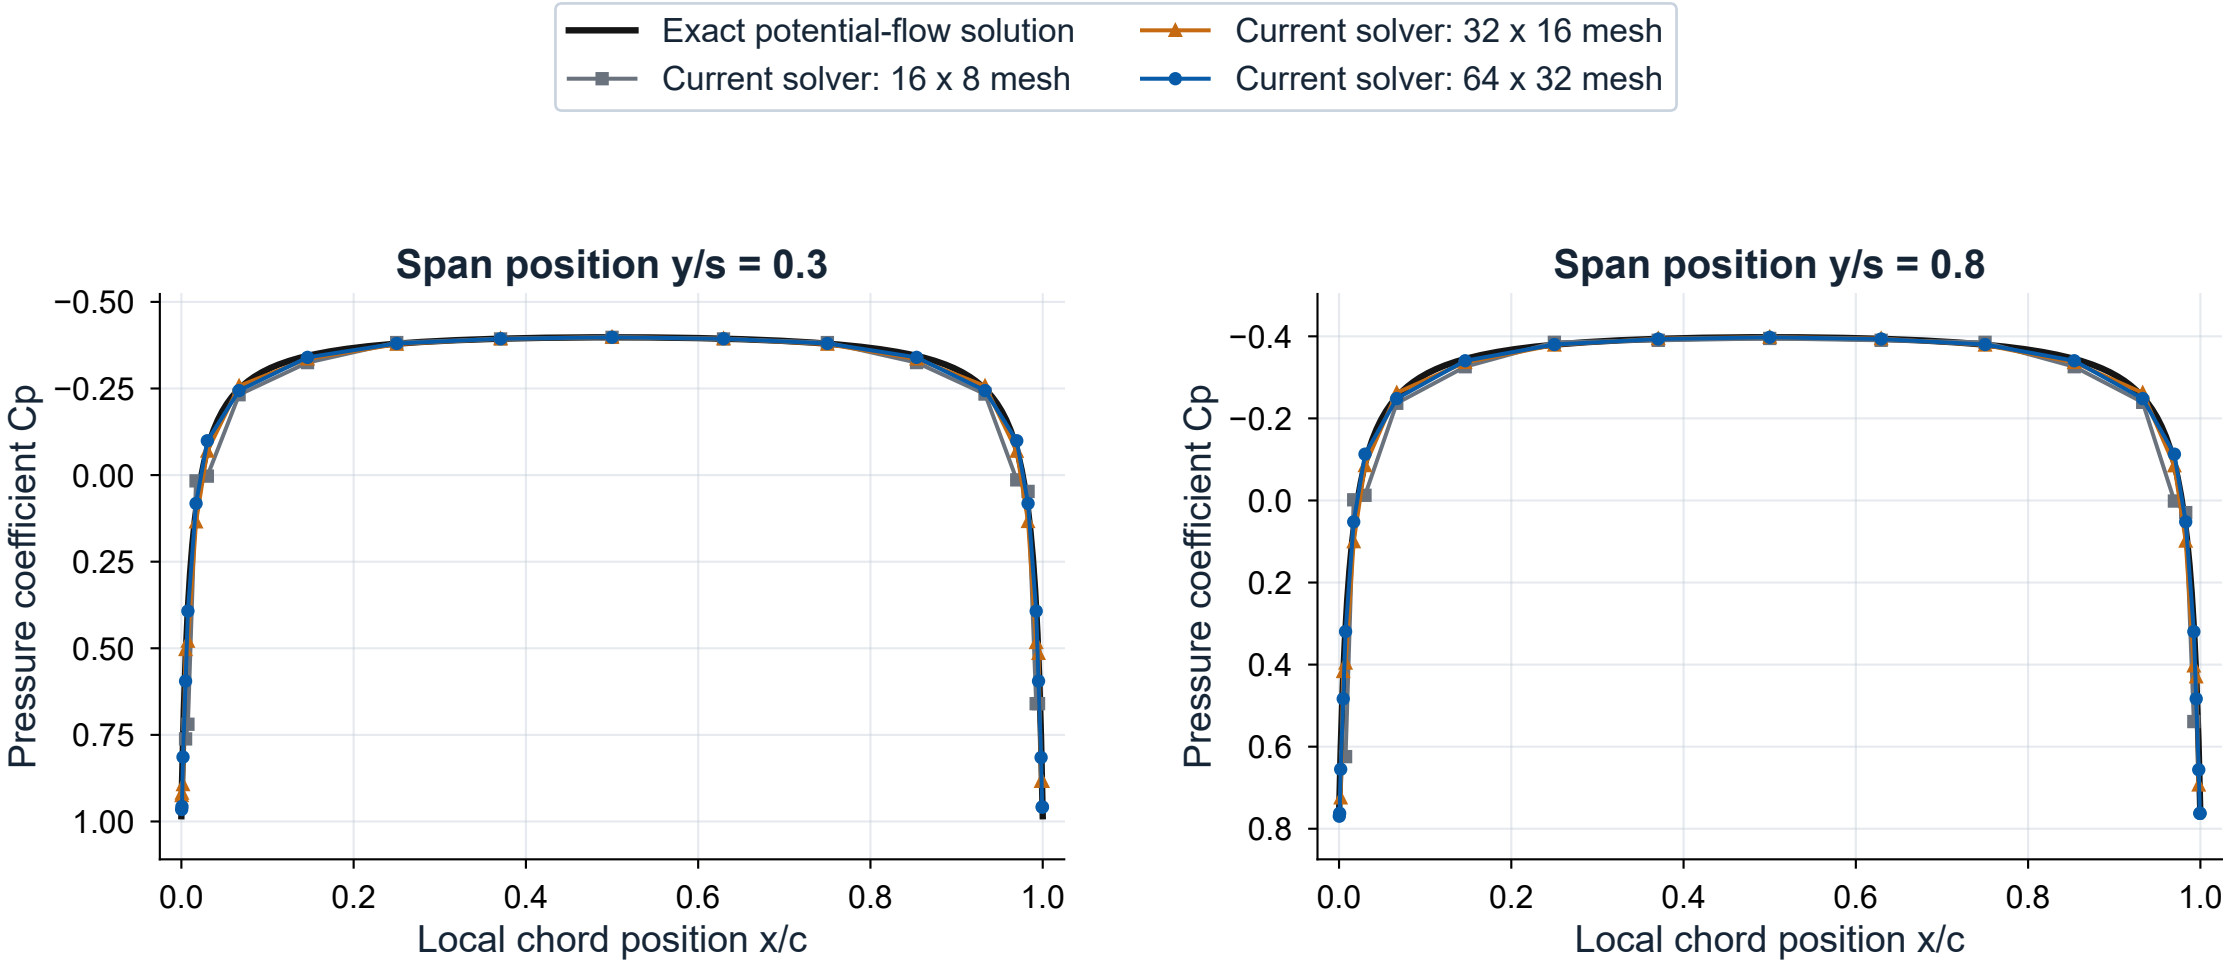

Semi-axes 100 : 300 : 20 mm; zero incidence. Mesh = chord x span. Negative Cp is upward.
Common-position RMS error: 0.1271 -> 0.03860 -> 0.02103. Missing samples remain gaps.
This tests a non-lifting 3D body; it does not validate the lifting-wing tip/wake corner.