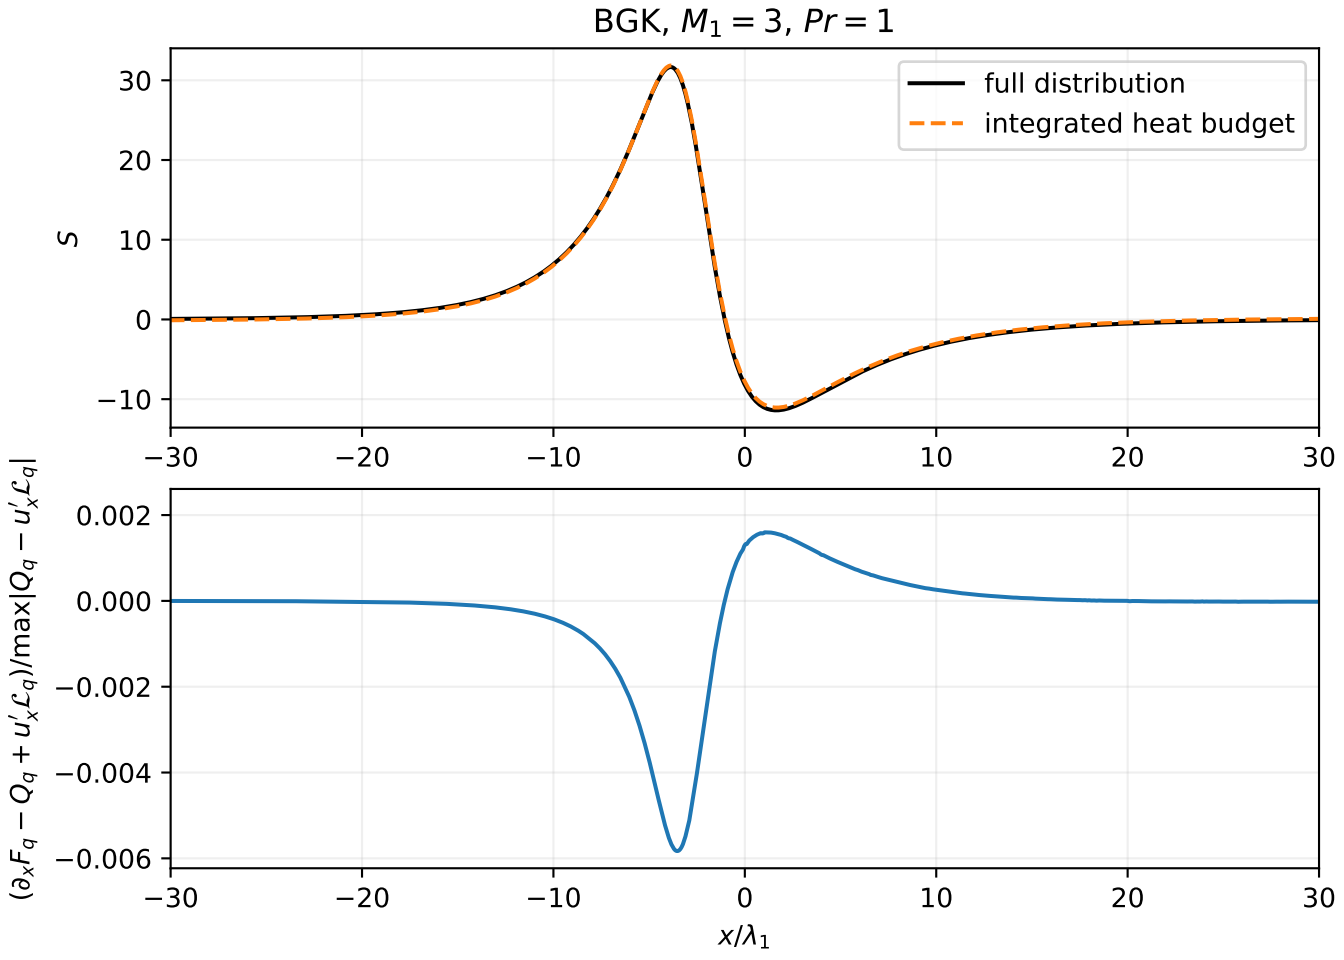
BGK, $M_1 = 3$, $Pr = 1$
full distribution
integrated heat budget
S
$(\partial_x F_q - Q_q + u_x' \mathcal{L}_q)/\max|Q_q - u_x' \mathcal{L}_q|$
x/λ_1