


Executed HS--NTC solver versus Mohammadzadeh DSMC wall pressure

(a) Direct solver validation: $Re = 1.5$, $Kn = 0.1$, $Ma = 0.09$



(b) Pointwise difference from published DSMC markers

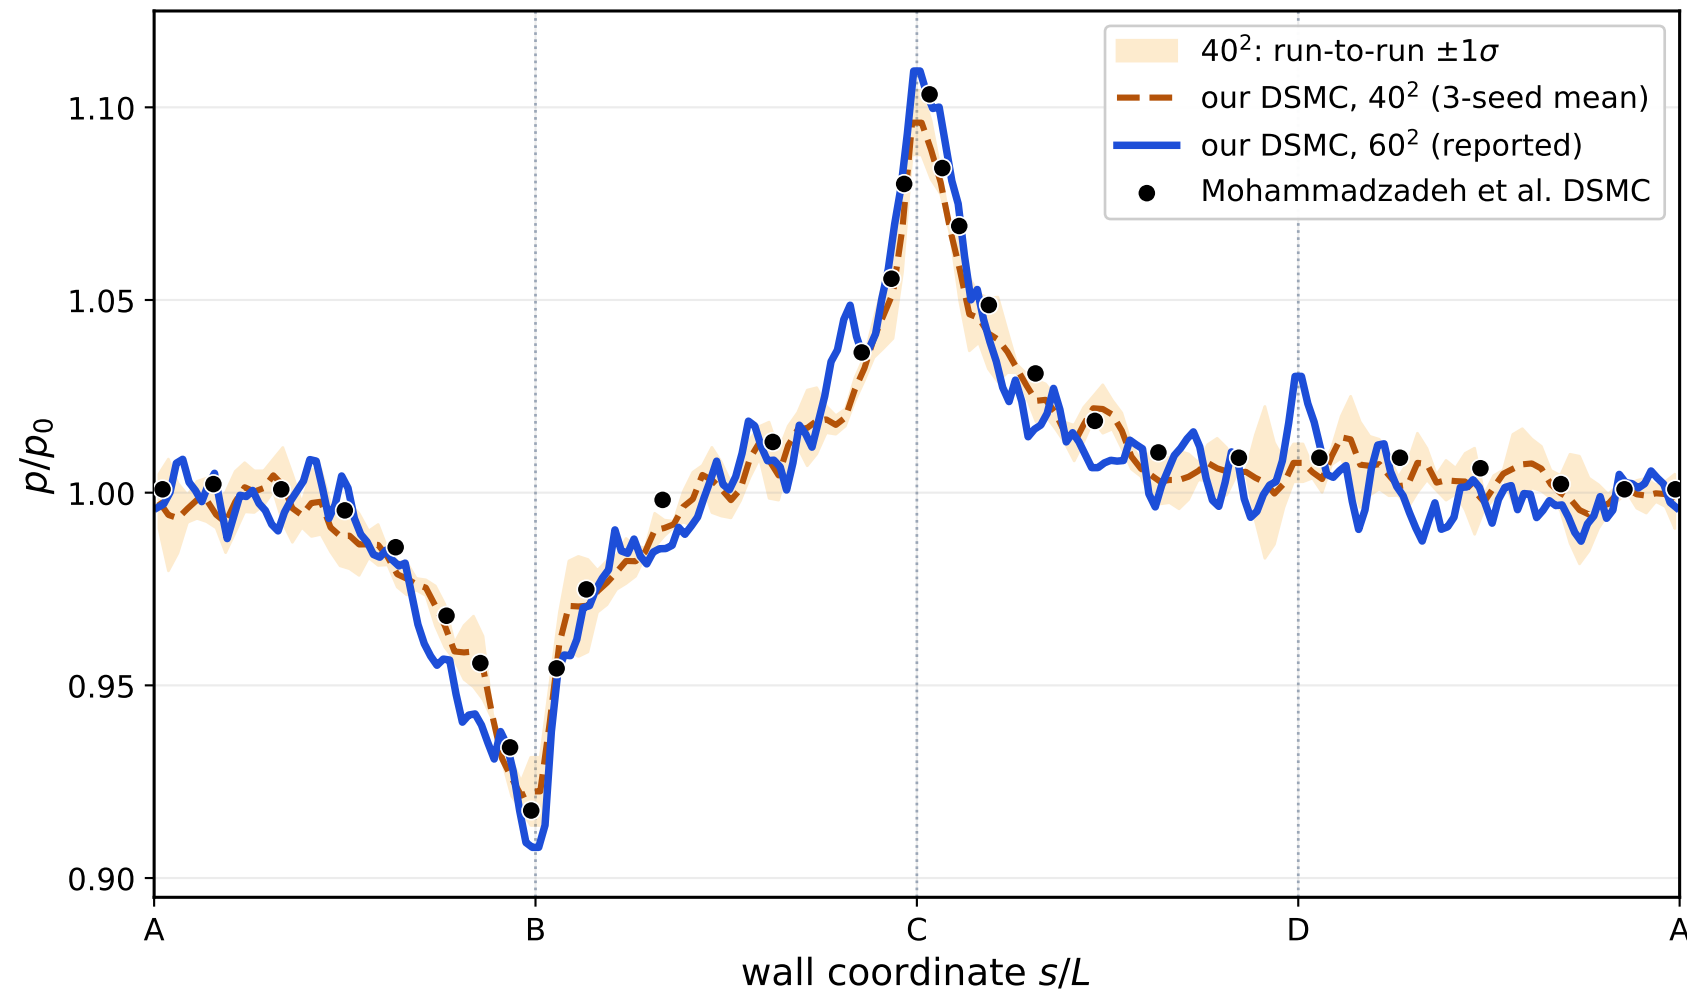