


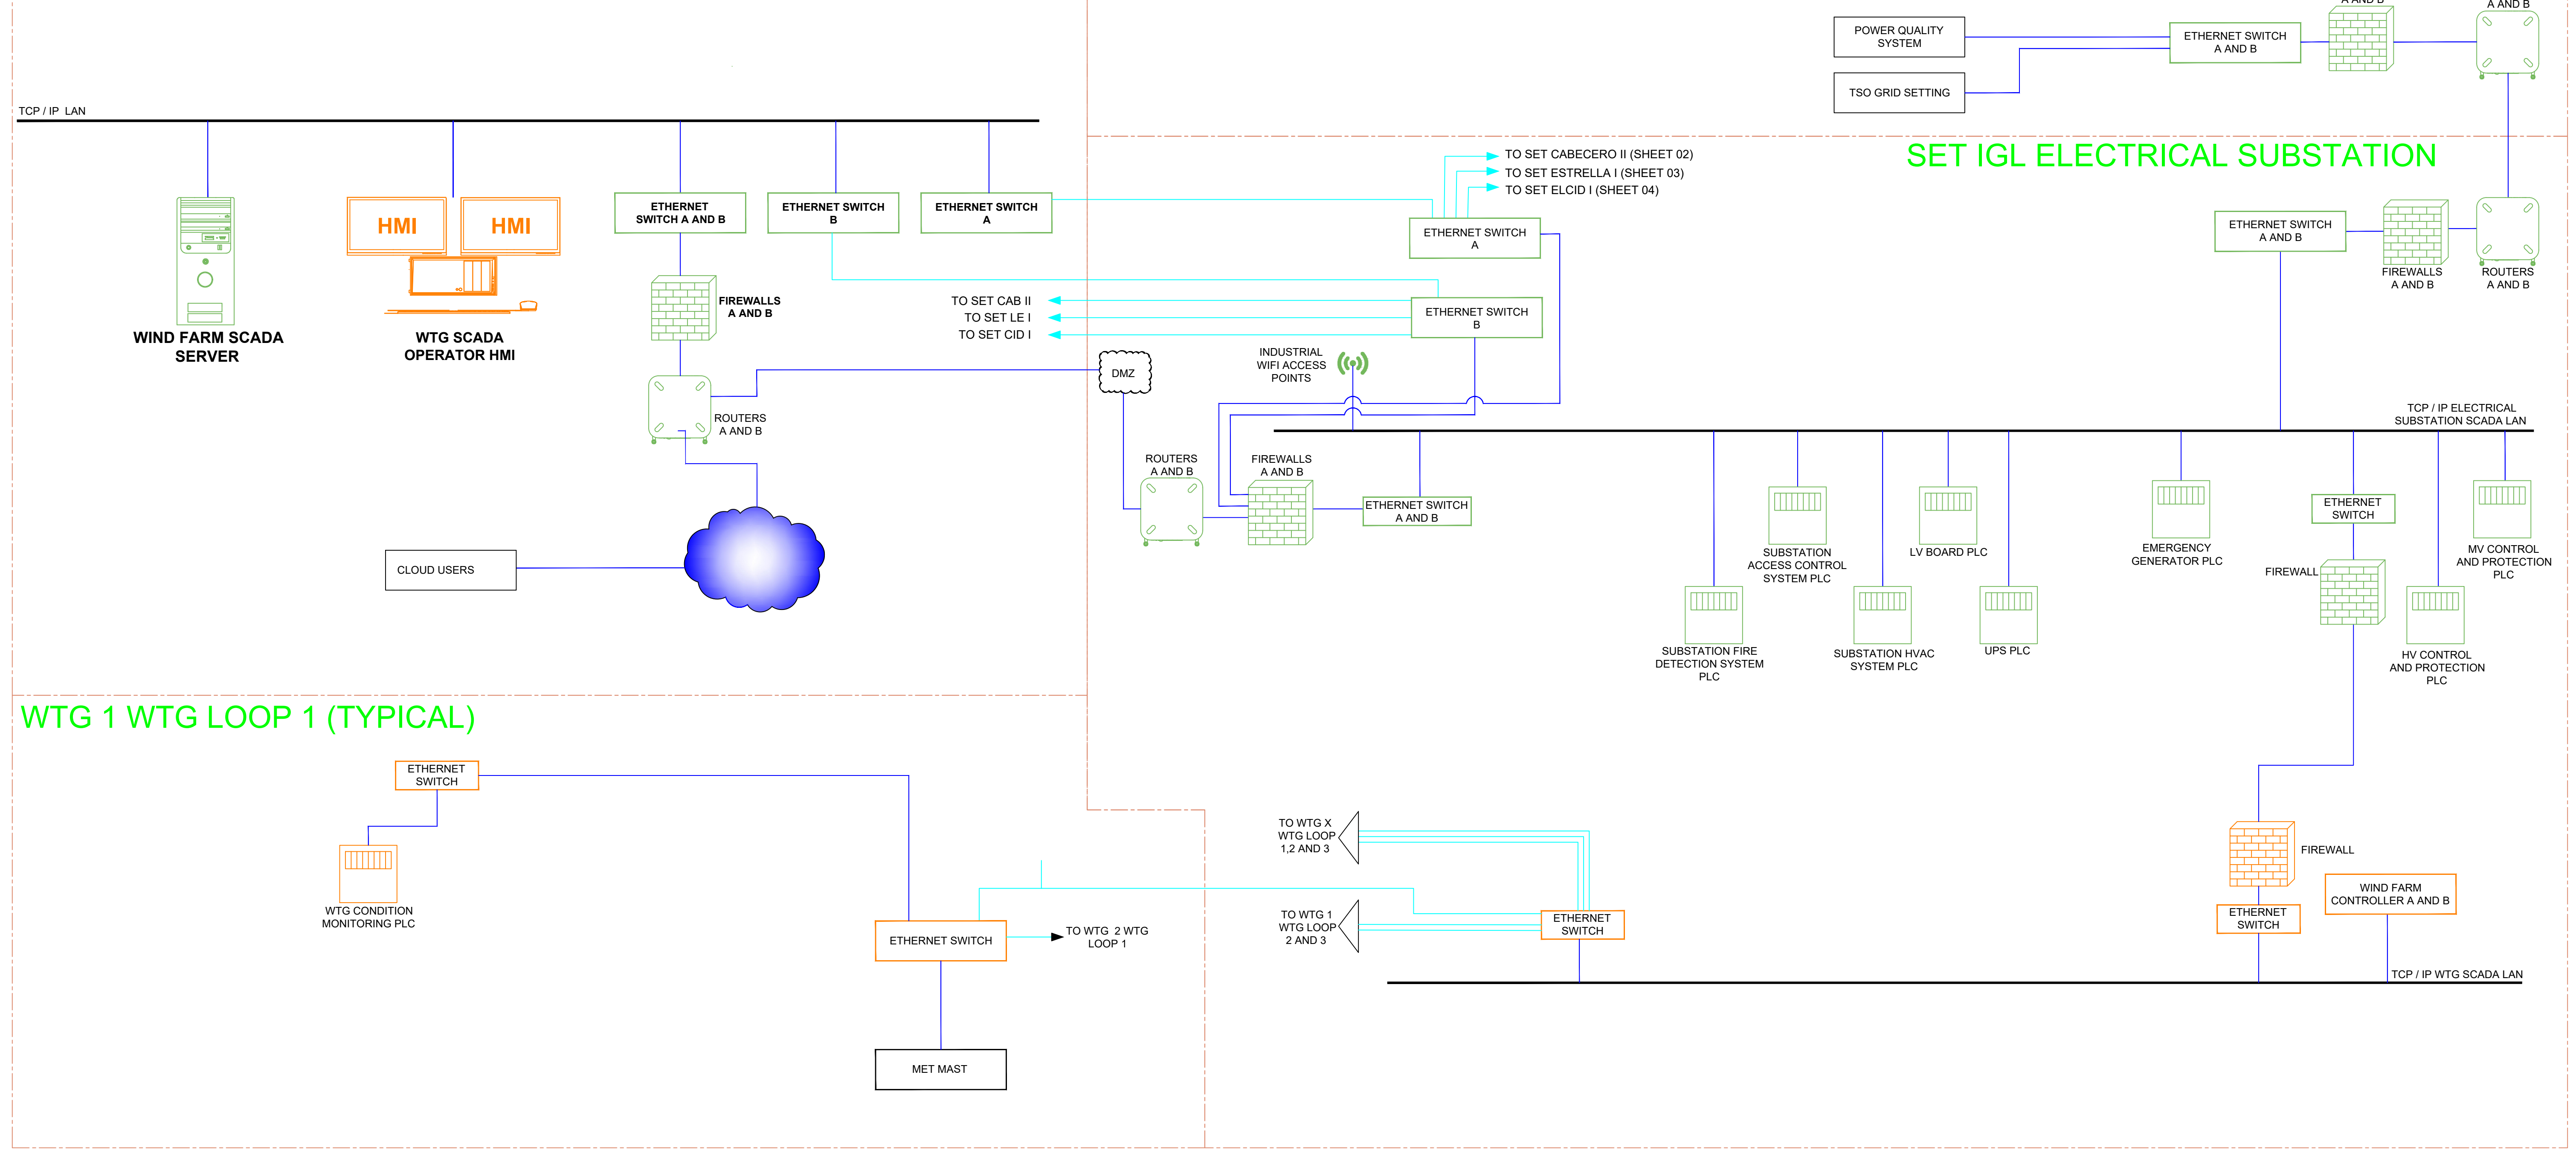

HMI

SERVER

DATABASE

ROUTER

PRINTER

CLOCK/ CCTV NETWORK SERVER

VoIP PHONES

FIREWALL

VPN INTERNET

PLC

WIFI ACCESS POINTS

CCTV SYSTEM

UTP NETWORK CABLE

FIBER OPTIC CABLE

HUMAN MACHINE INTERFACE

CLOSED CIRCUIT TELEVISION

PROGRAMMABLE LOGIC CONTROLLER

UNINTERRUPTIBLE POWER SUPPLY

VIRTUAL PRIVATE NETWORK

WIND TURBINE GENERATOR

VOICE OVERALL IP

LOW VOLTAGE

MEDIUM VOLTAGE

HIGH VOLTAGE

TRANSMISSION CONTROL PROTOCOL

INTERNET PROTOCOL

HEATING VENTILATION AND AIR CONDITION

NETWORK TIME PROTOCOL

DEMILITARIZED ZONE

OPERATIONAL TECHNOLOGY

INTERNET SERVICE PROVIDER

WTG SCADA SUPPLIER

ELECTRICAL SUBSTATION SET IGL CONTRACTOR

ABBREVIATIONS:

HMI - HUMAN MACHINE INTERFACE

VoIP - VOICE OVERALL IP

HVAC - HEATING VENTILATION AND AIR CONDITION

CCTV - CLOSED CIRCUIT TELEVISION

LV - LOW VOLTAGE

NTP - NETWORK TIME PROTOCOL

PLC - PROGRAMMABLE LOGIC CONTROLLER

MV - MEDIUM VOLTAGE

DMZ - DEMILITARIZED ZONE

UPS - UNINTERRUPTIBLE POWER SUPPLY

HV - HIGH VOLTAGE

OT - OPERATIONAL TECHNOLOGY

VPN - VIRTUAL PRIVATE NETWORK

TCP - TRANSMISSION CONTROL PROTOCOL

ISP - INTERNET SERVICE PROVIDER

WTG - WIND TURBINE GENERATOR

IP - INTERNET PROTOCOL

NOTE:

1. ELECTRICAL SUBSTATION LAN WILL USE PARALLEL REDUNDANCY PROTOCOL.

SCOPE OF SUPPLY:

WTG SCADA SUPPLIER

ELECTRICAL SUBSTATION SET IGL CONTRACTOR

REV.

FOR INFORMATION

19.09.2024

SAK

SPA

A

FOR INFORMATION

23.05.2023

SAK

SPA

REV.

DESCRIPTION:

DATE:

DRAWN:

APPROVED:

CLIENT:

PROJECT:

TITLE:
CONTROL (SCADA) AND TELECOM SYSTEMS ARCHITECTURE -
SET IGL

SCALE: NTS

SIZE: A0

DRAWING NUMBER

DOC ID:

ID-NUMBER:

SHEET:

REV.

16

15

14

13

12

11

10

9

8

7

6

5

4

3

2

1