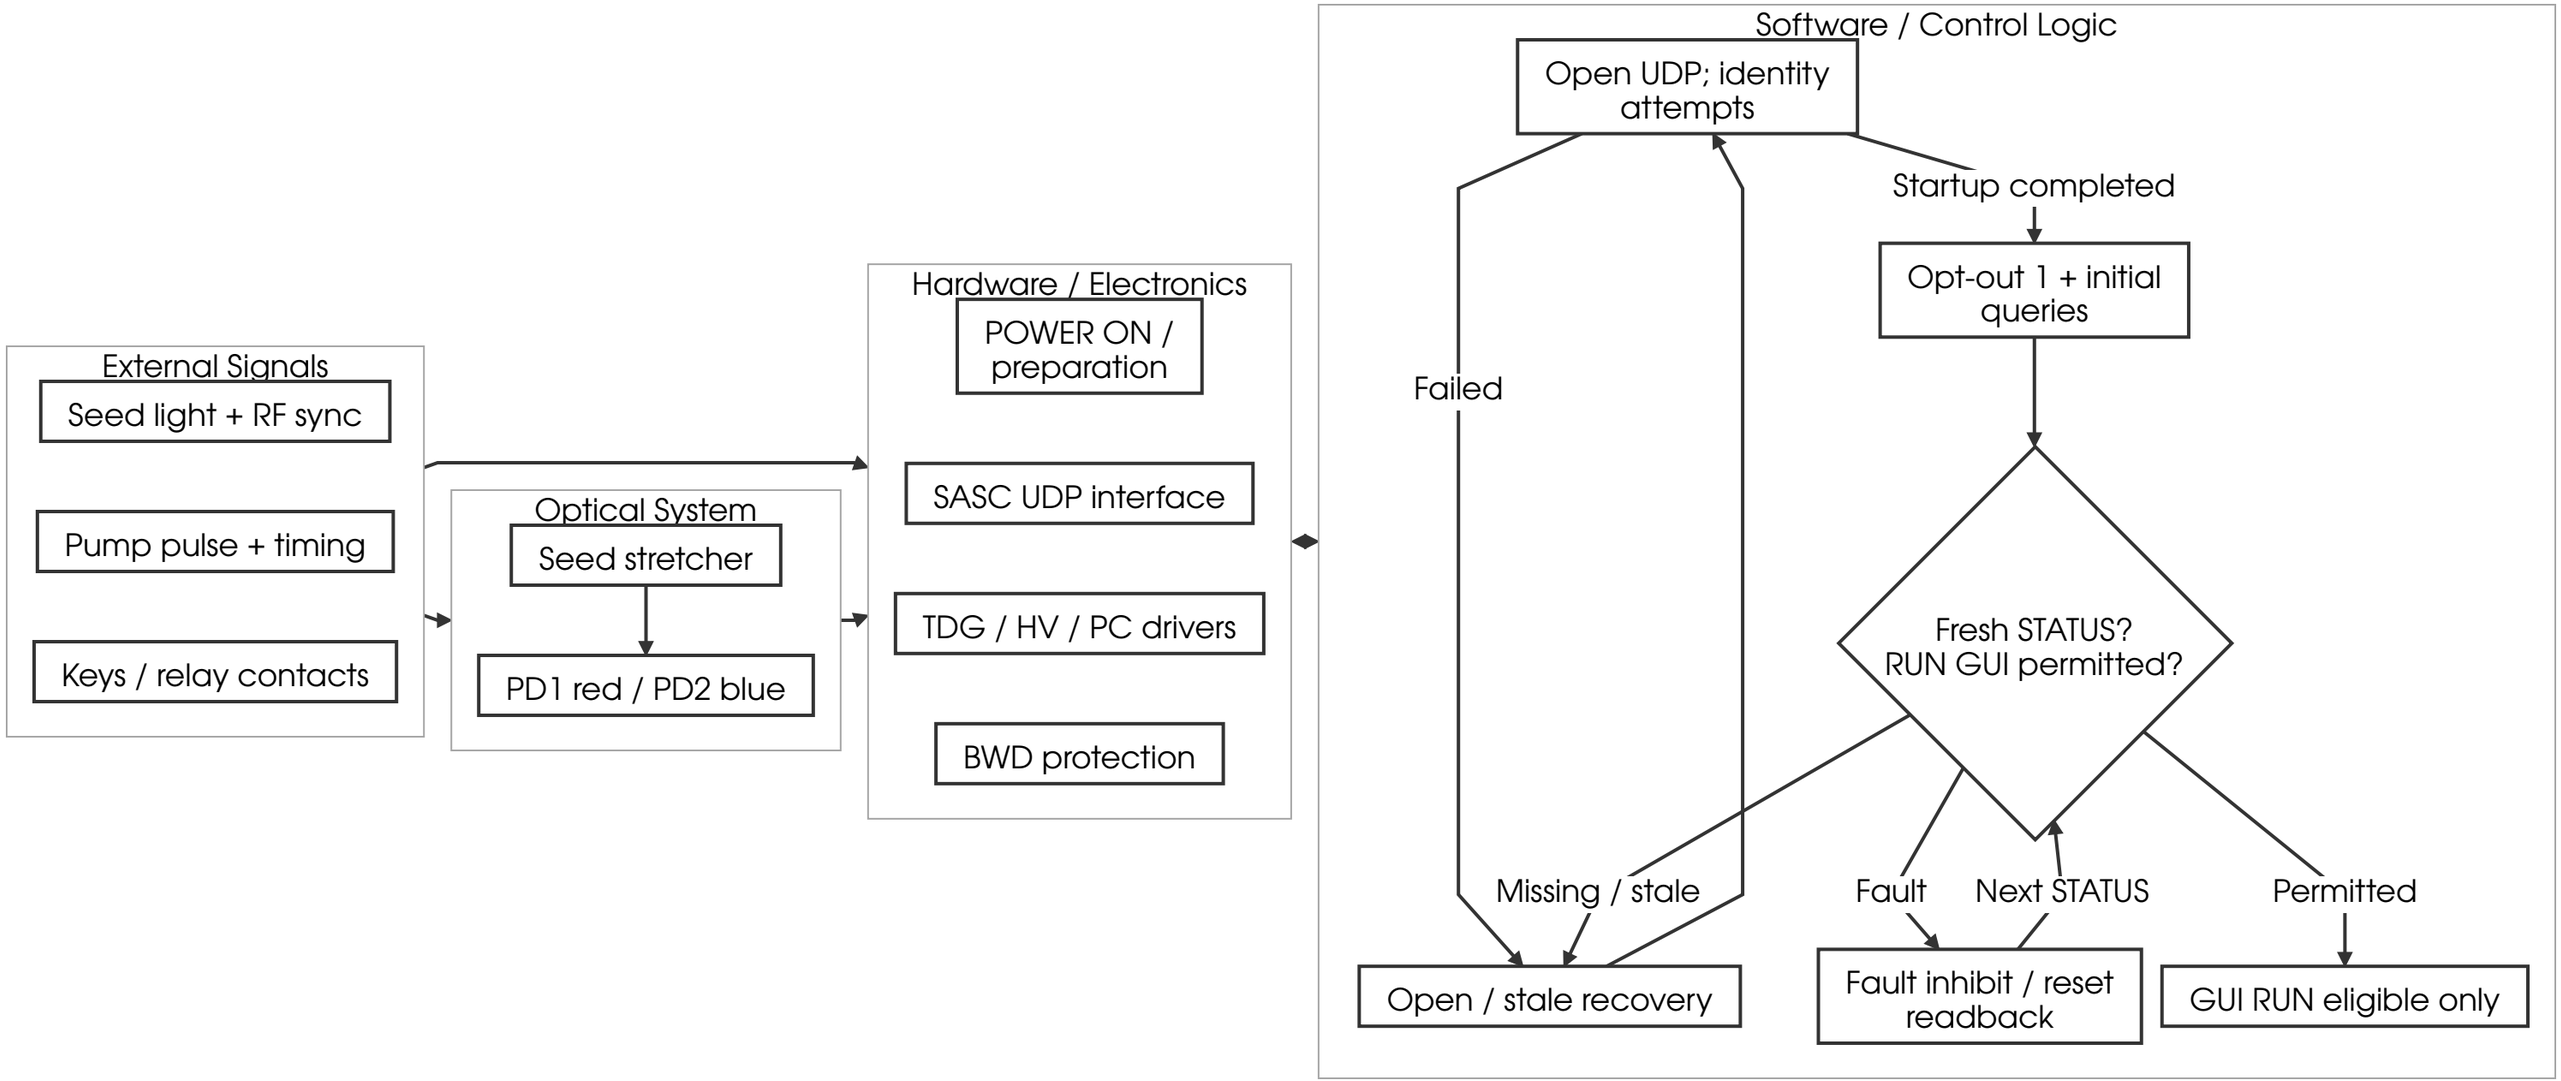
External Signals
Seed light + RF sync
Pump pulse + timing
Keys / relay contacts
Optical System
Seed stretcher
PD1 red / PD2 blue
Hardware / Electronics
POWER ON / preparation
SASC UDP interface
TDG / HV / PC drivers
BWD protection
Software / Control Logic
Open UDP; identity attempts
Failed
Startup completed
Opt-out 1 + initial queries
Fresh STATUS? RUN GUI permitted?
Missing / stale
Fault
Next STATUS
Permitted
Open / stale recovery
Fault inhibit / reset readback
GUI RUN eligible only