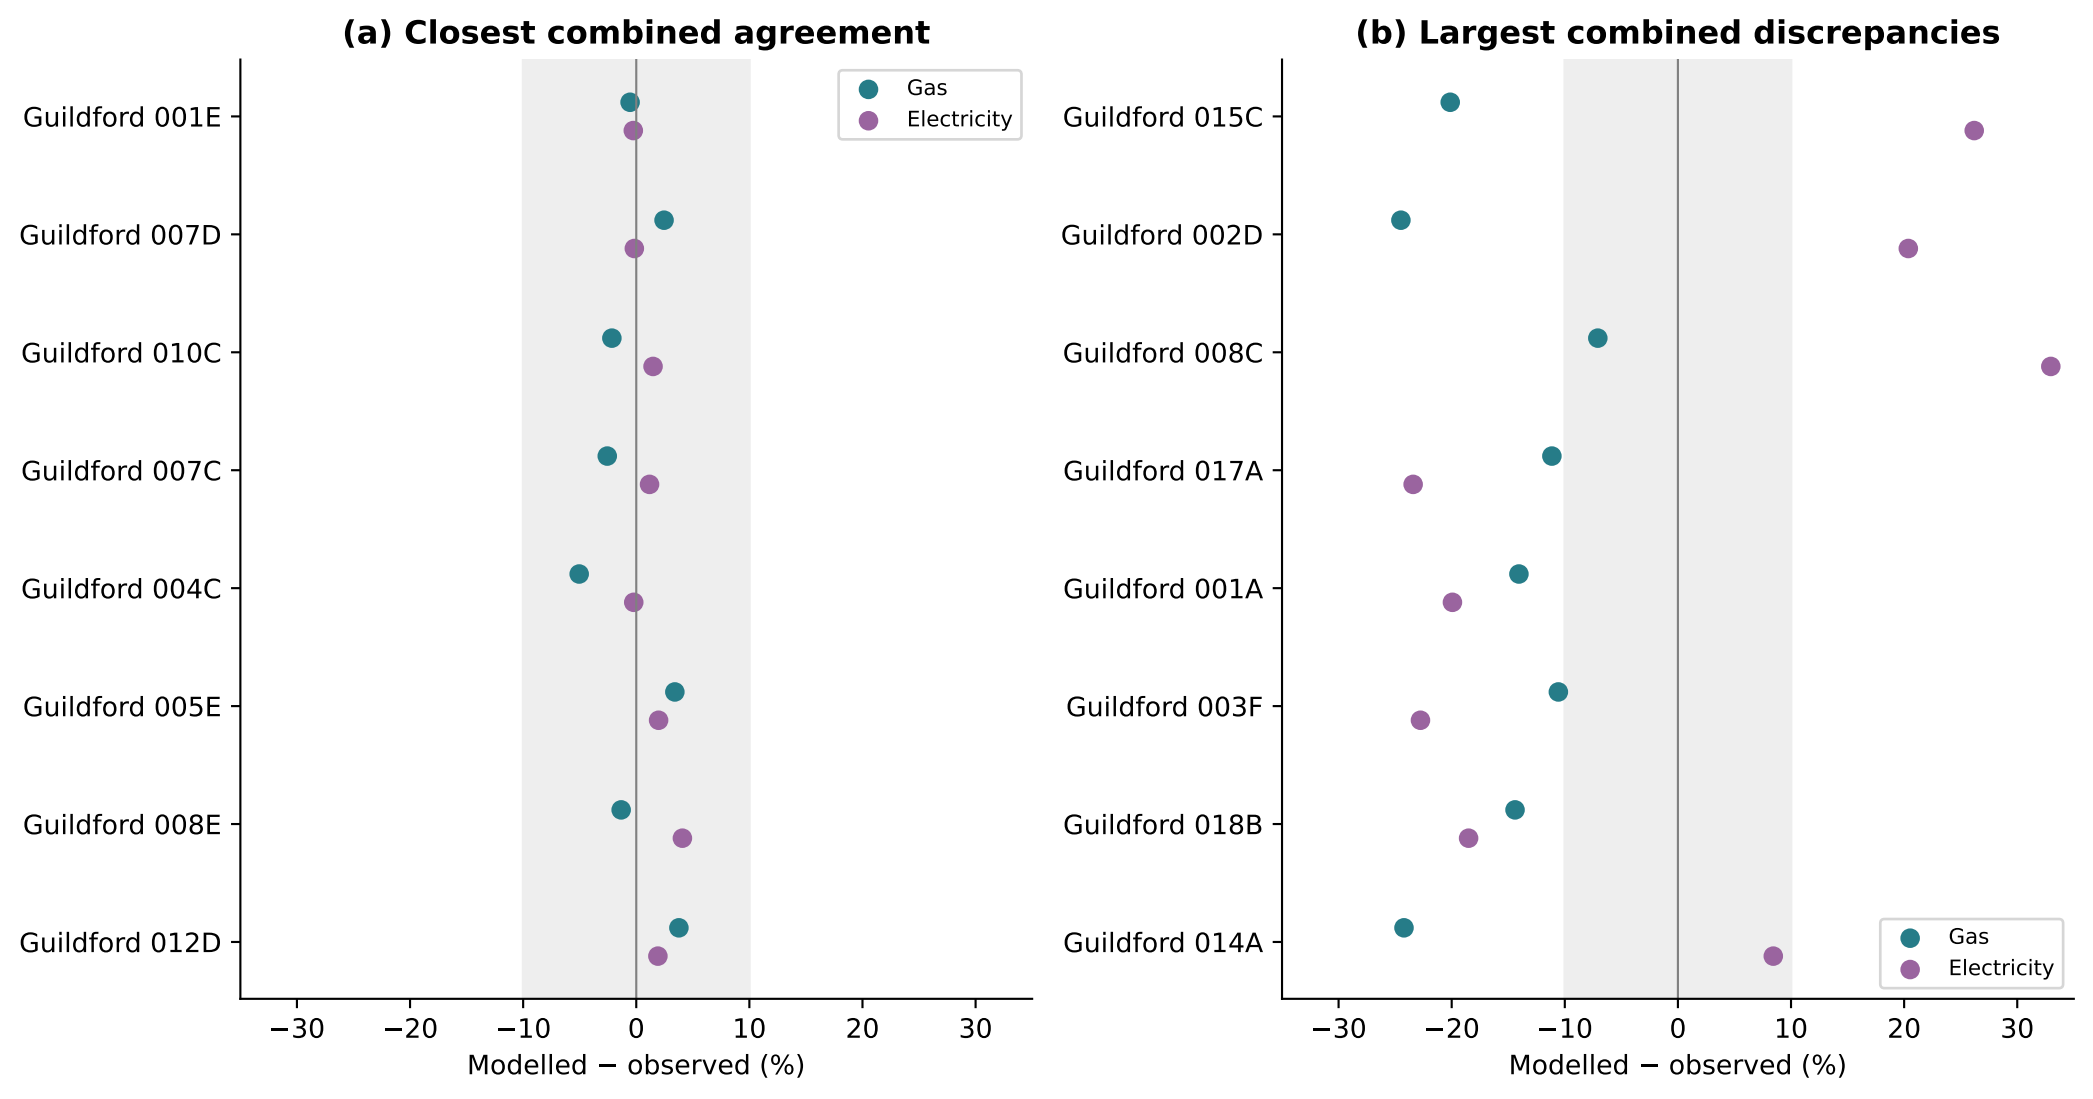
(a) Closest combined agreement
Guildford 001E
Guildford 007D
Guildford 010C
Guildford 007C
Guildford 004C
Guildford 005E
Guildford 008E
Guildford 012D
Gas
Electricity
−30
−20
−10
0
10
20
30
Modelled − observed (%)
(b) Largest combined discrepancies
Guildford 015C
Guildford 002D
Guildford 008C
Guildford 017A
Guildford 001A
Guildford 003F
Guildford 018B
Guildford 014A
Gas
Electricity
−30
−20
−10
0
10
20
30
Modelled − observed (%)