Loss Solutions Group, LLC
Toll Free 866.899.8756
Fax 860.639.5158
www.LossSolutionsGroup.com

February 10, 2026

Ms. Kimberly Wiegert
SageSure
P.O. Box 12487
Tallahassee, FL 32317

RE:	Insured:	Usie Real Estate Holdings LLC
	Claim Number:	HO-2026-598302623
	LSG Matter Number:	724300.0059-00
	Date of Loss:	November 6, 2025

Dear Ms. Wiegert,

Thank you for choosing Loss Solutions Group as your equipment loss consultant. This report provides an analysis of the above-referenced claim.

Assignment:

Loss Solutions Group was contacted by Ms. Kimberly Wiegert of SageSure. The scope of this assignment was to assess the cause of loss, extent of damage, repair costs, and salvage value associated with the insured's HVAC unit. The equipment sustained damage during an unknown event on November 6, 2025.

Findings and Analysis:

Loss Solutions Group contacted the insured, Ms. Felice Lashute with Usie Real Estate Holdings LLC (337-984-9933), to discuss her role in the claim. Ms. Lashute explained that on November 6, 2025 their main air conditioning unit stopped working and began tripping its breaker whenever it was turned on to cooling mode. She was unsure of the cause but speculated that it might have been related to the weather, possibly due to a lightning strike or a power surge, which is common in her area. She mentioned that she had her HVAC company assess the unit on November 6, 2025, and they discovered a shorted compressor. Since it was the middle of the colder months, the repair did not proceed until mid-January, when her HVAC company returned on January 14, 2026 to replace the compressor.

Loss Solutions Group contacted the insured's HVAC vendor, Air Source One Cooling and Heating Inc. (337-984-6541), and spoke with Mr. Mike Seymour to discuss the claimed event and their already completed repair. The vendor reported that they arrived on November 6, 2025 to find a

© 2022 by Loss Solutions Group, LLC. All rights reserved.

compressor that was shorting out and tripping its main breaker. Mr. Seymour mentioned that he was unsure whether the issue was caused by recent weather conditions or a power surge event. He did, however, recall that there were no severe storms around the beginning of November. The damage was limited to the unit's compressor shorting to ground due to a damaged electrical winding.

A total amount of $4,985.00 was presented.

Scope of Damage

Loss Solutions Group submits that the insured’s HVAC unit sustained damage during an unknown event on November 6, 2025.

Age & Condition

The insured reported that his affected equipment was around nine (9) years old and in average condition at the time of the claimed event.

Cause of Loss

Loss Solutions Group submits that the damage is consistent with a power anomaly event. We determined that there were no severe weather incidents in the insured's geographical area on or around the reported date of loss by using the NOAA severe weather data inventory website and www.wunderground.com. Furthermore, the nature of the damage aligns more closely with a power anomaly rather than a lightning strike, as key indicators of a lightning strike were absent. For instance, there were no burn marks on electrical circuit boards or power connections, particularly at the compressor's power terminals, nor was there burnt refrigerant. Additionally, we submit that it is possible the unit was damaged in the months prior to the reported date of loss and either continued to operate at a limited capacity or due to the colder temperatures this time of year just went unnoticed for some time.

Reparability

Loss Solutions Group has reviewed the provided information and discussed the damage with the vendor involved. We submit that the proposed repair path is warranted due to the extent of damage reportedly sustained during the claimed event.

Cost Analysis

Loss Solutions Group assessed the proposed costs by cross-referencing with alternative vendors, drawing on historical data for similar repairs, evaluating comparable equipment pricing, and consulting directly with the involved vendor to verify reasonableness.

© 2022 by Loss Solutions Group, LLC. All rights reserved.

AIR SOURCE ONE COOLING AND HEATING INC. (337-984-6541) INVOICE # 4013227

Loss Solutions Group reviewed the invoice presented by Air Source One totaling $4,985.00 for the repairs to the insured's HVAC unit.

Included in the cost is an amount for an Ingersoll Rand-branded 5-ton compressor, roughly eight (8) pounds of R410A refrigerant, a refrigerant liquid line filter dryer, and some brazing equipment and supplies. We submit that these components were required to complete the repair, and the costs are fair and reasonable.

Loss Solutions Group has reviewed the labor costs for the vendor to diagnose the damage and to perform the repairs. We submit that these amounts are fair and reasonable to complete the scope of work as presented to us.

RCV

Loss Solutions Group submits an amount of $4,985.00 (RCV) as being fair and reasonable to return the insured to a pre-loss condition. A further breakdown of the pricing is available in the attached spreadsheet.

Salvage

Loss Solutions Group submits that there is little to no salvage value associated with this claimed event.

Summary:

Loss Solutions Group's findings herein are based upon all information that was available at the time of this writing. The opinions are based upon reviewed documentation, interviews, research, experience, historical references, training and education.

1. The insured, Usie Real Estate Holdings LLC, reported that their HVAC unit sustained damage during an unknown event on November 6, 2025. A total amount of $4,985.00 was presented.

2. The insured reported that his affected equipment was around nine (9) years old and in average condition at the time of the claimed event.

3. Loss Solutions Group submits that the damage to the insured's equipment is consistent with a power anomaly event.

4. Loss Solutions Group has reviewed the provided information and discussed the damage with the vendor involved. We submit that the proposed repair path is warranted due to the extent of damage reportedly sustained during the claimed event.

© 2022 by Loss Solutions Group, LLC. All rights reserved.

5. Loss Solutions Group submits an amount of $4,985.00 (RCV) as being fair and reasonable to return the insured to a pre-loss condition. A further breakdown of the pricing is available in the attached spreadsheet.

6. Loss Solutions Group submits that there is little to no salvage value associated with this claimed event.

If you have any questions or if you need any additional information, please feel free to contact Tanner Beuret at (866) 899-8756 ext. 755, or via email at tbeuret@losssolutionsgroup.com. Team Leader Nick Ramos can be reached at (866) 899-8756 ext. 724, or via email at nramos@losssolutionsgroup.com.

Best regards,

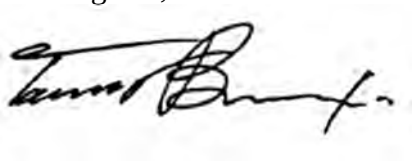

Tanner Beuret
Technical Consultant
Loss Solutions Group, LLC

© 2022 by Loss Solutions Group, LLC. All rights reserved.

INSURED: USIE REAL ESTATE HOLDINGS LLC
LSG MATTER #: 724300.0059-00
CLAIM #: HO-2026-598302623
DATE OF LOSS: 11/6/2025
CAUSE OF LOSS: POWER ANOMALY

AIR SOURCE ONE COOLING AND HEATING INC. (337-984-6541) INVOICE # 4013227											
REF #	ITEM	CLAIM PRESENTED			LSG RESEARCHED RCV			AGE (YEARS)	USEFUL LIFE (YEARS)	CONDITION	NOTES
		QTY	UNIT COST	TOTAL	QTY	UNIT COST	TOTAL				
1	REPLACE 5 TON CARRIER COMPRESSOR.	1	$ 4,985.00	$ 4,985.00	0	$ -	$ -	N/A	N/A	N/A	REPLACE 5 TON CARRIER COMPRESSOR ALONG WITH SOME OTHER ITEMS. THIS COST WAS PROVIDED TO US IN A LUMP SUM COST. WITH HELP FROM THE VENDOR WE WERE ABLE TO BREAK THIS COST DOWN AS FOLLOWS.
2	COM 14908 COMPRESSOR	0	$ -	$ -	1	$ 2,800.00	$ 2,800.00	9	20	AVERAGE	TRANE INGERSOLL RAND BRAND 4.5 TON 3 PHASE R410A COMPRESSOR. WITH A VENDOR MARK UP ON MATERIALS.
3	REFRIGERANT 410A	0	$ -	$ -	8	$ 130.00	$ 1,040.00	9	20	AVERAGE	ROUGHLY EIGHT POUNDS OF REFRIGERANT TO RECHARGE THE UNIT.
4	LIQUID FILTER DRYER.	0	$ -	$ -	1	$ 85.00	$ 85.00	9	20	AVERAGE	NEW LIQUID LINE REFRIGERANT FILTER
5	BRAZING EQUIPMENT AND SUPPLIES	0	$ -	$ -	1	$ 60.00	$ 60.00	N/A	N/A	N/A	BRAZING EQUIPMENT AND SUPPLIES
6	DISPOSAL OF OLD COMPRESSOR	0	$ -	$ -	1	$ 40.00	$ 40.00	N/A	N/A	N/A	DISPOSAL OF OLD COMPRESSOR

© 2022 by Loss Solutions Group, LLC. All rights reserved.

INSURED: USIE REAL ESTATE HOLDINGS LLC
LSG MATTER #: 724300.0059-00
CLAIM #: HO-2026-598302623
DATE OF LOSS: 11/6/2025
CAUSE OF LOSS: POWER ANOMALY

AIR SOURCE ONE COOLING AND HEATING INC. (337-984-6541) INVOICE # 4013227											
REF #	ITEM	CLAIM PRESENTED			LSG RESEARCHED RCV			AGE (YEARS)	USEFUL LIFE (YEARS)	CONDITION	NOTES
		QTY	UNIT COST	TOTAL	QTY	UNIT COST	TOTAL				
7	LABOR HOURS	0	$ -	$ -	8	$ 120.00	$ 960.00	N/A	N/A	N/A	LABOR HOURS FOR ONE TECHNICIAN FOR ONE DAY OF WORK.
SUB-TOTAL				**$ 4,985.00**			**$ 4,985.00**				
SALES TAX				$ -			$ -				
TOTAL				**$ 4,985.00**			**$ 4,985.00**				

TOTAL PRESENTED	**$ 4,985.00**

TOTAL RESEARCHED RCV	**$ 4,985.00**

© 2022 by Loss Solutions Group, LLC. All rights reserved.

Air Source One Cooling and Heating Inc

535 Ole Colony Rd
Lafayette, LA 70506

INVOICE	#4011914
SERVICE DATE	Nov 06, 2025
INVOICE DATE	Nov 06, 2025
PAYMENT TERMS	Upon receipt
DUE DATE	Jan 30, 2026
AMOUNT DUE	**$0.00**

PARTNERS' LIMITED
PARTNERS' LIMITED
204 Greystone Pl
Lafayette, LA 70503

(337) 984-9933
partnersltd@gmail.com

SERVICE ADDRESS

1907 Kaliste Saloom Rd
Lafayette, LA 70508

CONTACT US

(337) 984-6541
invoices@airsource1.net

Service completed by: Mike Seymour

INVOICE

Services	qty	unit price	amount
electrician went out and they told customer that the ac is what is blowing the breaker Inspected the system and found a shorted compressor. Jordan is going out tomorrow to give the customer quotes.	1.0	$0.00	$0.00

A "shorted compressor" (specifically shorted-to-ground) means the internal electrical motor windings have broken down, causing electricity to bypass its path and arc to the metal casing.
This trips circuit breakers instantly, prevents the unit from starting, and usually requires a full compressor or system replacement.

Causes: Overheating, age, mechanical failures, electrical surges, or lighting strikes

Subtotal	$0.00
Total Tax	$0.00
New Tax Rate (10%)	$0.00
Job Total	**$0.00**
Amount Due	**$0.00**

THANK YOU, WE APPRECIATE YOUR BUSINESS!
All invoices due at time of service.

Gmail Partners' Ltd Partners' Ltd. <partnersltd@gmail.co

nvoice 4013227 due from Air Source One Cooling and Heating Inc - $4,985.00

message

.ir Source One Cooling and Heating Inc <notifications@housecallpro.com> Wed, Jan 14, 2026 at 4:40
:eply-To: Air Source One Cooling and Heating Inc <invoices@airsource1.net>
o: partnersltd@gmail.com

Your invoice from Air Source One Cooling and Heating Inc

Hi Nick,

Thank you for choosing Air Source One Cooling and Heating Inc. Please see attached invoice due upon receipt.

Invoice Number:	#4013227
Service Date:	Jan 14, 2026
Customer Name:	PARTNERS' LIMITED
Company Name:	PARTNERS' LIMITED
Service Address:	1907 Kaliste Saloom Rd, Lafayette, LA 70508

Services	qty	unit price	amount
estimate on compressor	1.0	$4,985.00	$4,985.00

5 Ton Compressor ONLY

Warranty on compressor only
1 year part
1 year labor

COM14908 Compressor
CREW-CONTRACT Installation crew labor included
REF-REC Refrigerant recovery, (Federally Mandated)
WELD Welding equipment and supplies:
EPA-1 EPA Fee, disposal of old compressor, oil
VACUUM Deep vacuum pump expense:
Refrigerant 410A
LIQUID F/D C163-S, 16 cubic Inch liquid-line filter/drier 3/8

Subtotal	$4,985.00
New Tax Rate	$0.00
Total job price	$4,985.00

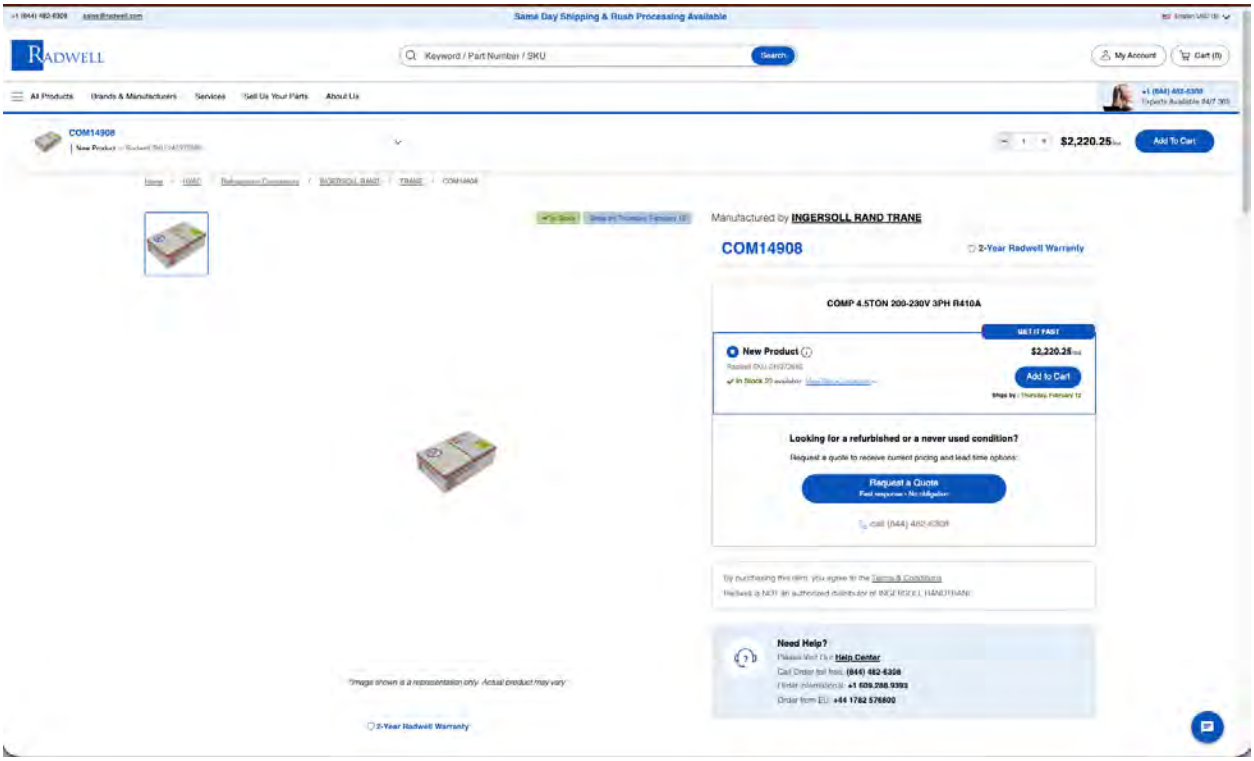

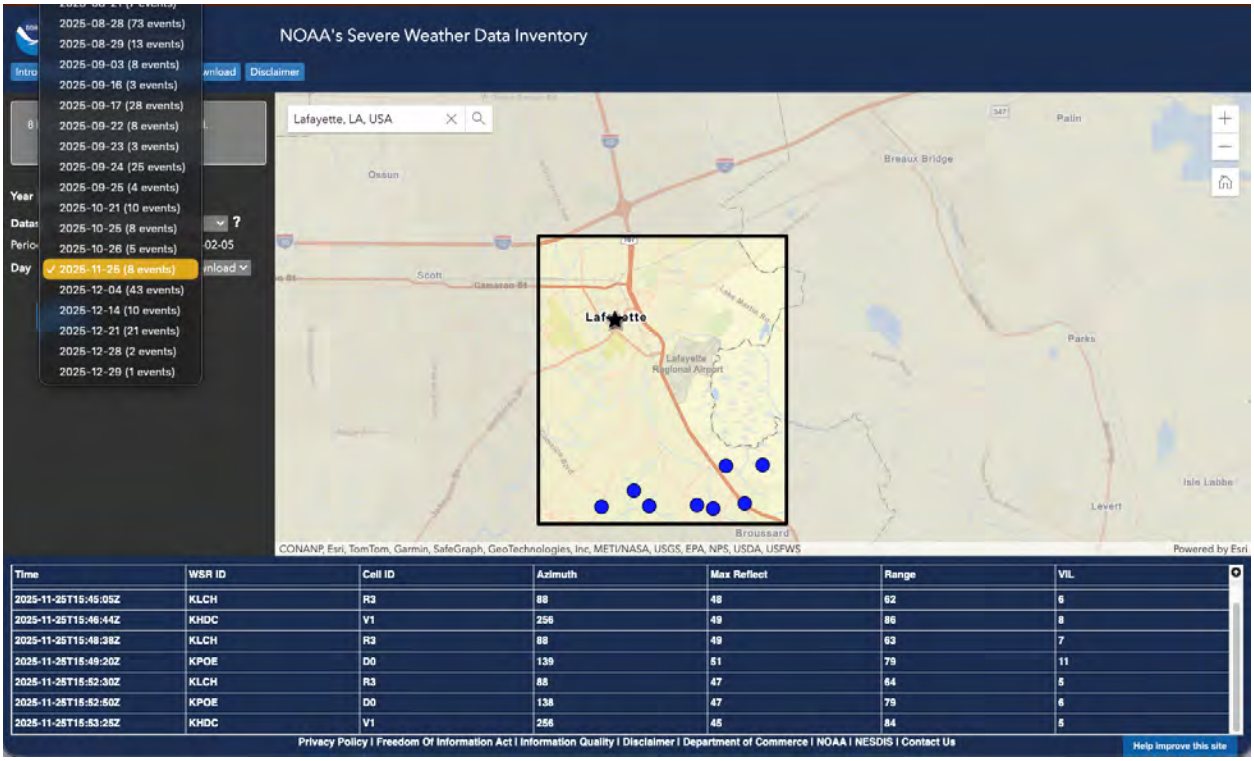

Time	WSR ID	Cell ID	Azimuth	Max Reflect	Range	VIL
2025-11-25T15:45:05Z	KLCH	R3	88	48	62	6
2025-11-25T15:46:44Z	KHDC	V1	256	49	86	8
2025-11-25T15:48:38Z	KLCH	R3	88	49	63	7
2025-11-25T15:49:20Z	KPOE	D0	139	51	79	11
2025-11-25T15:52:30Z	KLCH	R3	88	47	64	5
2025-11-25T15:52:50Z	KPOE	D0	138	47	79	6
2025-11-25T15:53:25Z	KHDC	V1	256	45	84	5

National Centers for Environmental Information

NOAA's Severe Weather Data Inventory

Introduction | Web Services | Bulk Download | Disclaimer

8 Filtered Storm Cells events retrieved.

Year 2025

Dataset Filtered Storm Cells ?

Period of Record: 1992-05-07 to 2026-02-05

Day 2025-11-25 (8 events) Download

Reset

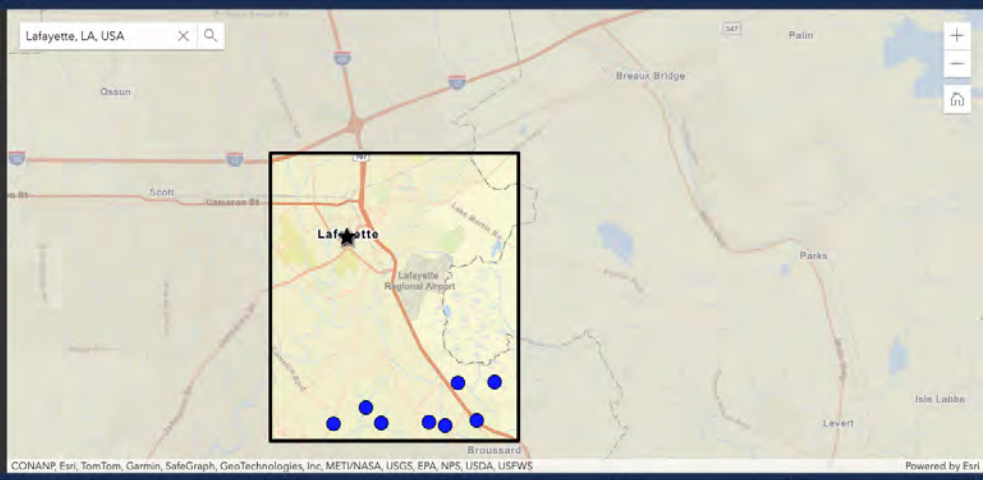

Time	WSR ID	Cell ID	Azimuth	Max Reflect	Range	VIL
2025-11-25T15:45:05Z	KLCH	R3	88	48	62	6
2025-11-25T15:46:44Z	KHDC	V1	256	49	86	8
2025-11-25T15:48:38Z	KLCH	R3	88	49	63	7
2025-11-25T15:49:20Z	KPOE	D0	139	51	79	11
2025-11-25T15:52:30Z	KLCH	R3	88	47	64	5
2025-11-25T15:52:50Z	KPOE	D0	138	47	79	6
2025-11-25T15:53:25Z	KHDC	V1	256	45	84	5

Privacy Policy | Freedom Of Information Act | Information Quality | Disclaimer | Department of Commerce | NOAA | NESDIS | Contact Us

Help improve this site

retail prices on select products!

Daily Observations

Time	Temperature	Dew Point	Humidity	Wind	Wind Speed	Wind Gust	Pressure	Precip.	Condition
12:43 AM	14 °C	14 °C	97 %	CALM	0 km/h	0 km/h	1,019.08 hPa	0.0 mm	Mist
12:51 AM	14 °C	14 °C	100 %	CALM	0 km/h	0 km/h	1,019.08 hPa	0.0 mm	Fair
12:53 AM	14 °C	14 °C	100 %	CALM	0 km/h	0 km/h	1,016.75 hPa	0.0 mm	Fair
1:53 AM	14 °C	13 °C	96 %	CALM	0 km/h	0 km/h	1,018.41 hPa	0.0 mm	Fair
2:53 AM	13 °C	12 °C	96 %	NNE	6 km/h	0 km/h	1,018.07 hPa	0.0 mm	Fair
3:53 AM	12 °C	12 °C	100 %	NNE	9 km/h	0 km/h	1,018.07 hPa	0.0 mm	Fair
4:53 AM	13 °C	13 °C	97 %	N	6 km/h	0 km/h	1,018.41 hPa	0.0 mm	Fair
5:53 AM	13 °C	13 °C	100 %	NNE	7 km/h	0 km/h	1,018.41 hPa	0.0 mm	Fair
6:53 AM	14 °C	13 °C	96 %	NNE	7 km/h	0 km/h	1,018.75 hPa	0.0 mm	Fair
7:53 AM	17 °C	16 °C	93 %	CALM	0 km/h	0 km/h	1,019.08 hPa	0.0 mm	Fair
8:53 AM	20 °C	17 °C	84 %	NE	6 km/h	0 km/h	1,019.08 hPa	0.0 mm	Fair
9:53 AM	23 °C	18 °C	76 %	VAR	7 km/h	0 km/h	1,018.75 hPa	0.0 mm	Fair
10:53 AM	24 °C	17 °C	66 %	ENE	7 km/h	0 km/h	1,018.07 hPa	0.0 mm	Cloudy
11:53 AM	25 °C	17 °C	63 %	VAR	6 km/h	0 km/h	1,016.72 hPa	0.0 mm	Partly Cloudy
12:53 PM	26 °C	18 °C	67 %	VAR	7 km/h	0 km/h	1,015.20 hPa	0.0 mm	Mostly Cloudy
1:53 PM	25 °C	18 °C	64 %	CALM	0 km/h	0 km/h	1,013.03 hPa	0.0 mm	Cloudy
2:53 PM	25 °C	18 °C	64 %	CALM	0 km/h	0 km/h	1,014.35 hPa	0.0 mm	Mostly Cloudy
3:53 PM	24 °C	19 °C	71 %	CALM	0 km/h	0 km/h	1,014.35 hPa	0.0 mm	Cloudy
4:53 PM	23 °C	19 °C	76 %	CALM	0 km/h	0 km/h	1,014.35 hPa	0.0 mm	Cloudy
5:53 PM	23 °C	19 °C	81 %	CALM	0 km/h	0 km/h	1,014.01 hPa	0.0 mm	Cloudy
6:53 PM	22 °C	19 °C	81 %	CALM	0 km/h	0 km/h	1,014.01 hPa	0.0 mm	Cloudy
7:53 PM	22 °C	18 °C	81 %	SE	7 km/h	0 km/h	1,014.01 hPa	0.0 mm	Cloudy
8:53 PM	22 °C	18 °C	78 %	SE	7 km/h	0 km/h	1,013.67 hPa	0.0 mm	Cloudy
9:53 PM	21 °C	18 °C	84 %	CALM	0 km/h	0 km/h	1,013.34 hPa	0.0 mm	Partly Cloudy
10:32 PM	21 °C	18 °C	84 %	CALM	0 km/h	0 km/h	1,013.00 hPa	0.0 mm	Cloudy
10:53 PM	20 °C	17 °C	84 %	CALM	0 km/h	0 km/h	1,013.00 hPa	0.0 mm	Cloudy
11:53 PM	19 °C	16 °C	83 %	CALM	0 km/h	0 km/h	1,012.32 hPa	0.0 mm	Mostly Cloudy

You May Like

Sponsored Links by Taboola

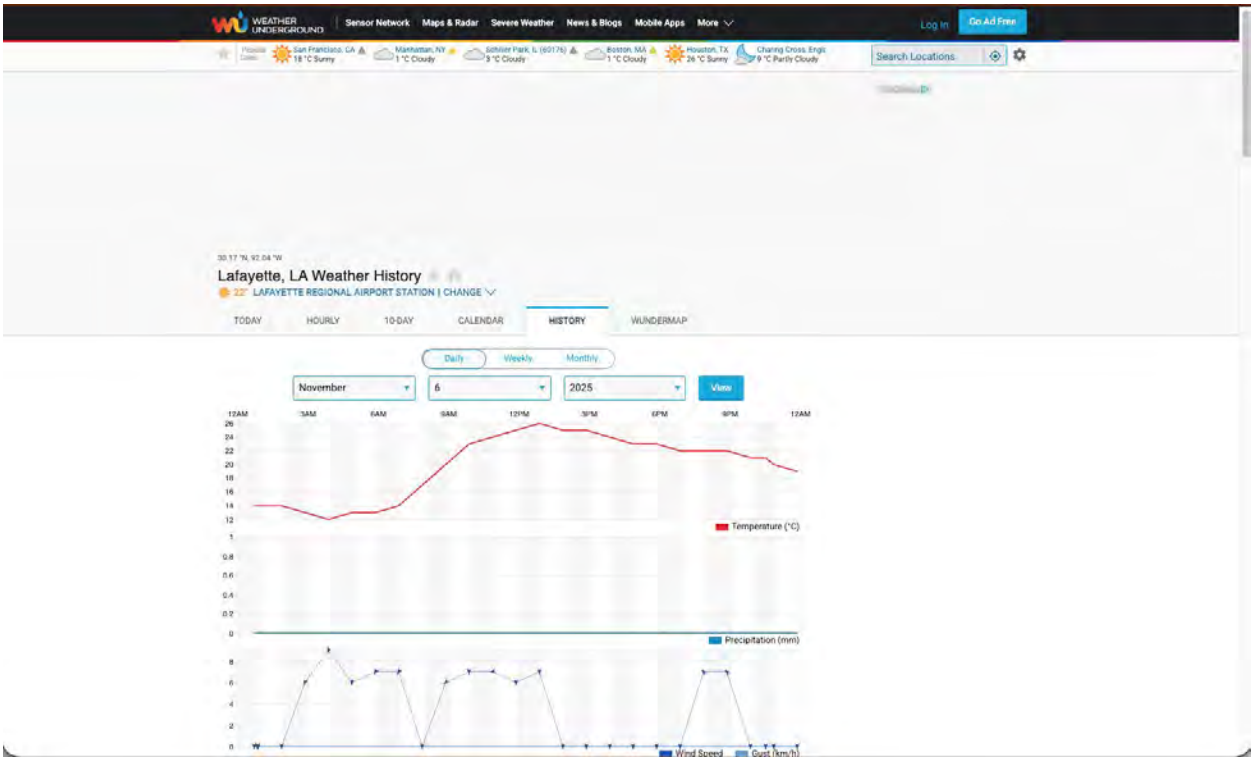

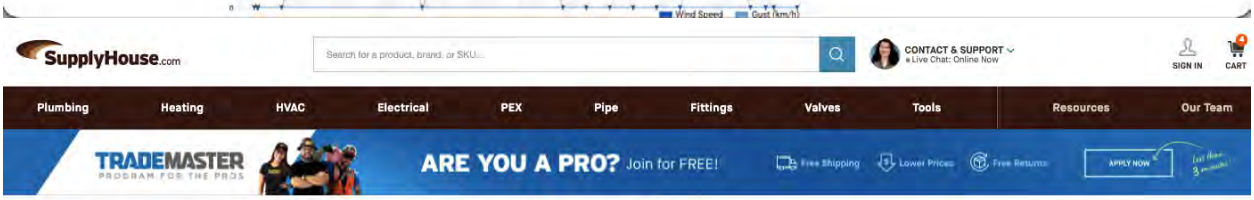

Hover image to zoom

Home / Plumbing Supplies / Tools / Soldering Supplies / Brazing Rods

Stay-Silv 15% Flat Brazing Rods (28 Sticks per Tube)

Brand: Harris SKU: 15620F1 (10) Q&A: (0)

$132.37 each

ADD TO CART

In Stock Get 366 Mon, Dec 23

FastTrack
Order by 5PM, receive Monday
Details

TurboTrack
Order today, get by 12PM Monday
Time Slots

Free Shipping This item ships free

Easy Returns No restocking fee for 90 days

Product Highlights

15% Silver, 5% Phosphorus, 80% Copper

1 lb

Description

SupplyHouse.com

Search for a product, brand, or SKU...

CONTACT & SUPPORT
Live Chat: Online Now

SIGN IN CART

Plumbing | Heating | HVAC | Electrical | PEX | Pipe | Fittings | Valves | Tools | Resources | Our Team

TRADEMASTER PROGRAM FOR THE PROS

ARE YOU A PRO? Join for FREE!

Free Shipping | Lower Prices | Free Returns | APPLY NOW

Less than 3 minutes!

Hover image to zoom

Home > HVAC Supplies > HVAC Replacement Parts > Lennox Parts > Lennox Filters

R410a Bi-flow Drier, 49W23

Brand: Lennox SKU: 49W23 (0) Q&A: (0)

$83.36 each

ADD TO CART

In Stock Get 2 Wed, Jul 17

Will this part work with my unit?
Click to see if this part is compatible with your unit.

Free Shipping On orders over $99

Easy Returns No restocking fee for 90 days

Description

49W23 is an official OEM R410a Bi-flow Drier for Lennox HVAC equipment.

Contact

Question? Call or text 888-757-4774

Google

HOW MUCH DO HVAC COMPANIES CHARGE PER POUND OF RE

All | Images | Shopping | News | Videos | More | Tools

Residential Air Conditioner Freon Refill Cost

As mentioned earlier, Freon costs about **$125 – $150** per pound. Most homeowners will pay in the range of $200 to $400 for a refill, depending on the type and size of their HVAC unit. If you own a larger r22 unit, you may have to spend $600 or more.

centralheatofga.com
https://centralheatofga.com › how-much-does-it-cost-to...

How Much Does It Cost to Refill Refrigerant in AC Unit?