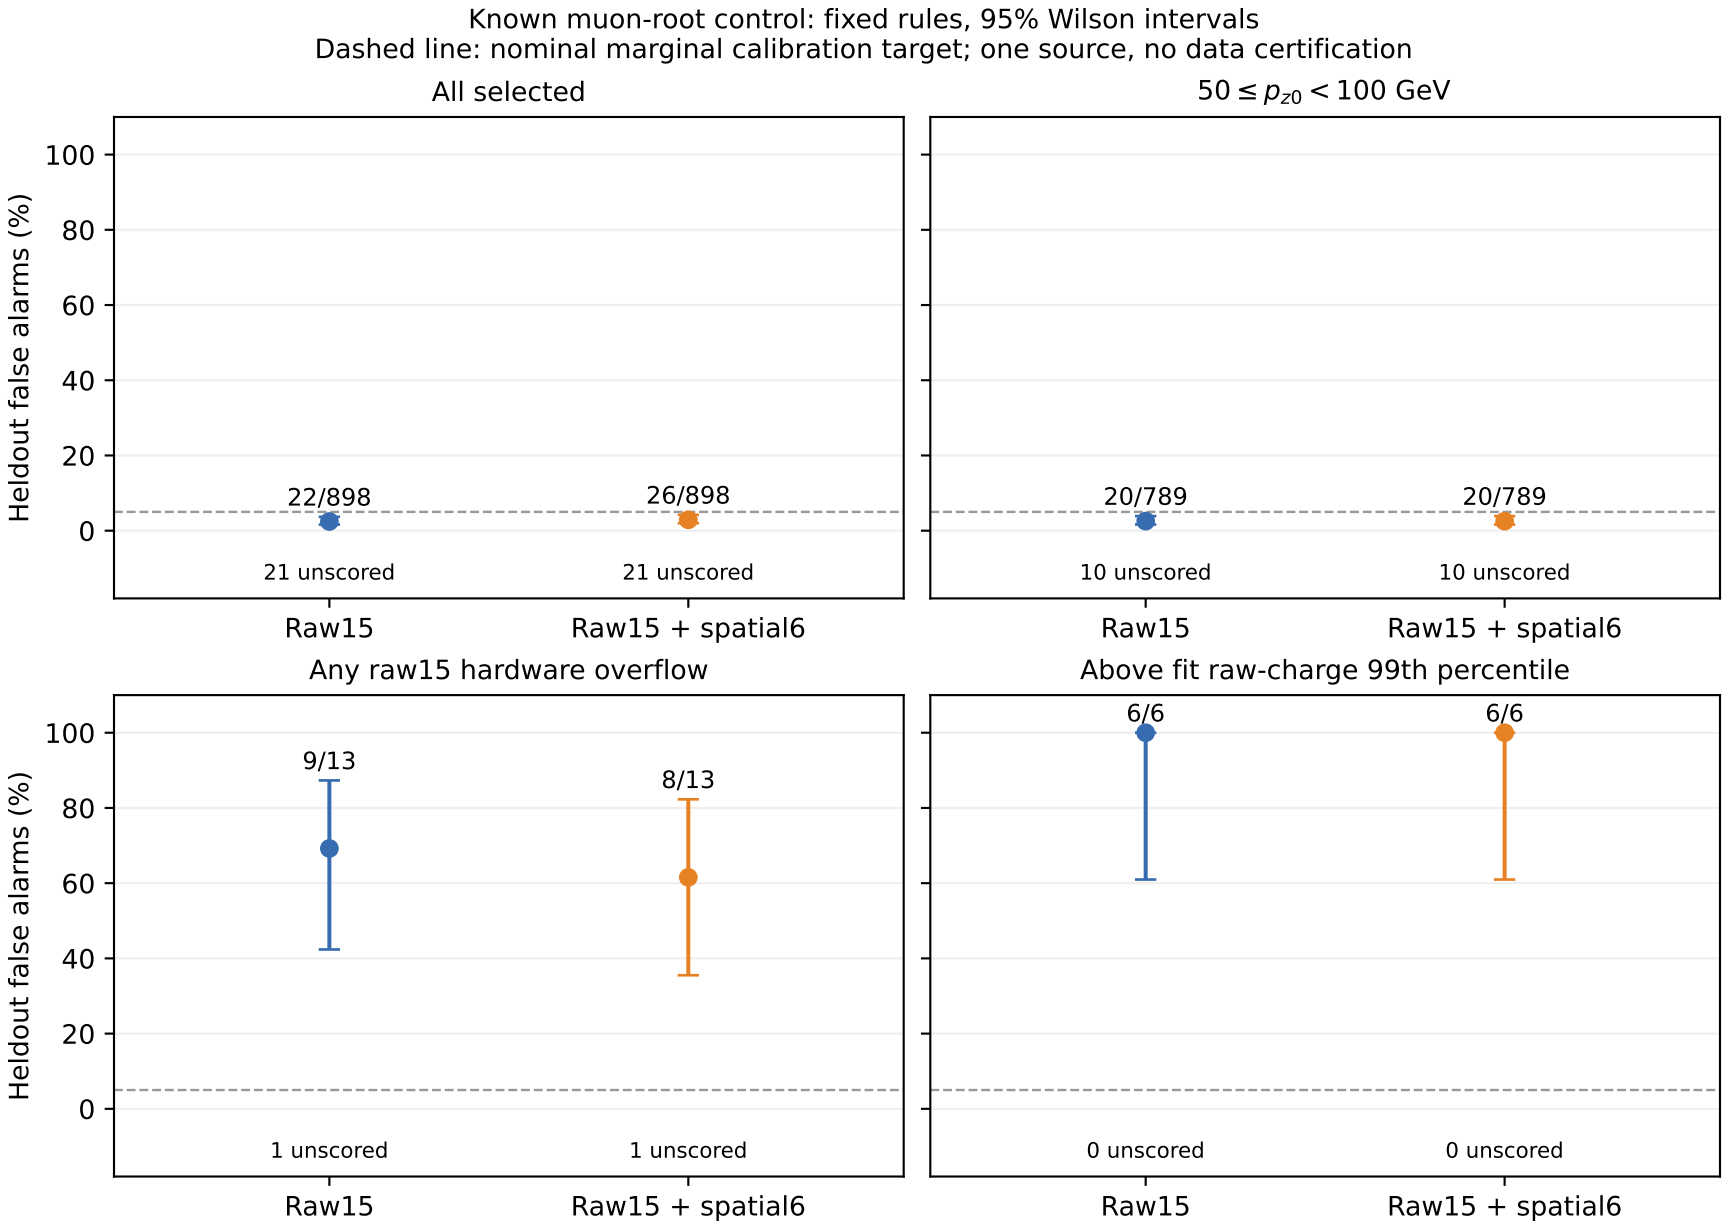
Known muon-root control: fixed rules, 95% Wilson intervals
Dashed line: nominal marginal calibration target; one source, no data certification
All selected
$50 \le p_{z0} < 100$ GeV
Any raw15 hardware overflow
Above fit raw-charge 99th percentile
Heldout false alarms (%)
100
80
60
40
20
0
22/898
26/898
20/789
20/789
9/13
8/13
6/6
6/6
21 unscored
21 unscored
10 unscored
10 unscored
1 unscored
1 unscored
0 unscored
0 unscored
Raw15
Raw15 + spatial6