


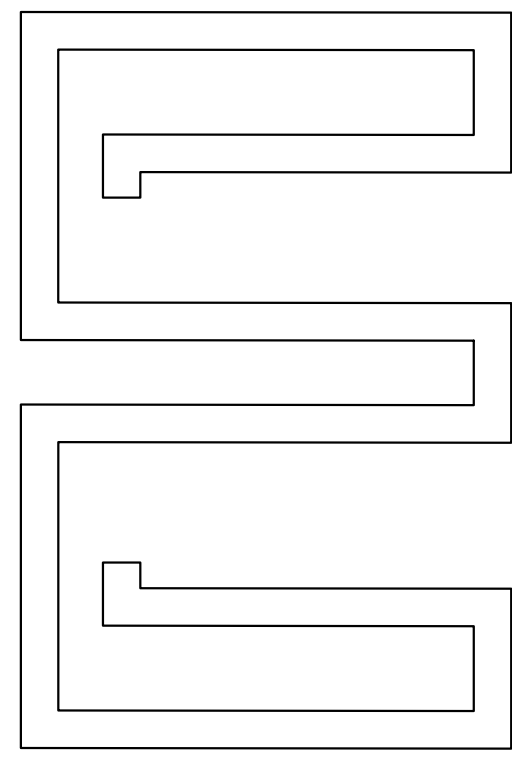

Eslam Ahmed
Engineering services

General Notes


- 1- ALL DIMENSIONS AND AXES SHOULD BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS BEFORE CONSTRUCTION.
- 2- ALL DIMENSION AND LEVELS ARE IN M UNLESS OTHERWISE NOTED ON PLAN.
- 3- THE CUBIC STRENGTH OF R. CONCRETE USED IN ALL R.C. WORKS AFTER 28 DAYS SHOULD NOT BE LESS THAN 250
- 4- THE CEMENT USED FOR BOTH PLAIN AND REINFORCED CONCRETE UNDER GROUND LEVEL IS SULPHATE RESISTENCE POTLAND CEMENT.
- 5- STEEL USED IN RFT. IN R.C. WORK IS HIGH TENSILE STEEL "36/54" FOR DIAMETERS 10 mm AND MILD STEEL "24/35" FOR 8mm.
- 6- THE REINFORCMENT OF COULMNS WILL BE TAKEN FROM COULMNS DETAILS.
- 7- CONCRETE COVER SHOULD NOT LESS THAN 2.5 cm FOR COULMNS.
- 8- DESIGN IS CARRIED TO THE REQUIREMENTS OF THE EGYPTIAN CODE OF PRACTICE (2007).
- 9- CONCRETE USED SHOULD BE VERY DENSE AND CURING MUST BE ACCORDING TO EGYPTIAN CODE OF PRACTICE (2007).
- 10- L0 IS THE BIGEST OF :-
 - a- 1/6 THE CLEARANCE HEIGHT Of Column
 - b- THE BIGEST DIMENTION OF column Section
 - c- 50 CM
- 11- Ld IS THE BIGEST OF 1 m OR 60 .
- 12- CONSTRUCTION JOINTS IN FLOOR WILL BE LOCATED WITHEN THE MIDDLE THIRD OF THE SLABS AND BEAMS.
- 13- SURFACE OF CONSTRUCTION JOINTS WILL BE CLEANED AND LATTANCE REMOVED.

Layout Name: Solid slab 14 cm




Project Name: Rectangular halls

Structural Eng: Hossam Esmail

Instructor: Eslam Ahmed



Date:	Project.No	Sheet.No
Scale:		

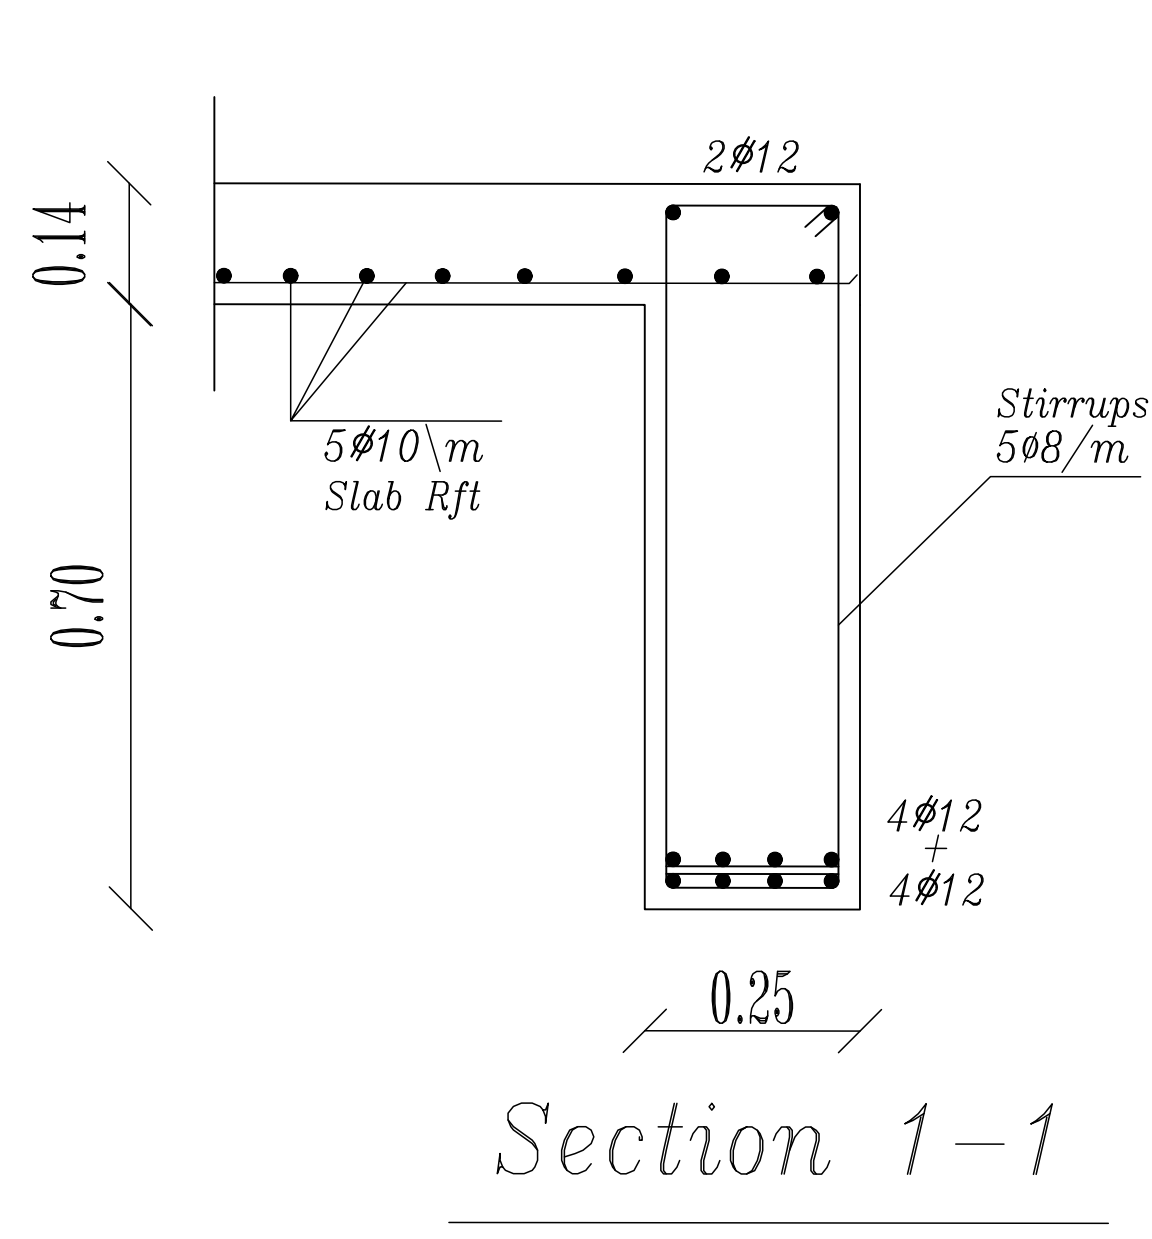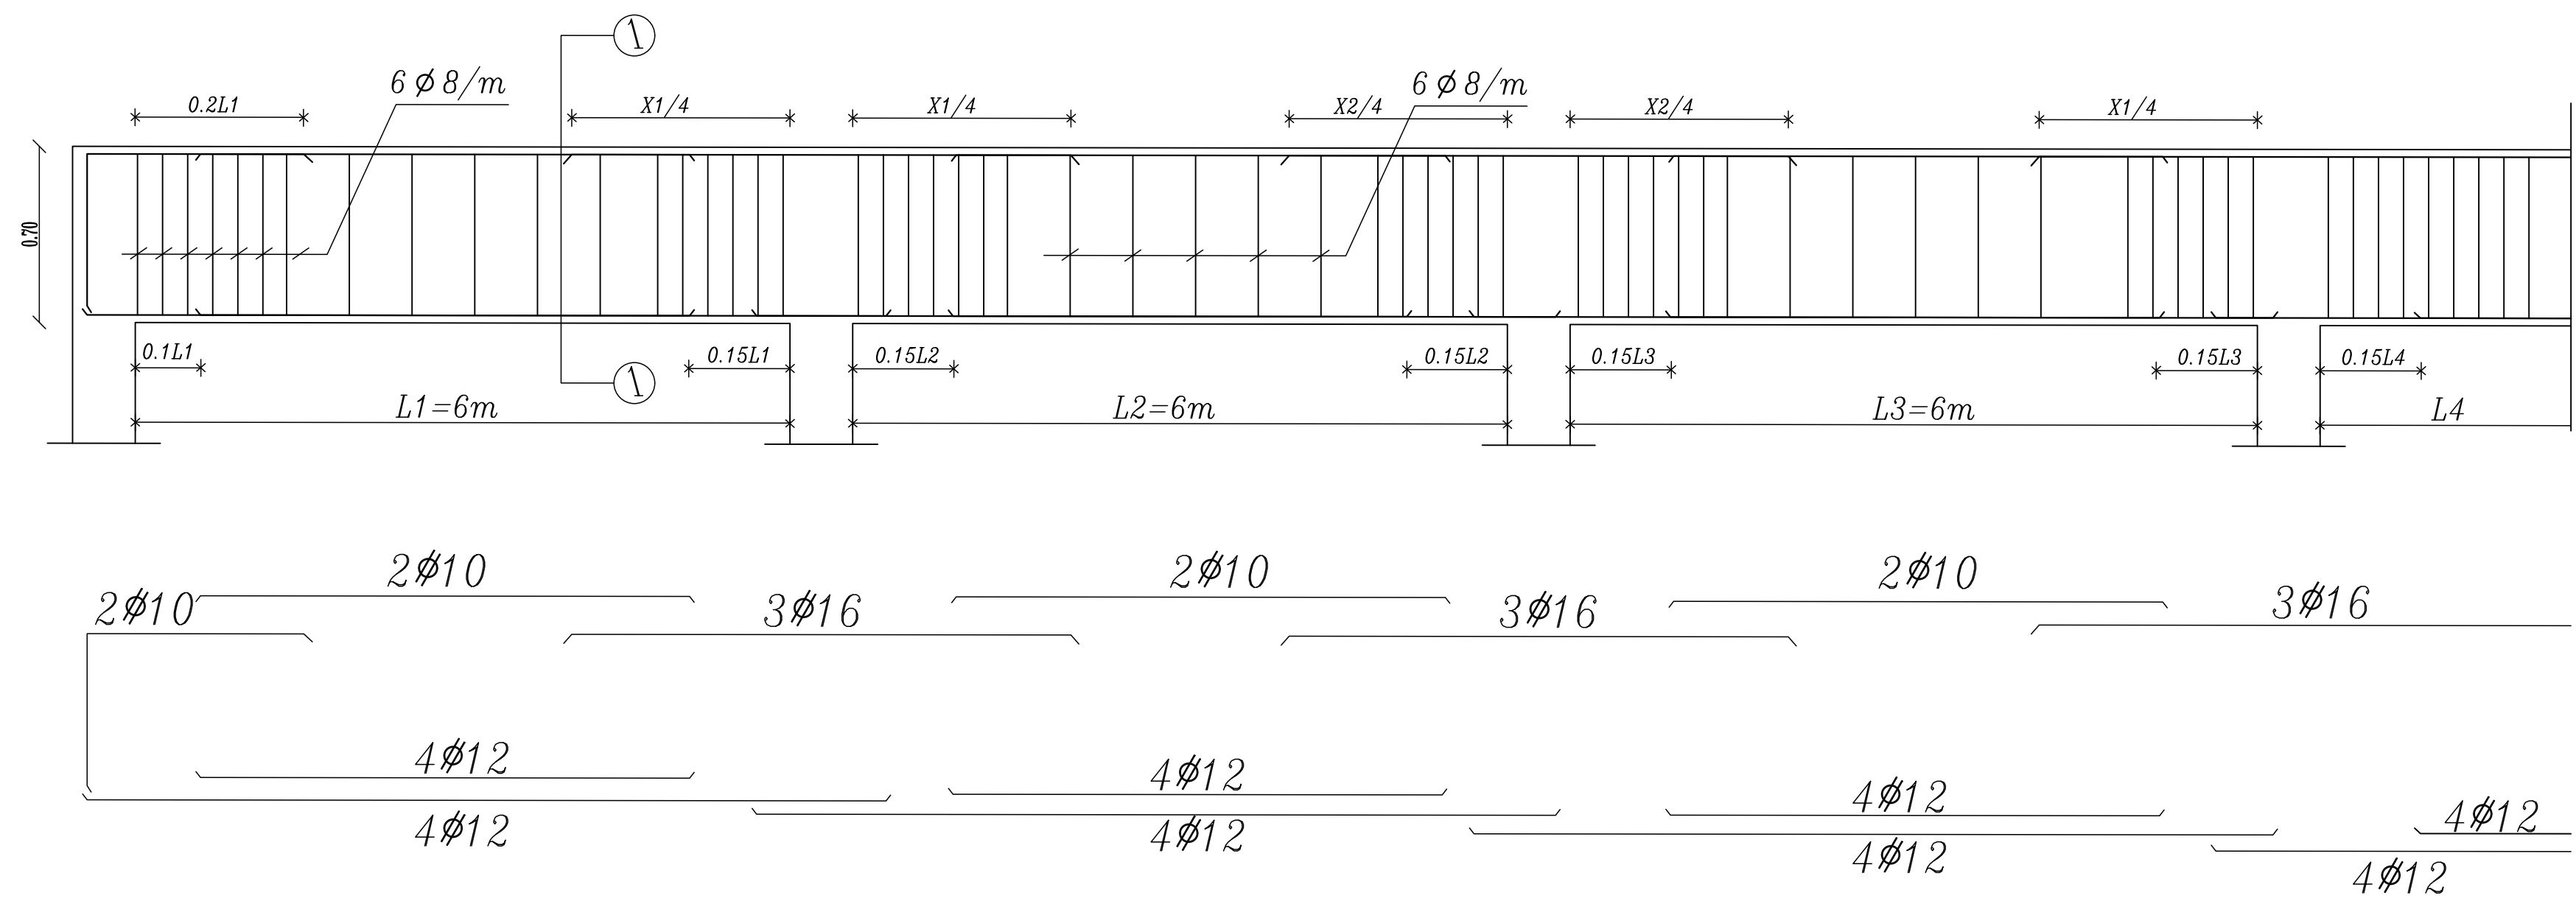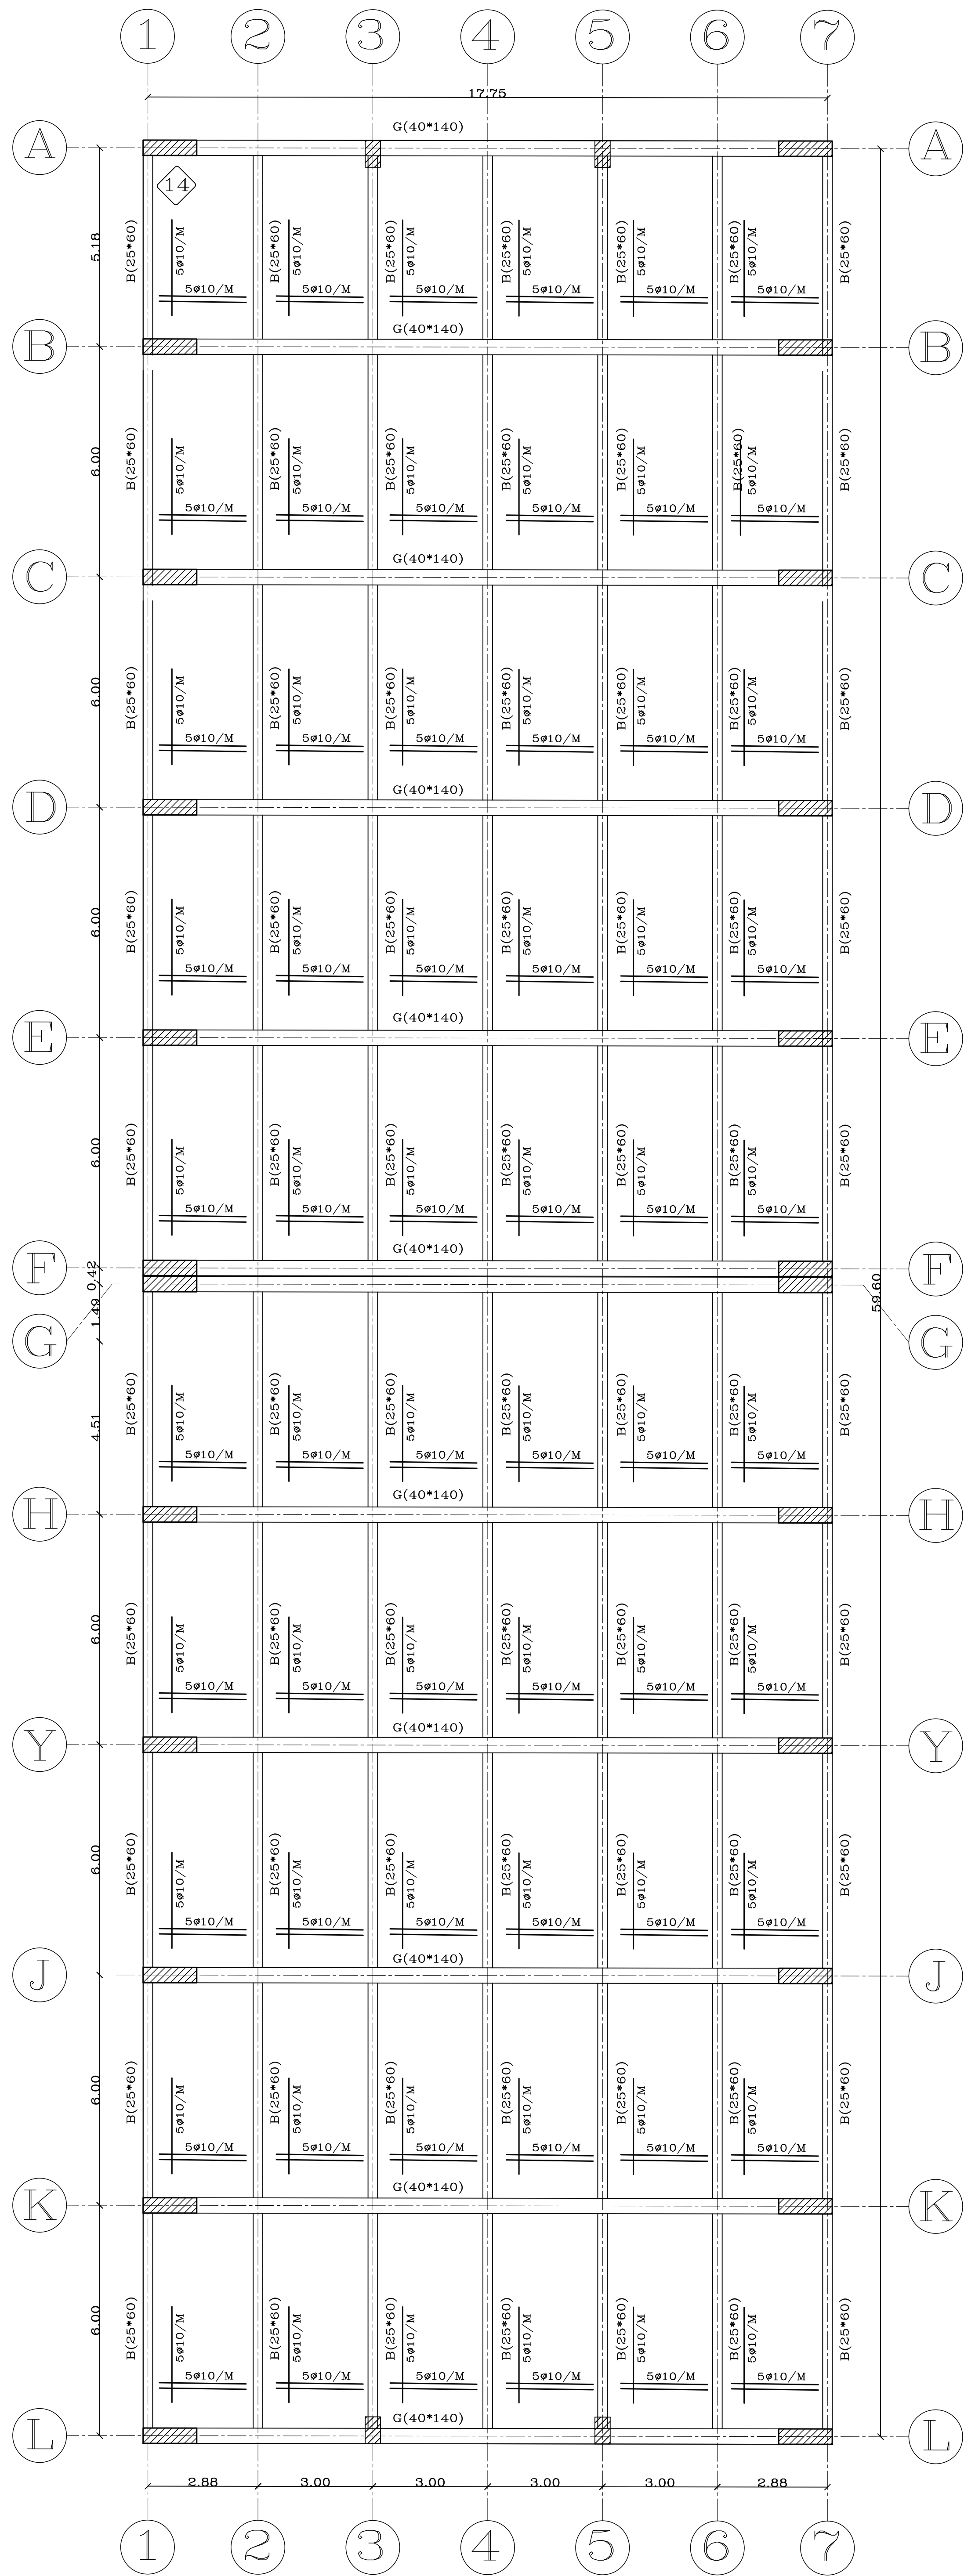

شكل تسليج الكمرات (ط) عند الركائز الطرفية

Beam Table

Beam	Bottom Rft.		Top Rft.		Stirrups	Notes
	S1.	S2.	Str.Hanger	Support		
B1	4ø12	4ø12	2ø12	3ø16	5 ø 8/m	
G	5ø25	5ø25	5ø12	2ø16	5 ø 8/m	



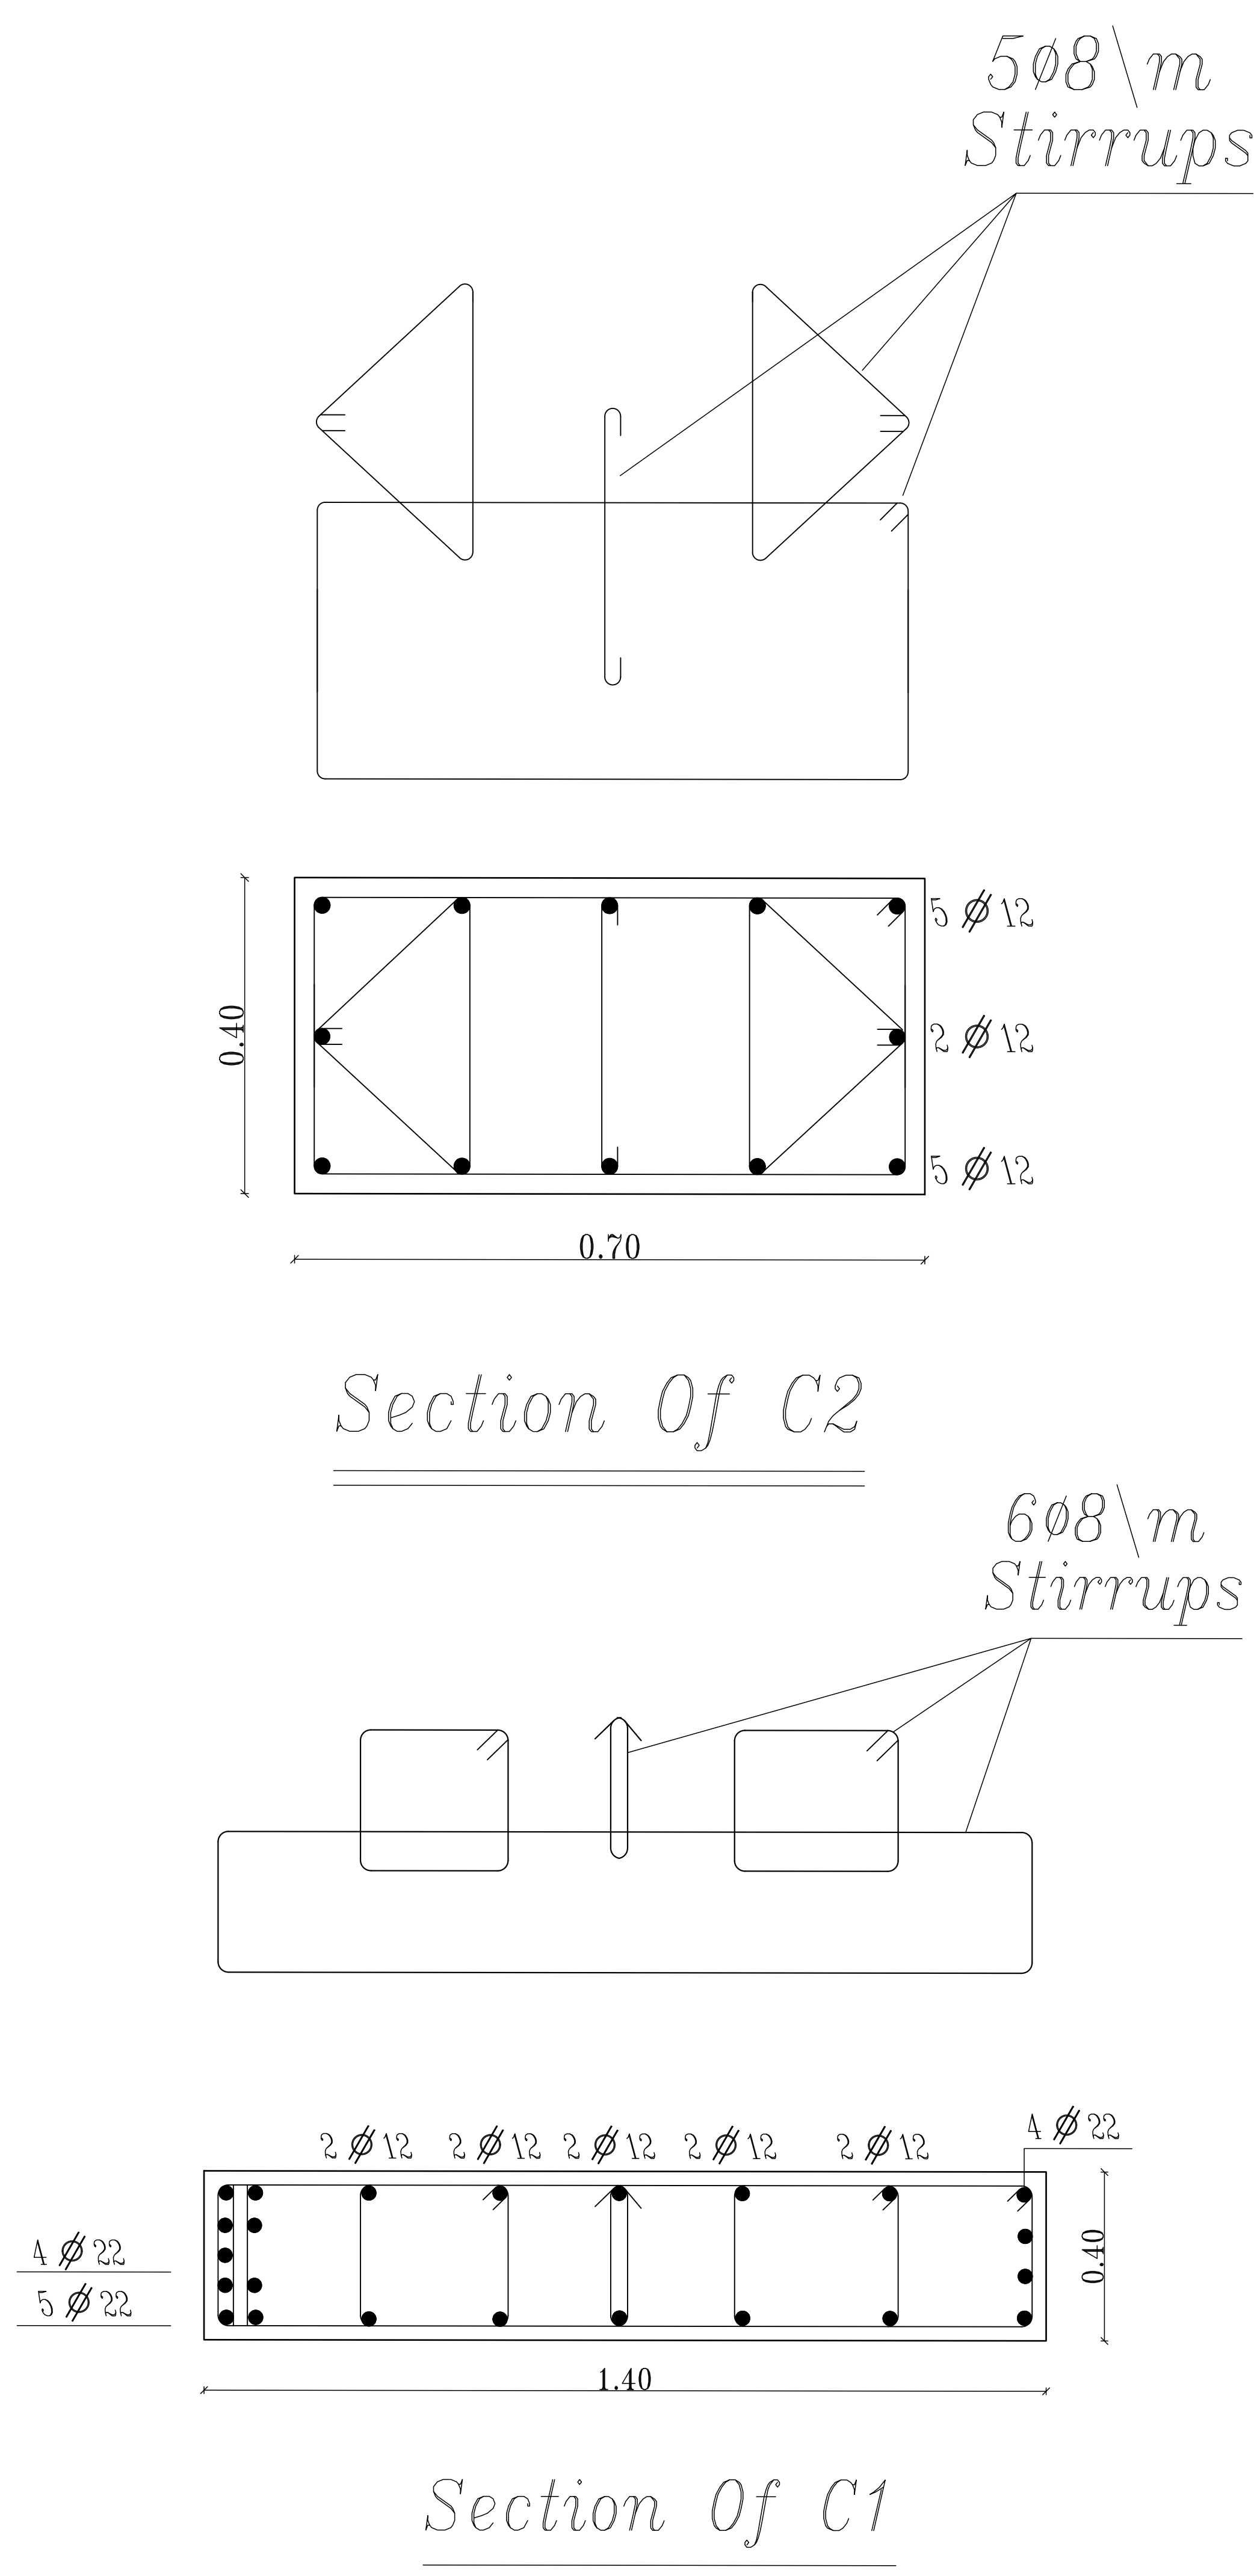


Table Of Column Sections: -

Model No.	Dimension	Rft	Stirrups	Notes
C1	40*140	9Ø22	6Ø8\m	
C2	40*70	12Ø12	5Ø8\m	

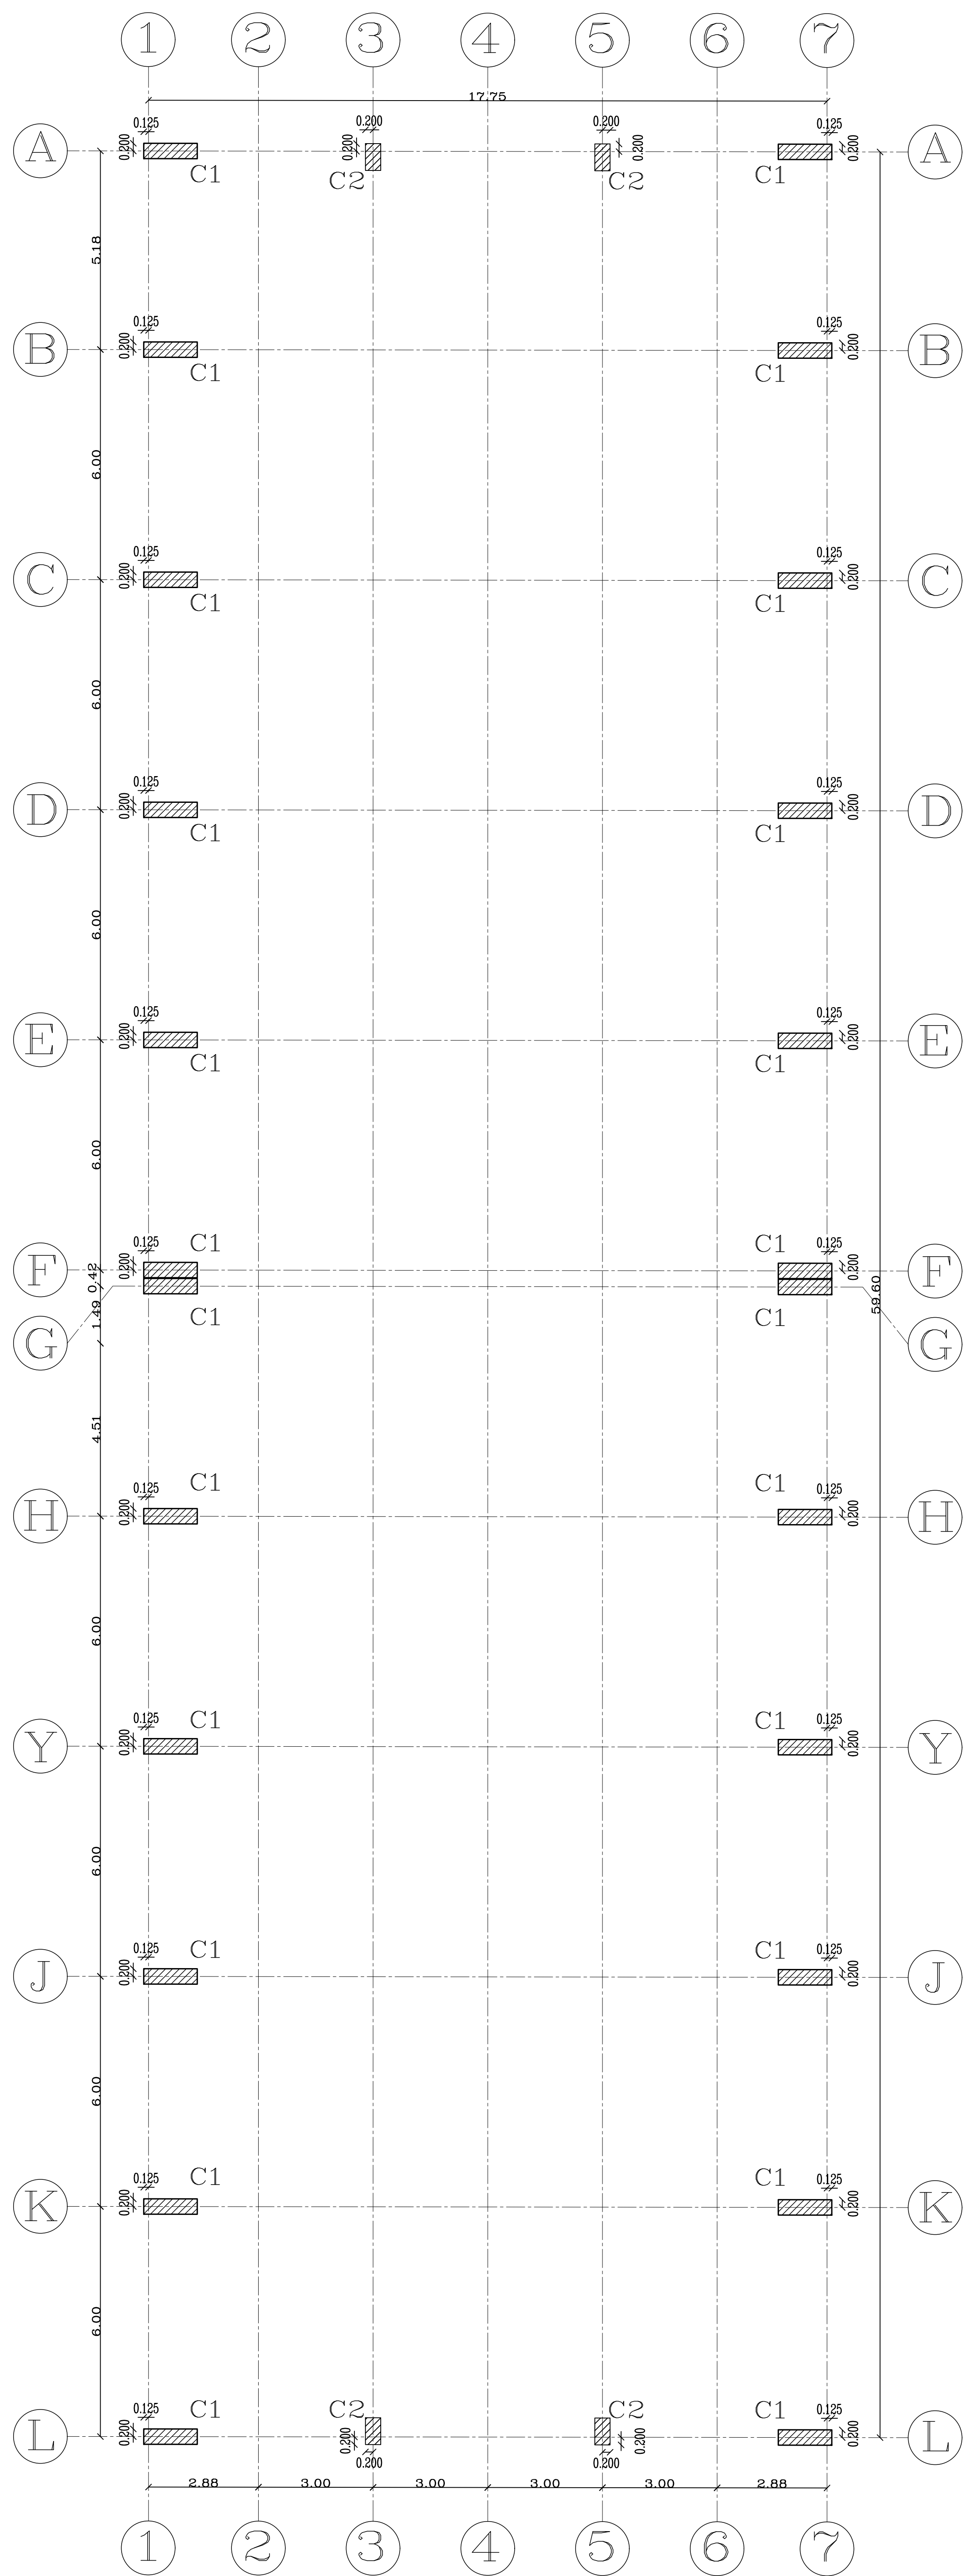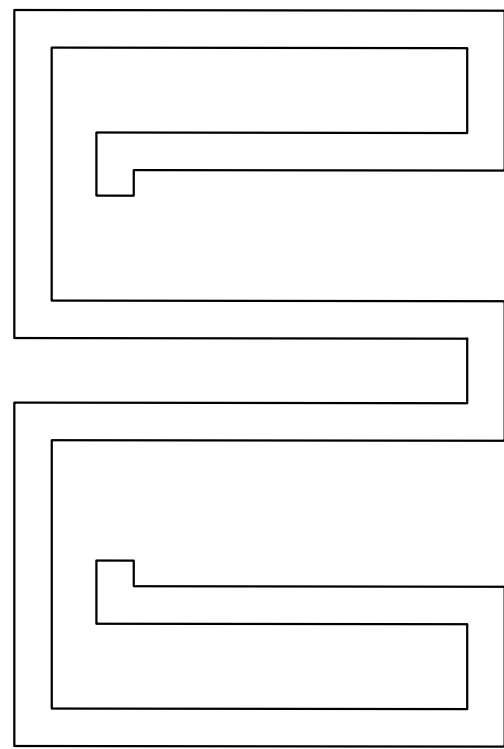

Eslam Ahmed
Engineering services

General Notes


- 1- ALL DIMENSIONS AND AXES SHOULD BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS BEFORE CONSTRUCTION.
- 2- ALL DIMENSION AND LEVELS ARE IN M UNLESS OTHERWISE NOTED ON PLAN.
- 3- THE CUBIC STRENGTH OF R. CONCRETE USED IN ALL R.C. WORKS AFTER 28 DAYS SHOULD NOT BE LESS THAN 250
- 4- THE CEMENT USED FOR BOTH PLAIN AND REINFORCED CONCRETE UNDER GROUND LEVEL IS SULPHATE RESISTENCE POTLAND CEMENT.
- 5- STEEL USED IN RFT. IN R.C. WORK IS HIGH TENSILE STEEL "36/54" FOR DIAMETERS 10 mm AND MILD STEEL "24/35" FOR 8mm.
- 6- THE REINFORCMENT OF COULMNS WILL BE TAKEN FROM COULMNS DETAILS.
- 7- CONCRETE COVER SHOULD NOT LESS THAN 2.5 cm FOR COULMNS.
- 8- DESIGN IS CARRIED TO THE REQUIREMENTS OF THE EGYPTIAN CODE OF PRACTICE (2007).
- 9- CONCRETE USED SHOULD BE VERY DENSE AND CURING MUST BE ACCORDING TO EGYPTIAN CODE OF PRACTICE (2007).
- 10- L0 IS THE BIGEST OF :-
 - a- 1/6 THE CLEARANCE HEIGHT Of Column
 - b- THE BIGEST DIMENTION OF column Section
 - c- 50 CM
- 11- Ld IS THE BIGEST OF 1 m OR 60 .
- 12- CONSTRUCTION JOINTS IN FLOOR WILL BE LOCATED WITHEN THE MIDDLE THIRD OF THE SLABS AND BEAMS.
- 13- SURFACE OF CONSTRUCTION JOINTS WILL BE CLEANED AND LATTANCE REMOVED.

Layout Name: Column and Axis

Project Name: Rectangular halls

Structural Eng: Hossam Esmail

Instructor: Eslam Ahmed




Date:

Project.No

Sheet.No

Scale:

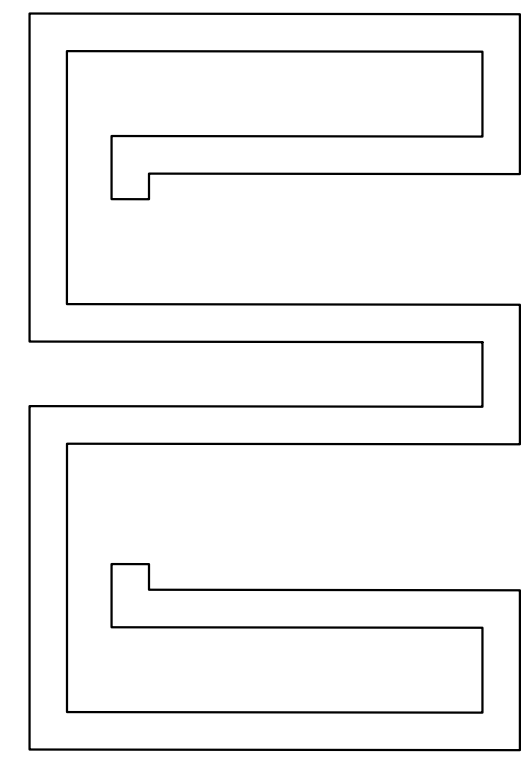

Eslam Ahmed
Engineering services

General Notes


- 1- ALL DIMENSIONS AND AXES SHOULD BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS BEFORE CONSTRUCTION.
- 2- ALL DIMENSION AND LEVELS ARE IN M UNLESS OTHERWISE NOTED ON PLAN.
- 3- THE CUBIC STRENGTH OF R. CONCRETE USED IN ALL R.C. WORKS AFTER 28 DAYS SHOULD NOT BE LESS THAN 250
- 4- THE CEMENT USED FOR BOTH PLAIN AND REINFORCED CONCRETE UNDER GROUND LEVEL IS SULPHATE RESISTENCE POTLAND CEMENT.
- 5- STEEL USED IN RFT. IN R.C. WORK IS HIGH TENSILE STEEL "36/54" FOR DIAMETERS 10 mm AND MILD STEEL "24/35" FOR 8mm.
- 6- THE REINFORCMENT OF COULMNS WILL BE TAKEN FROM COULMNS DETAILS.
- 7- CONCRETE COVER SHOULD NOT LESS THAN 2.5 cm FOR COULMNS.
- 8- DESIGN IS CARRIED TO THE REQUIREMENTS OF THE EGYPTIAN CODE OF PRACTICE (2007).
- 9- CONCRETE USED SHOULD BE VERY DENSE AND CURING MUST BE ACCORDING TO EGYPTIAN CODE OF PRACTICE (2007).
- 10- L0 IS THE BIGEST OF :-
 - a- 1/6 THE CLEARANCE HEIGHT Of Column
 - b- THE BIGEST DIMENTION OF column Section
 - c- 50 CM
- 11- Ld IS THE BIGEST OF 1 m OR 60 .
- 12- CONSTRUCTION JOINTS IN FLOOR WILL BE LOCATED WITHEN THE MIDDLE THIRD OF THE SLABS AND BEAMS.
- 13- SURFACE OF CONSTRUCTION JOINTS WILL BE CLEANED AND LATTANCE REMOVED.

Layout Name: Foundation


Project Name: Rectangular halls

Structural Eng: Hossam Esmail


Instructor: Eslam Ahmed




Date:	Project.No	Sheet.No
Scale:		

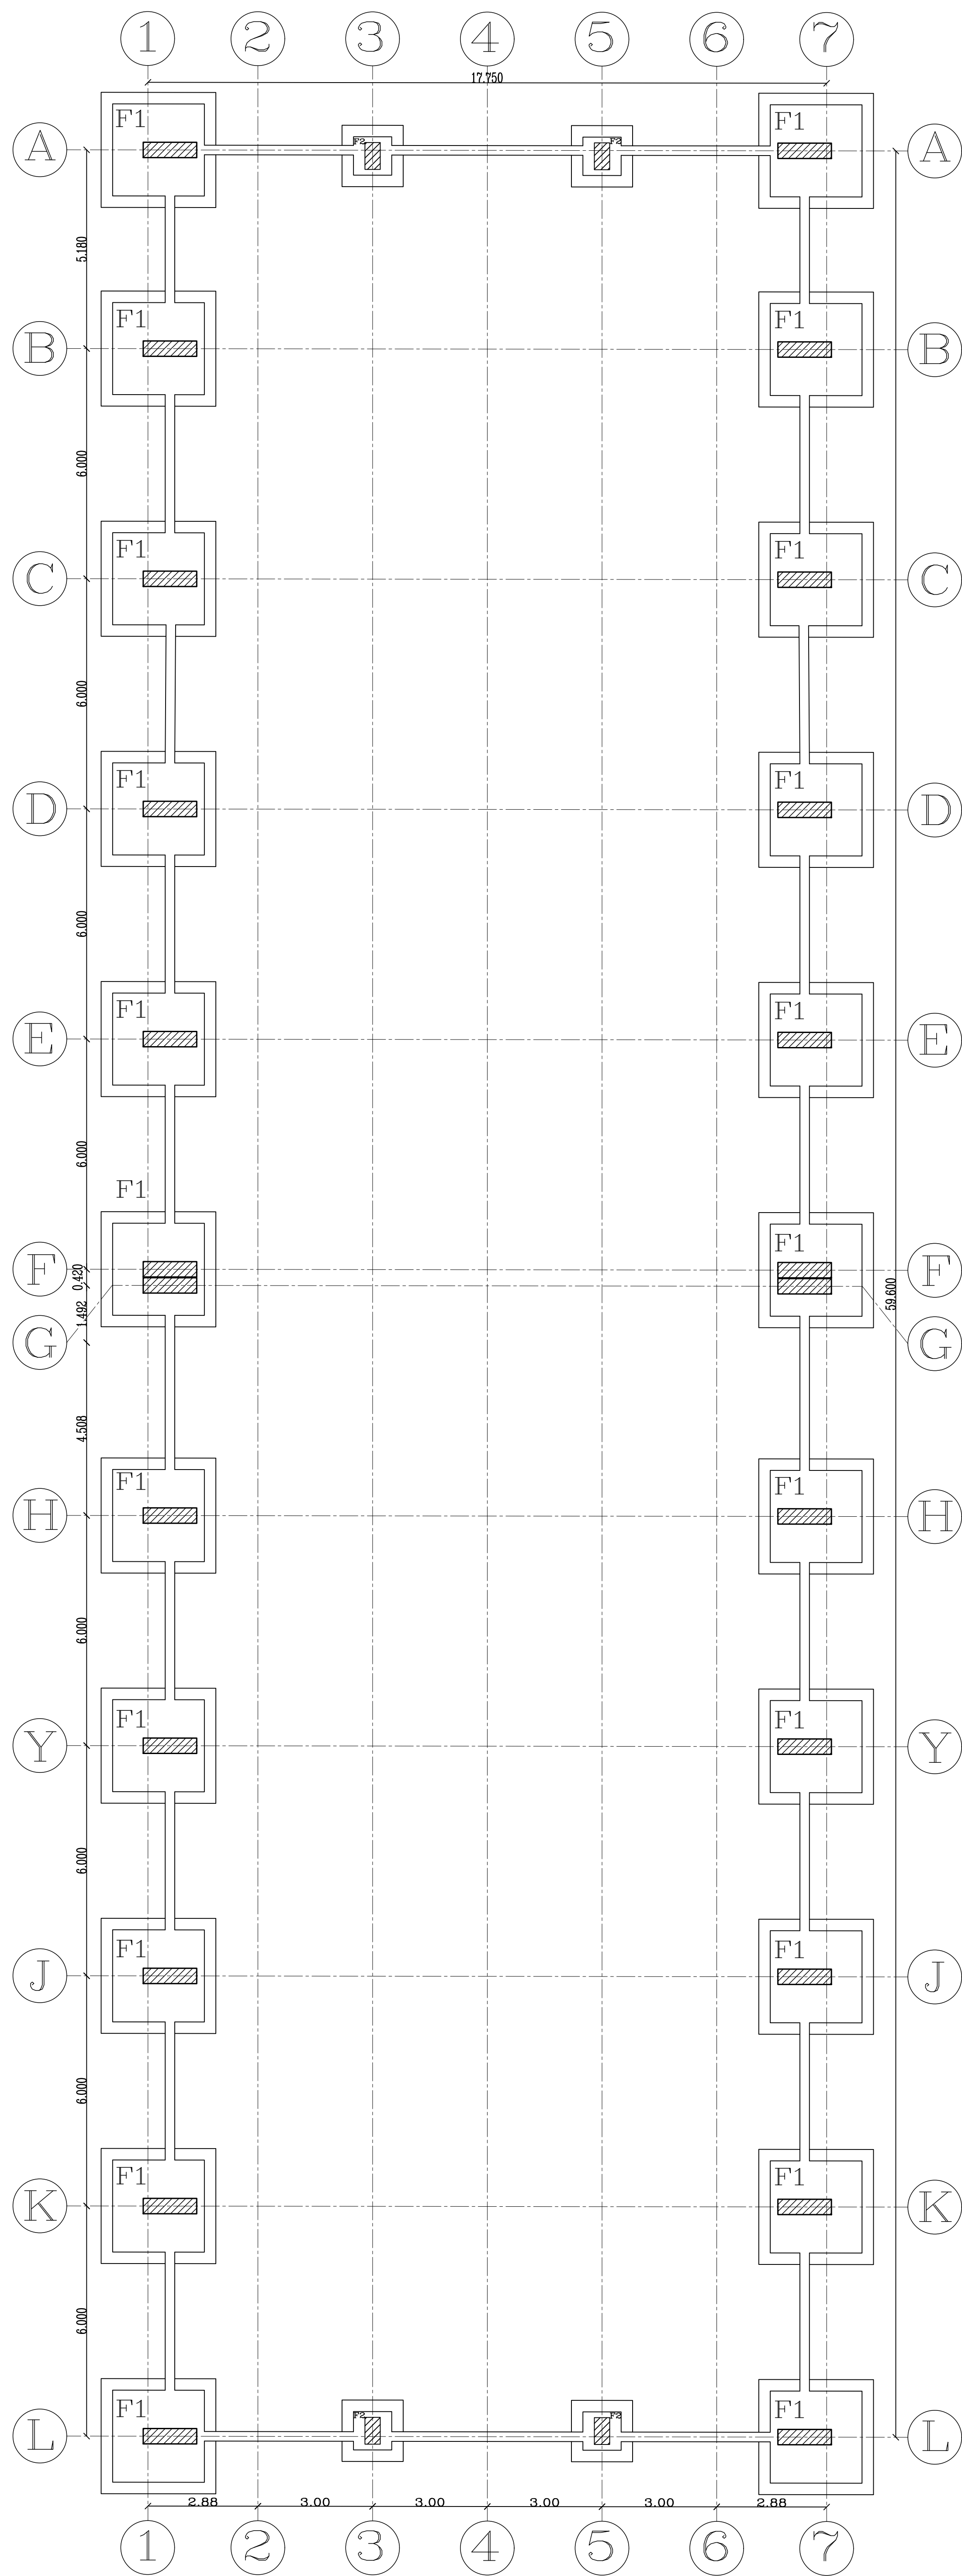


Stirrups
5ø8\m

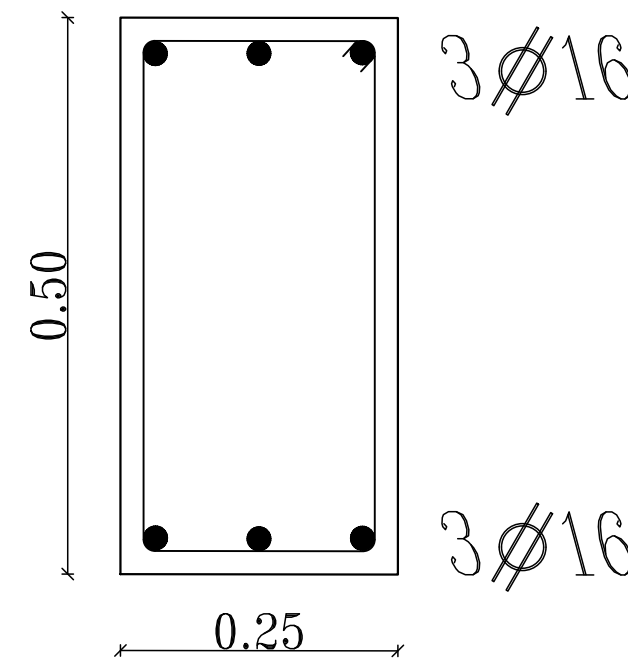

Section Of Smell

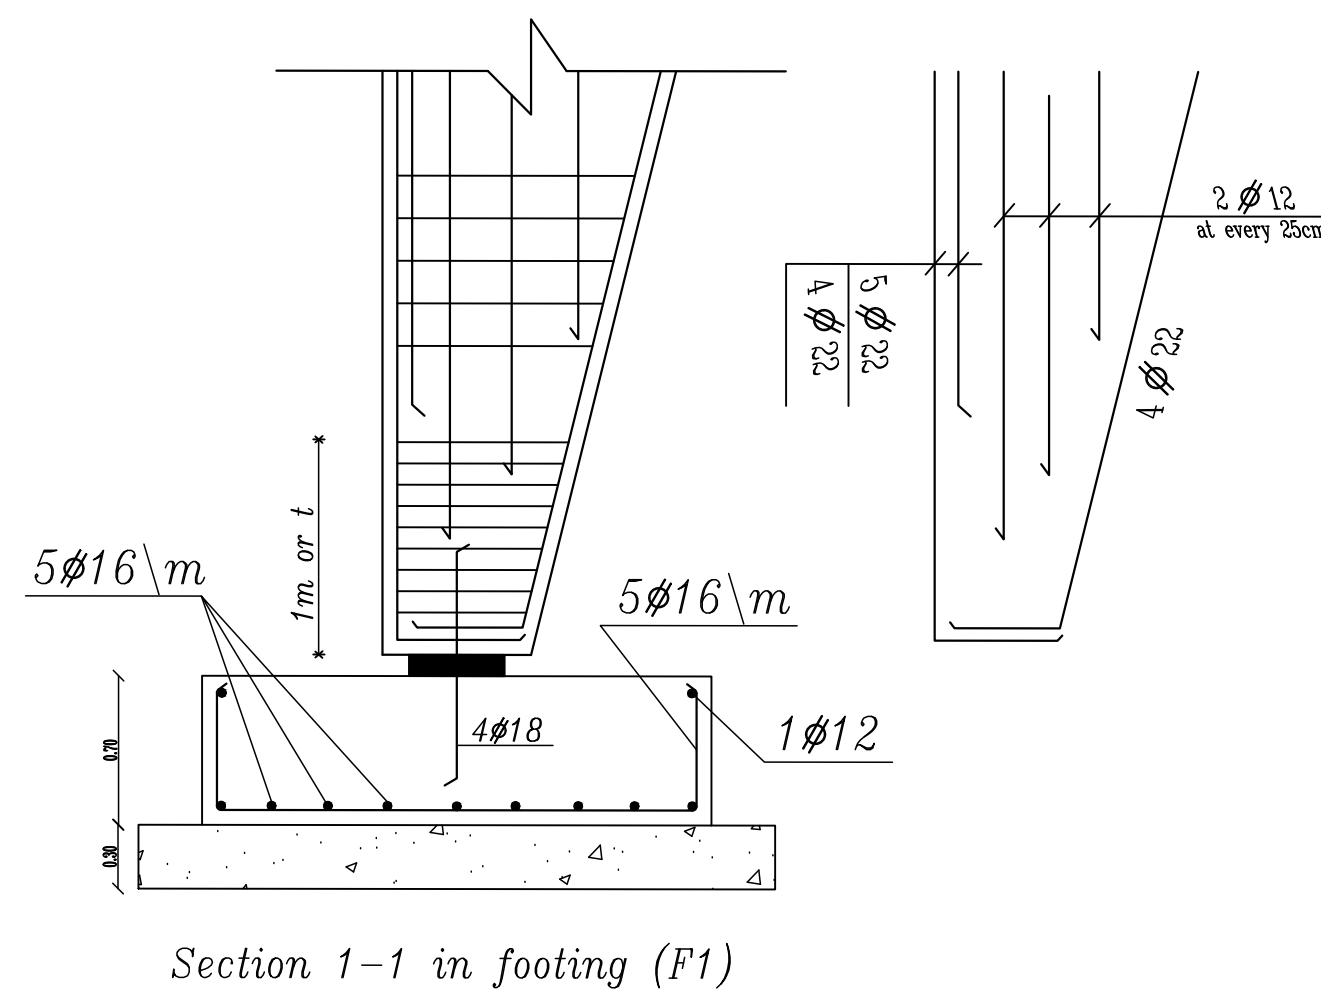


Plan Of footing (F1)

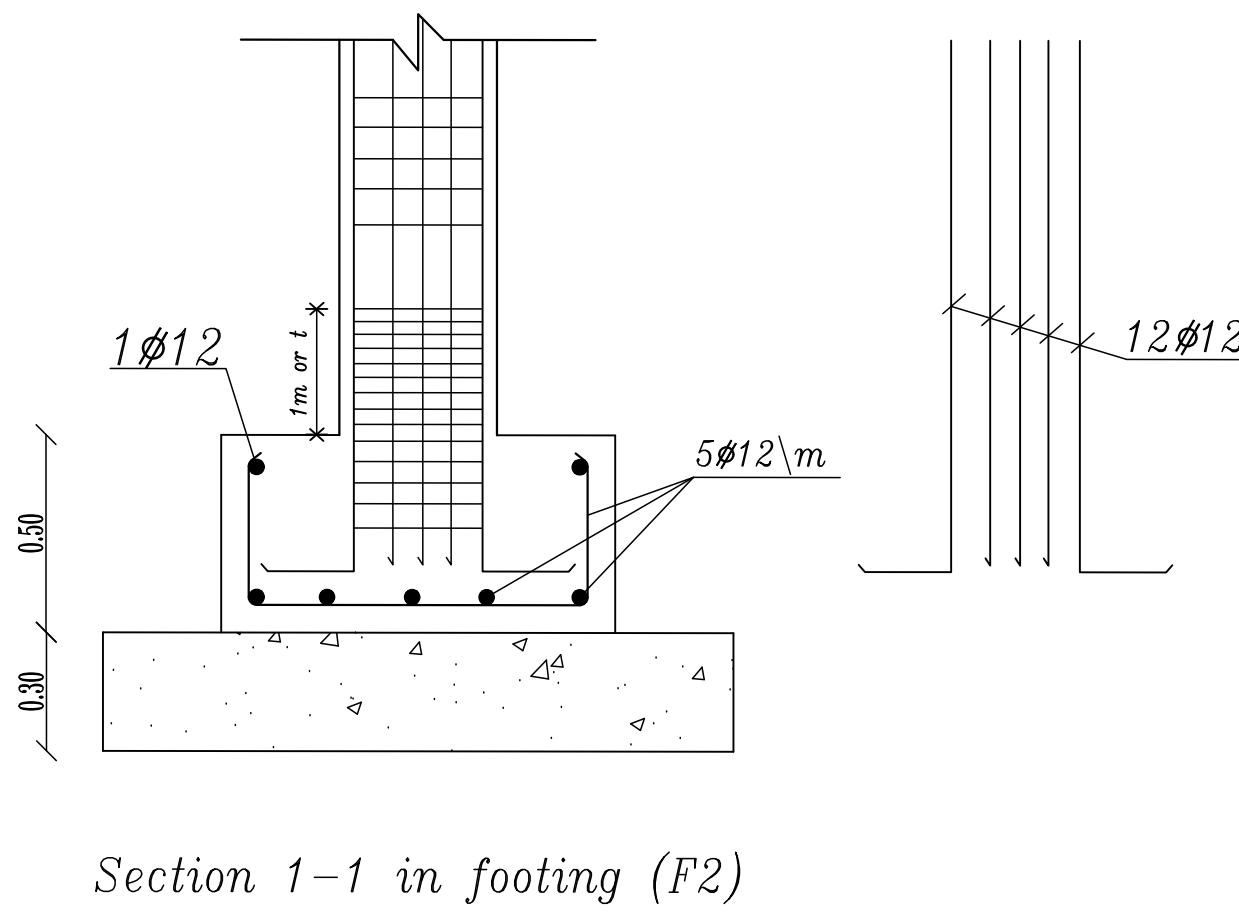

Plan Of footing (F2)

Table Of Footings Sections: -

Sections	plain Concrete			Reinforced Concrete			Bottom Steel\m		Top steel\m	
	Length	width	thickness	Length	width	thickness	short	Long	short	Long
F1	3.00	3.00	0.30	2.40	2.40	0.70	5ø16\m	5ø16\m	--	--
F2	1.60	1.60	0.30	1.00	1.00	0.50	5ø12\m	5ø12\m		

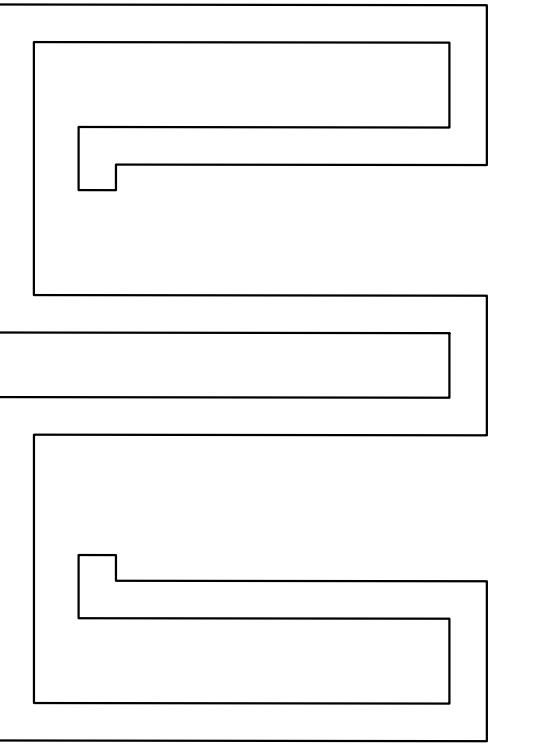

Eslam Ahmed
Engineering services

General Notes


- 1- ALL DIMENSIONS AND AXES SHOULD BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS BEFORE CONSTRUCTION.
- 2- ALL DIMENSION AND LEVELS ARE IN M UNLESS OTHERWISE NOTED ON PLAN.
- 3- THE CUBIC STRENGTH OF R. CONCRETE USED IN ALL R.C. WORKS AFTER 28 DAYS SHOULD NOT BE LESS THAN 250
- 4- THE CEMENT USED FOR BOTH PLAIN AND REINFORCED CONCRETE UNDER GROUND LEVEL IS SULPHATE RESISTENCE POTLAND CEMENT.
- 5- STEEL USED IN RFT. IN R.C. WORK IS HIGH TENSILE STEEL "36/54" FOR DIAMETERS 10 mm AND MILD STEEL "24/35" FOR 8mm.
- 6- THE REINFORCMENT OF COULMNS WILL BE TAKEN FROM COULMNS DETAILS.
- 7- CONCRETE COVER SHOULD NOT LESS THAN 2.5 cm FOR COULMNS.
- 8- DESIGN IS CARRIED TO THE REQUIREMENTS OF THE EGYPTIAN CODE OF PRACTICE (2007).
- 9- CONCRETE USED SHOULD BE VERY DENSE AND CURING MUST BE ACCORDING TO EGYPTIAN CODE OF PRACTICE (2007).
- 10- L0 IS THE BIGEST OF :-
 - a- 1/6 THE CLEARANCE HEIGHT Of Column
 - b- THE BIGEST DIMENTION OF column Section
 - c- 50 CM
- 11- Ld IS THE BIGEST OF 1 m OR 60 .
- 12- CONSTRUCTION JOINTS IN FLOOR WILL BE LOCATED WITHEN THE MIDDLE THIRD OF THE SLABS AND BEAMS.
- 13- SURFACE OF CONSTRUCTION JOINTS WILL BE CLEANED AND LATTANCE REMOVED.

Layout Name: Sections

Project Name: Rectangular halls

Structural Eng: Hossam Esmail

Instructor: Eslam Ahmed



Date:

Project.No

Sheet.No

Scale:

