


Filter output power

- △ DB(|Pharm(M_PROBE.VP1)|)[*] (dBm)
Noise with filter.AP_HB
- DB(|Pharm(M_PROBE.VP2)|)[*] (dBm)
Noise with filter.AP_HB
- ◇ DB(|Pharm(M_PROBE.VP2)|)[*] (dBm)
Noise with filter 2.AP_HB

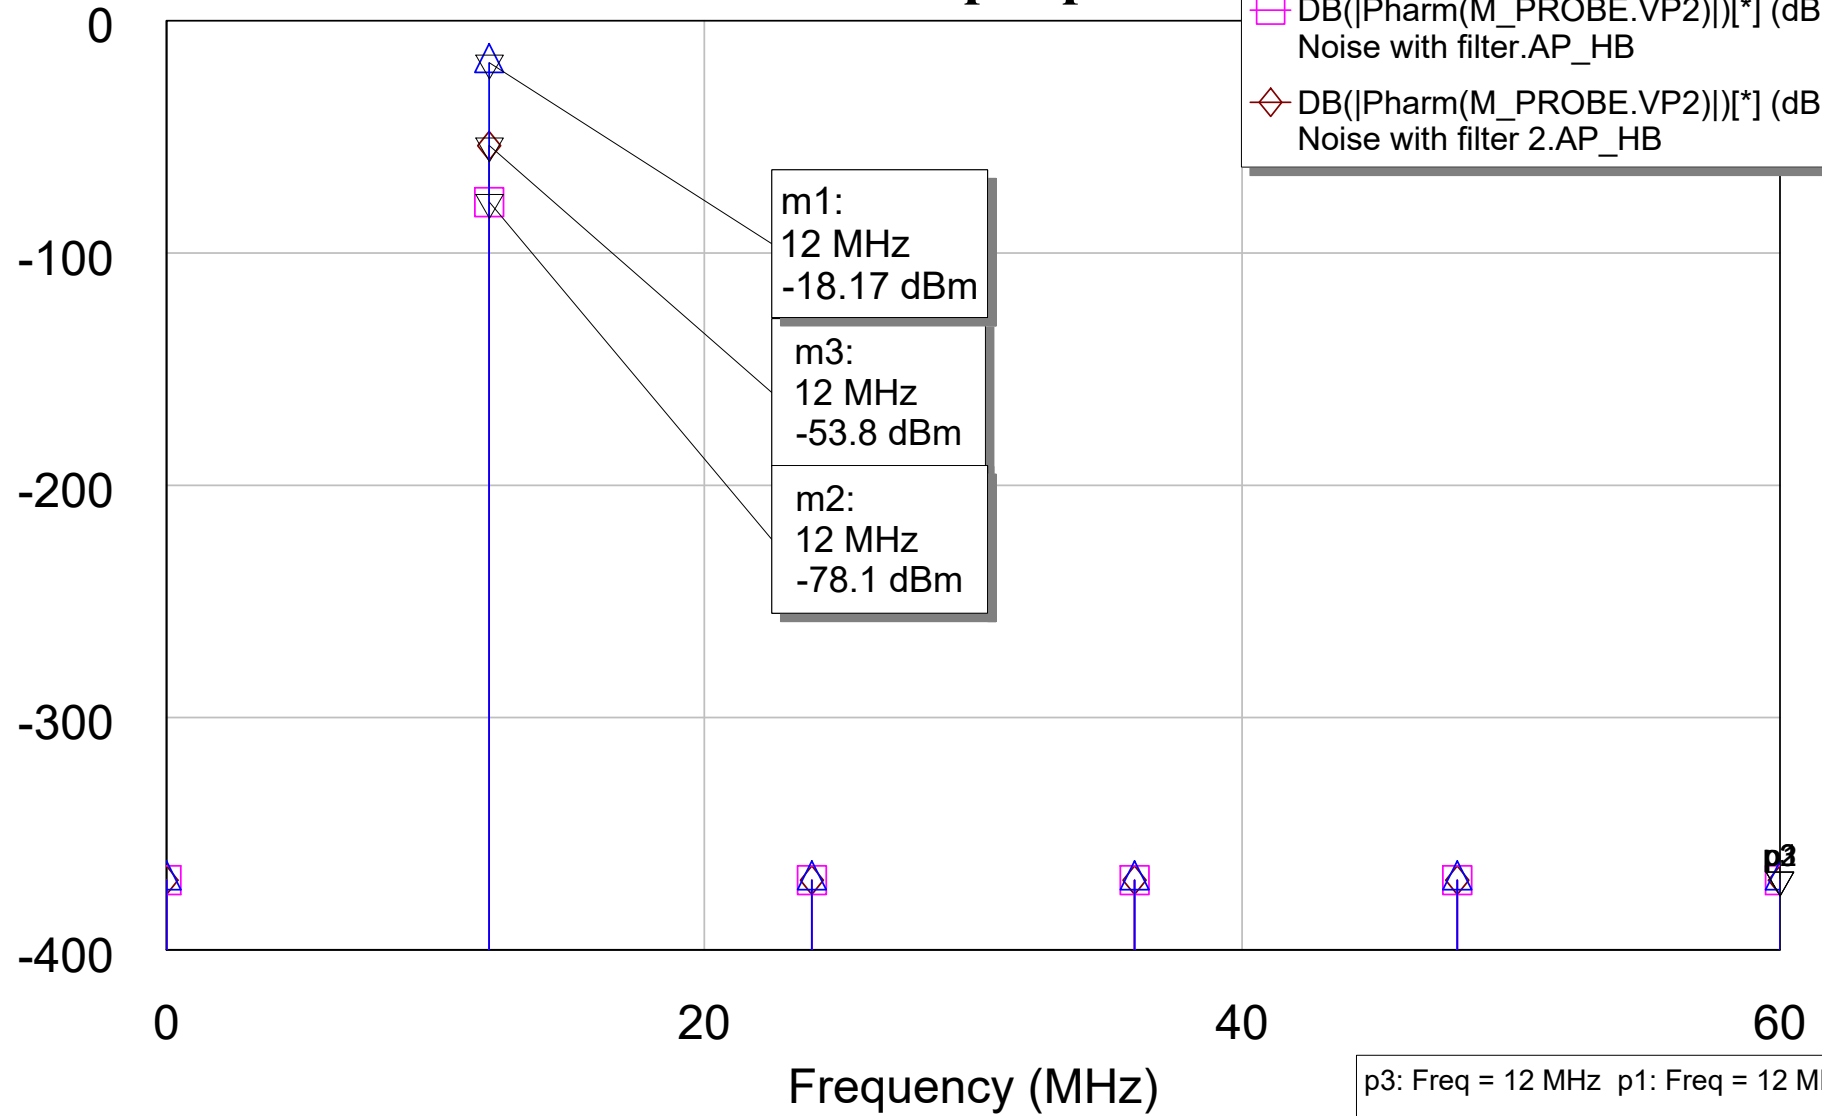

p3: Freq = 12 MHz p1: Freq = 12 MHz
p2: Freq = 12 MHz