
CERTIFICATE OF ANALYSIS

Size : 1-3 mm **Date : 11/10/2026**

SIEVE ANALYSIS

Microns	4000	3350	2800	2360	2000	1700	1400	1180	1000	850	Pan
Results (%)	0.00	0.10	1.35	19.80	33.25	25.10	15.60	3.45	0.75	0.20	0.40

Sieve Analysis — Particle Size Distribution

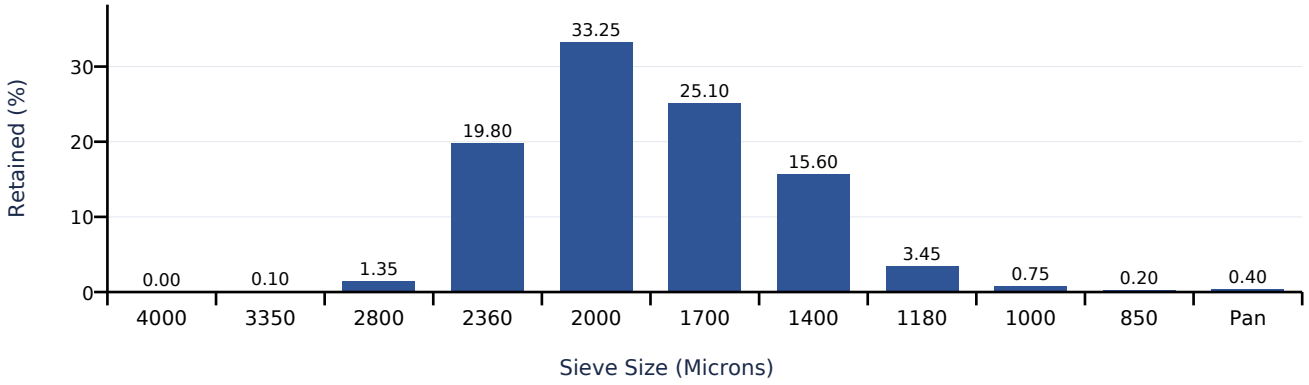


MOISTURE CONTENT

Property	Result	Unit	Status
Moisture Content	0.12	%	**PASS ✓**

CHEMICAL COMPOSITION

Compound	MgO	Al_2O_3	SiO_2	CaO	Fe_2O_3	CaCO3
Conc. %	3.274	0.486	1.889	52.539	0.534	93.782

Compounds in the Form of Oxides

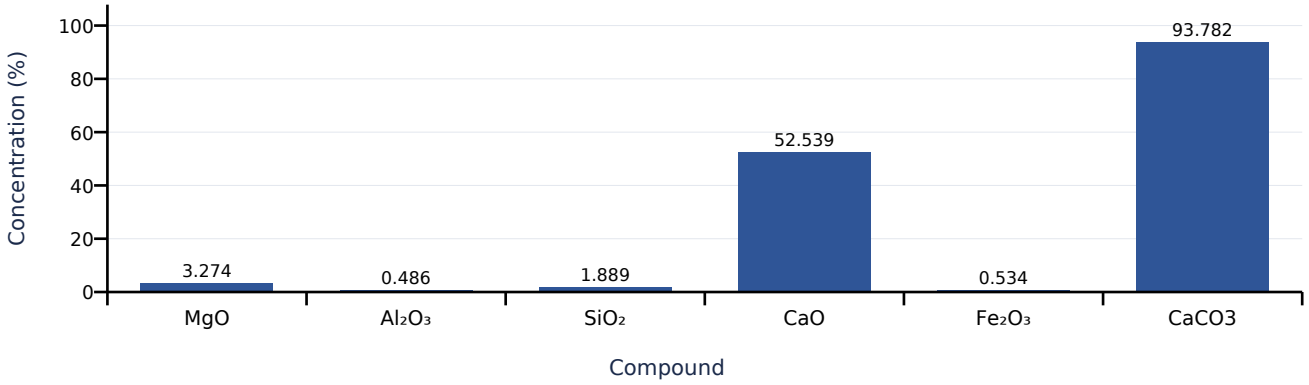

PREPARED BY QC : **STAMP:** **APPROVED BY QC MANAGER :**





