
CERTIFICATE OF ANALYSIS

Size : 10-20 mm - (3/4) **Date : 11/10/2026**

SIEVE ANALYSIS						
Microns	**25000**	**19000**	**16000**	**11200**	**9500**	**Pan**
Results (%)	0.00	21.15	72.60	6.25	0.00	0.00


Sieve Analysis — Particle Size Distribution

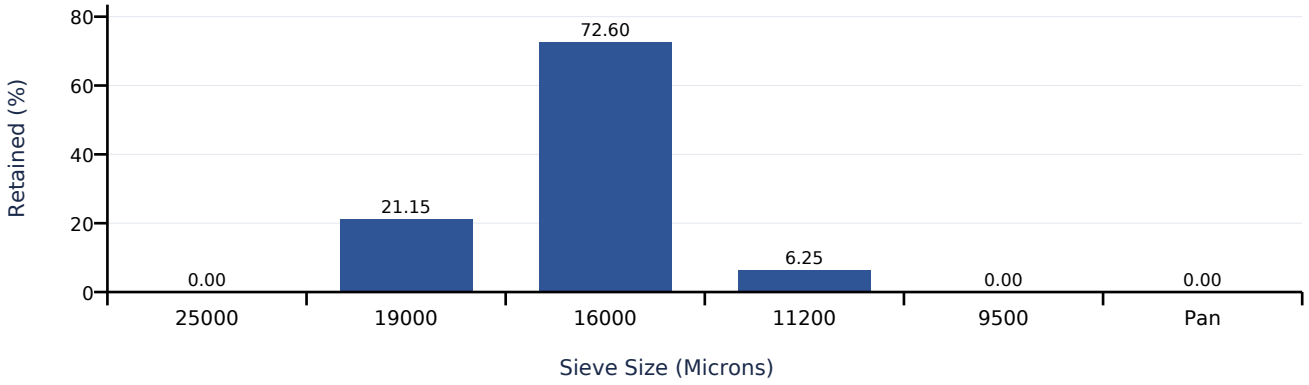

MOISTURE CONTENT			
Property	**Result**	**Unit**	**Status**
Moisture Content	0.10	%	**PASS ✓**

CHEMICAL COMPOSITION						
Compound	**MgO**	**Al_2O_3**	**SiO_2**	**CaO**	**Fe_2O_3**	**CaCO3**
Conc. %	1.999	0.347	1.722	53.537	0.273	95.564

Compounds in the Form of Oxides

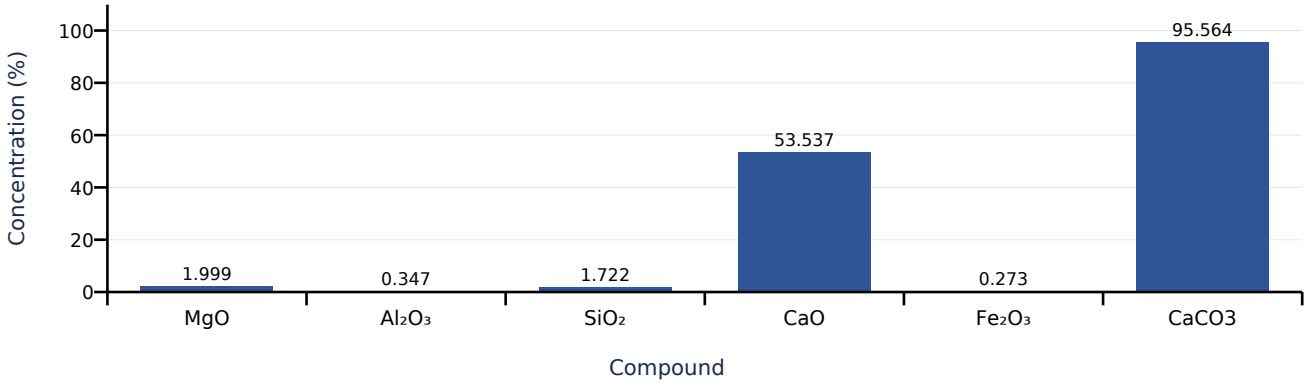

PREPARED BY QC : **STAMP:** **APPROVED BY QC MANAGER :**





