
CERTIFICATE OF ANALYSIS

Size : 2-4 mm **Date : 11/10/2026**

SIEVE ANALYSIS

Microns	4750	4000	3350	2800	2360	2000	1700	1400	1180	1000	Pan
Results (%)	0.55	5.80	15.60	26.85	30.00	14.40	5.05	0.90	0.85	0.00	0.00

Sieve Analysis — Particle Size Distribution

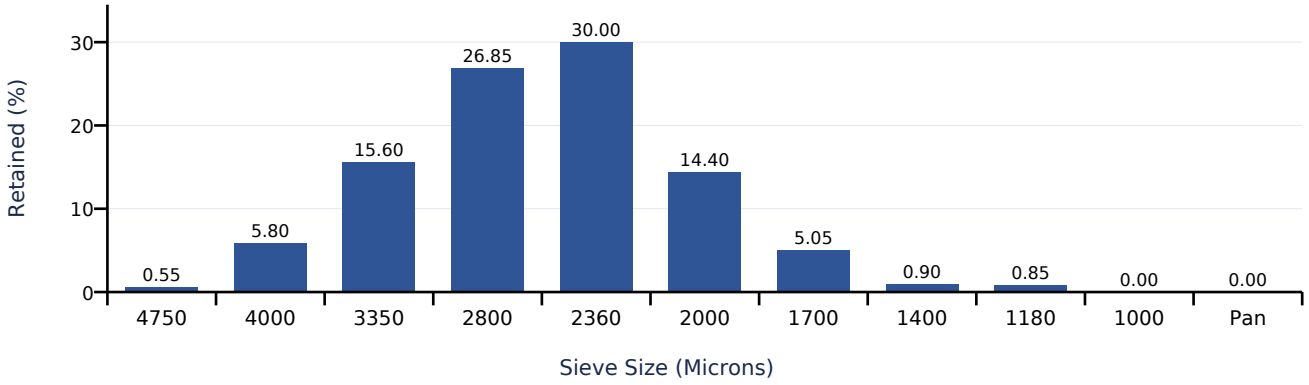


MOISTURE CONTENT

Property	Result	Unit	Status
Moisture Content	0.12	%	**PASS ✓**

CHEMICAL COMPOSITION

Compound	MgO	Al_2O_3	SiO_2	CaO	Fe_2O_3	CaCO3
Conc. %	2.955	0.381	1.390	53.799	0.258	96.031

Compounds in the Form of Oxides

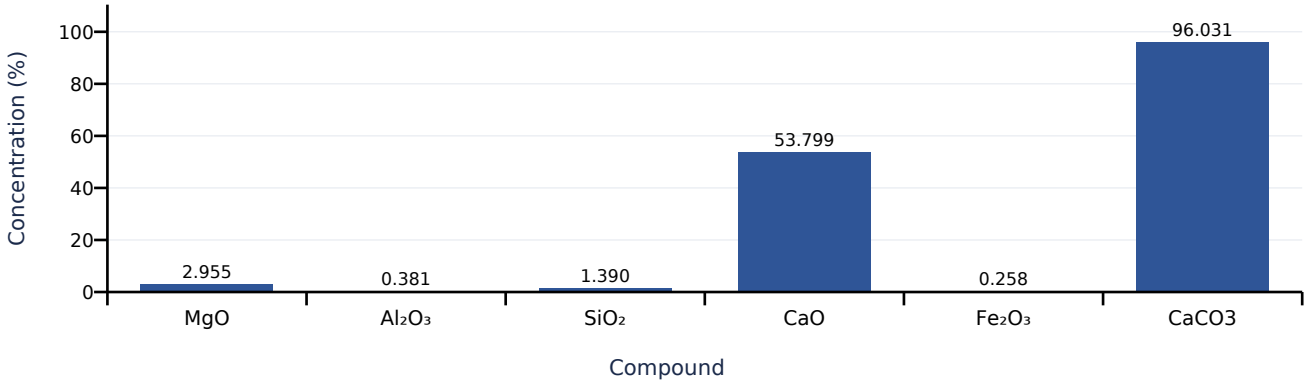

PREPARED BY QC : **STAMP:** **APPROVED BY QC MANAGER :**





