
CERTIFICATE OF ANALYSIS

Size : 10-20 mm - (3/4)	Date : 11/10/2026

SIEVE ANALYSIS

Microns	25000	19000	16000	11200	9500	Pan
Results (%)	0.00	21.15	72.60	6.25	0.00	0.00

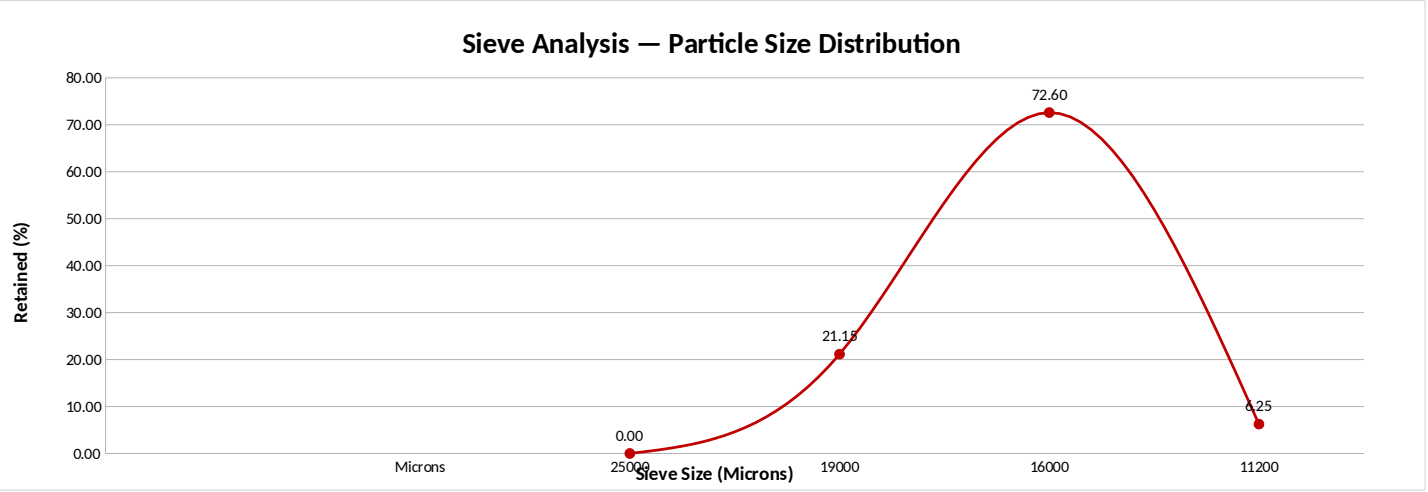


MOISTURE CONTENT

Property	Result	Unit	Status
Moisture Content	0.10	%	PASS ✓

CHEMICAL COMPOSITION

Compound	MgO	Al_2O_3	SiO_2	CaO	Fe_2O_3	CaCO3
Conc. %	1.999	0.347	1.722	53.537	0.273	95.564

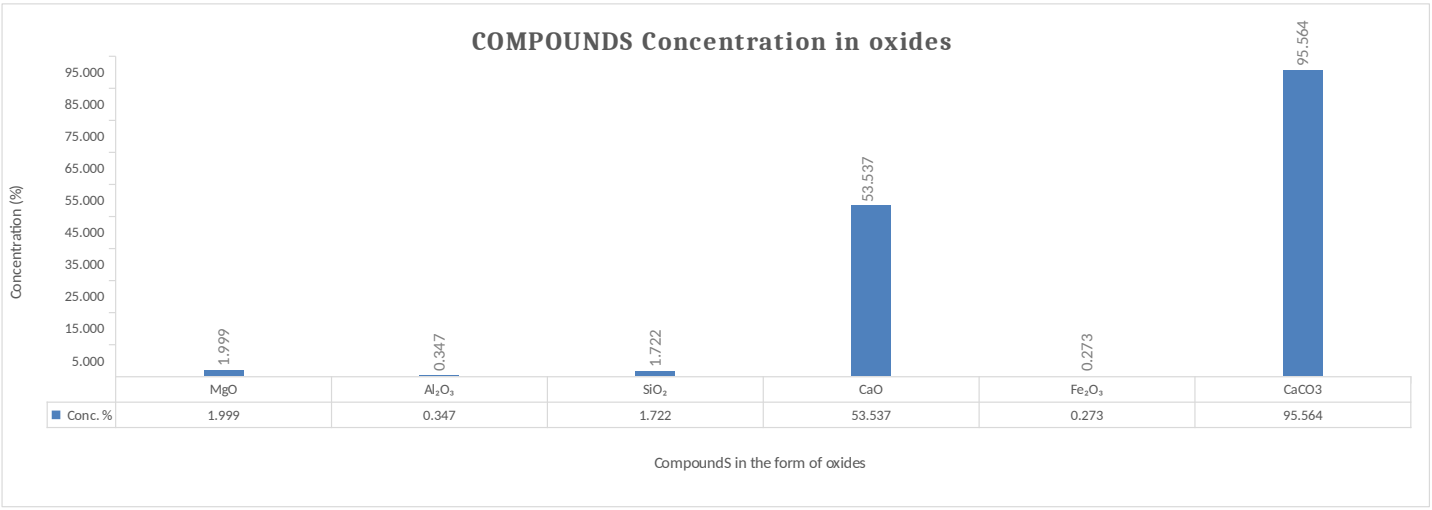

PREPARED BY QC :

STAMP:

APPROVED BY QC MANAGER :