Add

Boolean

- stop OFF
- latch OFF
- topLS OFF
- bottomLS OFF
- middleLS OFF
- motorup OFF
- gateup_PB OFF
- salitysensor OFF
- gateuplamp OFF
- Ult_sonicsea OFF
- ultras_bar OFF
- motordown OFF
- bottom_PB OFF
- gatebotlamp OFF
- middlePB OFF
- gatemidlamp OFF
- upOLrelay OFF
- DownOLrelay OFF

Contacts | Coils | Math | Compare | Time/Count | Other

Save | Add Rung | Trash

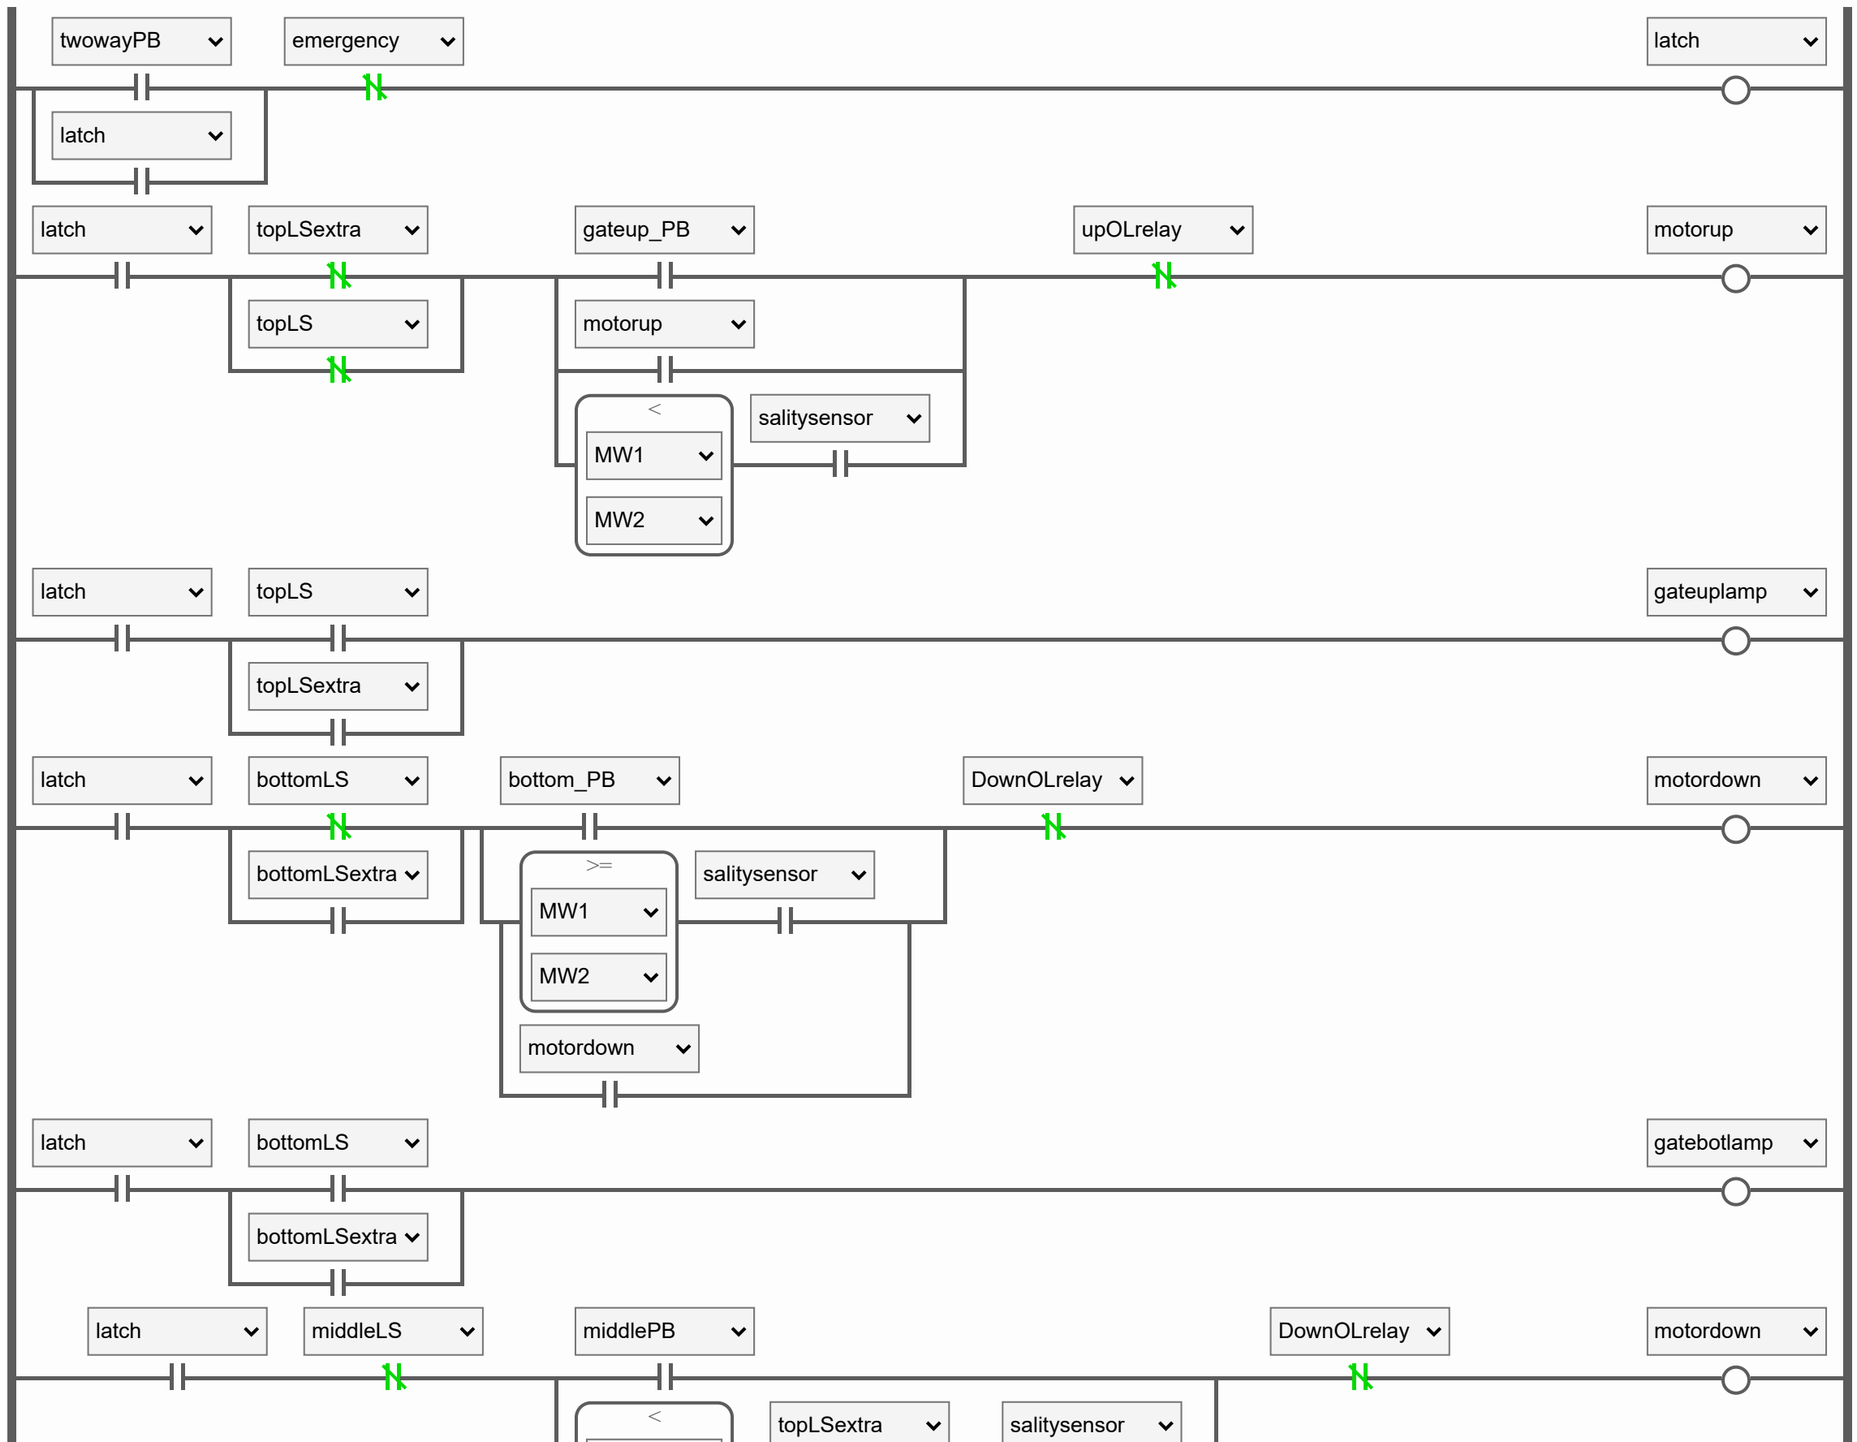

- twowayPB OFF
- emergency OFF
- topLSextra OFF
- bottomLSextra OFF
- MW1 0
- MW2 0
- pumpPB OFF
- pumpon OFF
- HeatC1 OFF
- Heat1temp OFF
- S1 0
- S2 0
- T1 100
- T2 130
- heatgen OFF
- pressure 0
- pressure1 0
- valve1 OFF
- Cham2T 0
- Cham2T1 0

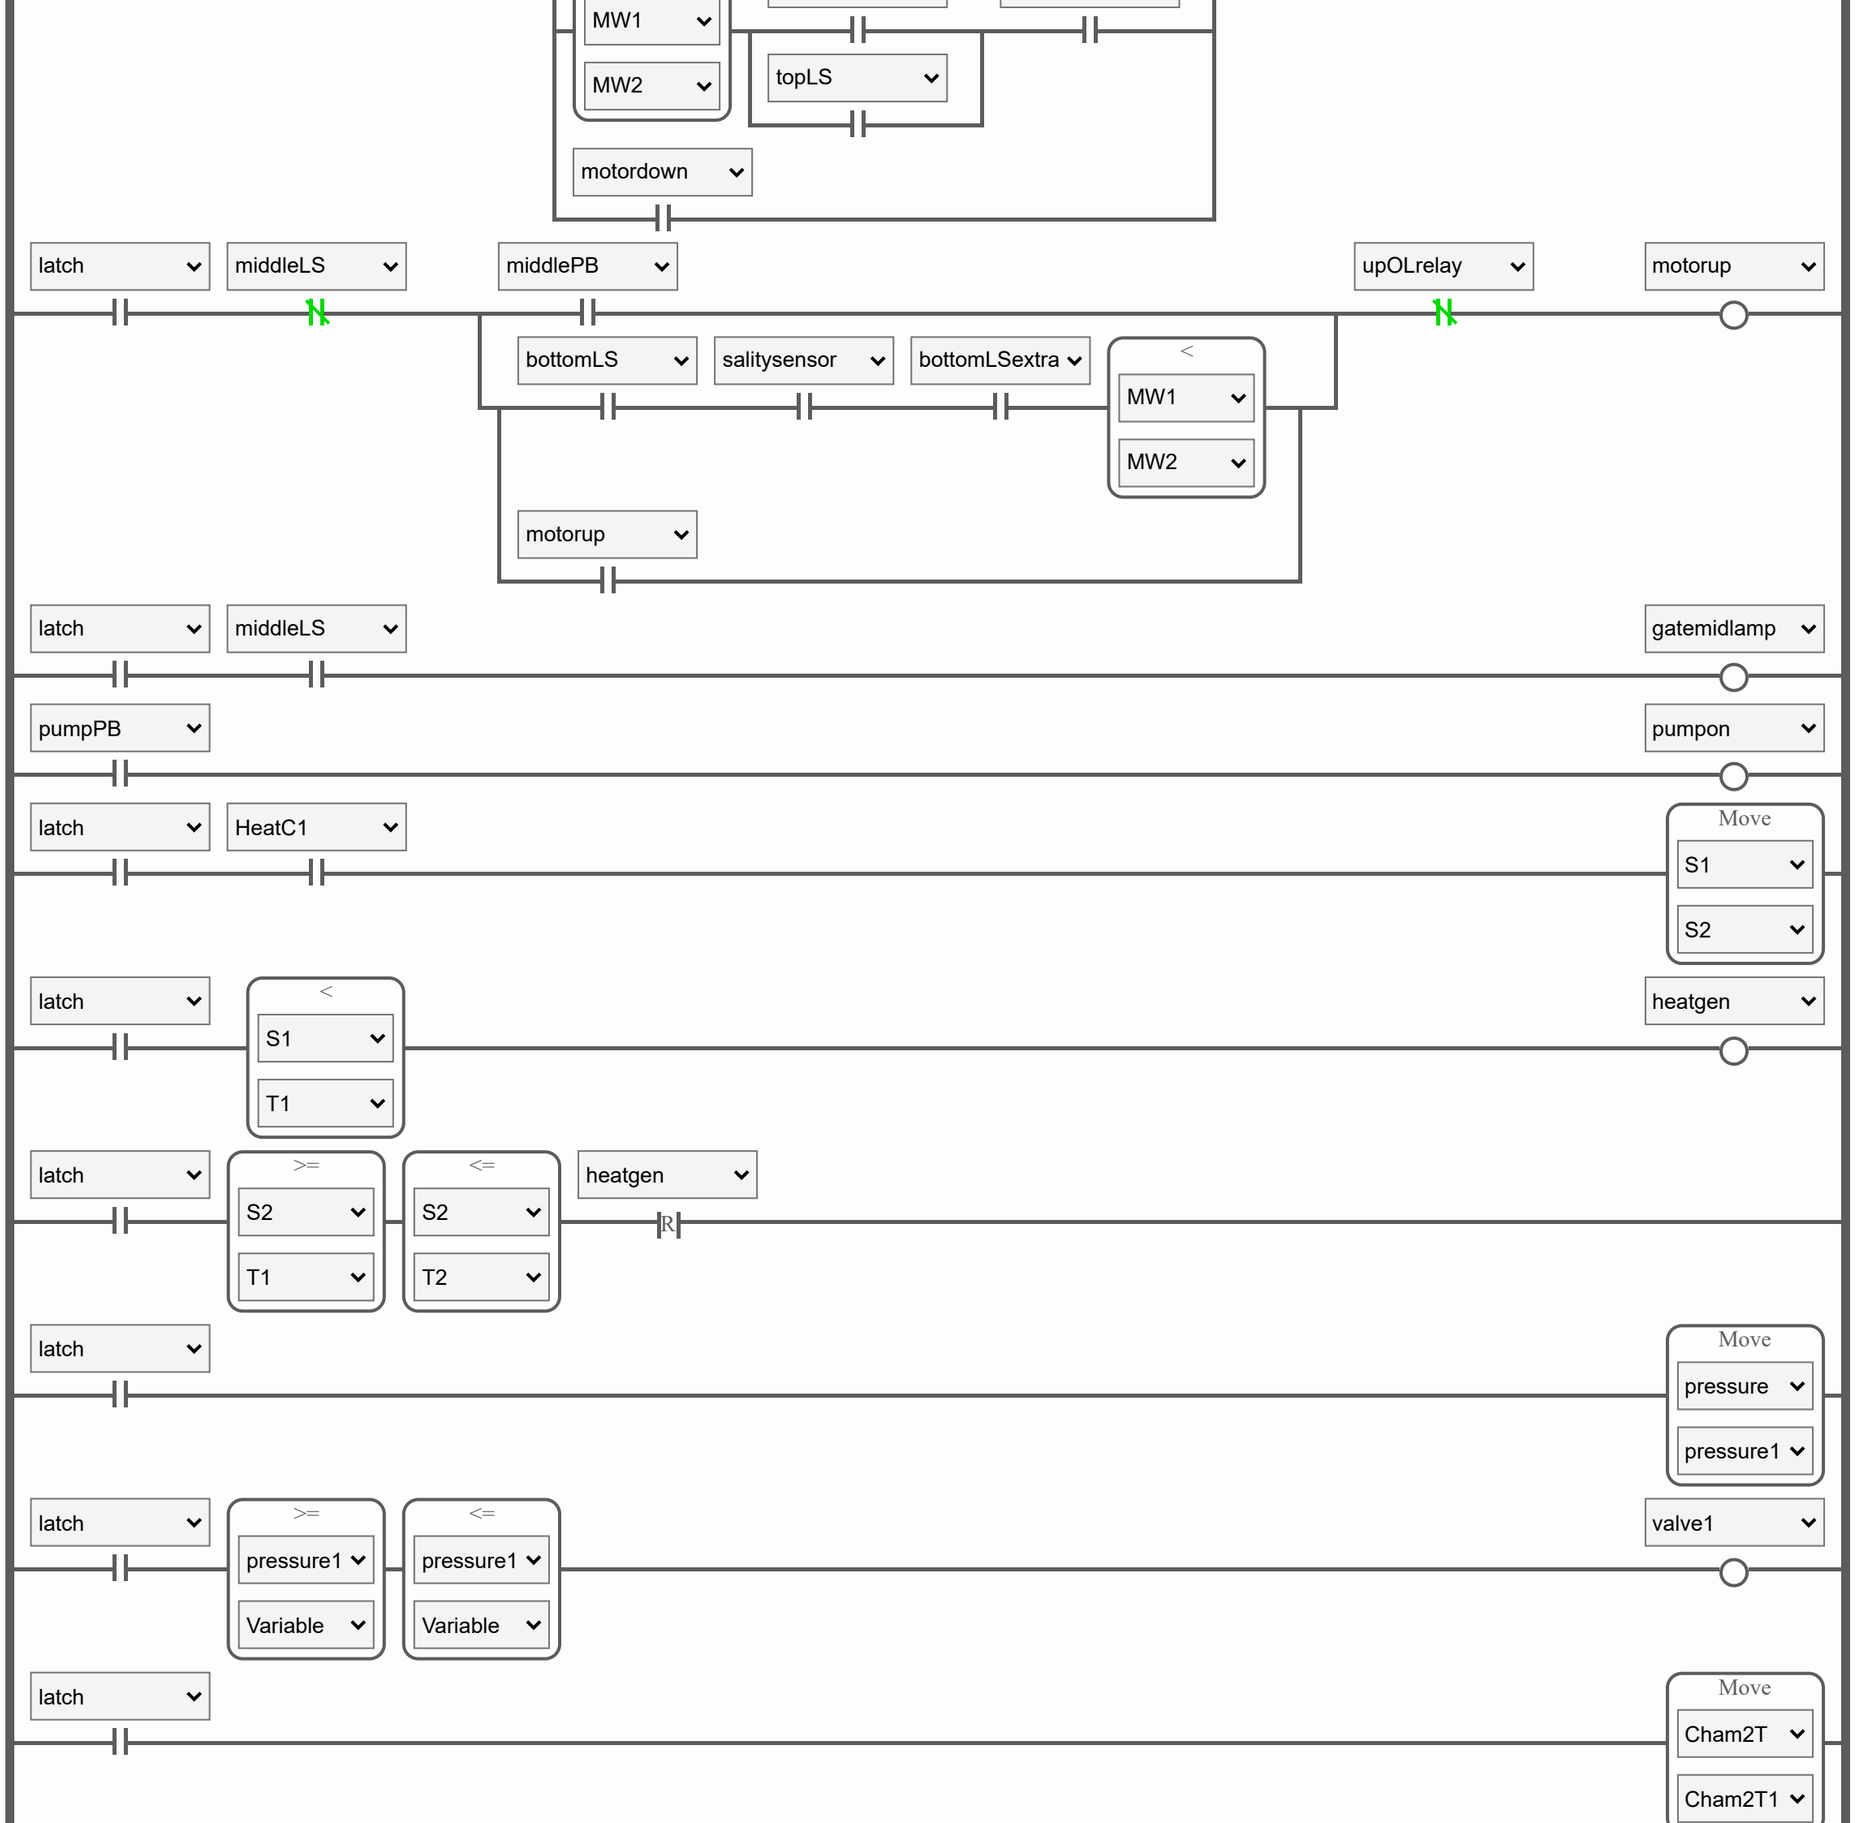

- Th 35
- cooling OFF
- valve2 OFF
- flowsens OFF
- flowsense 0
- flowsen 0
- S8 0
- temp1 OFF
- topLS1 OFF
- topex1 OFF
- motorup1 OFF
- upOLrelay1 OFF
- S9 0
- temp7 OFF
- S5 0
- S6 0
- botLS_ex OFF
- BotLS1 OFF
- downOLr1 OFF
- motordow1 OFF

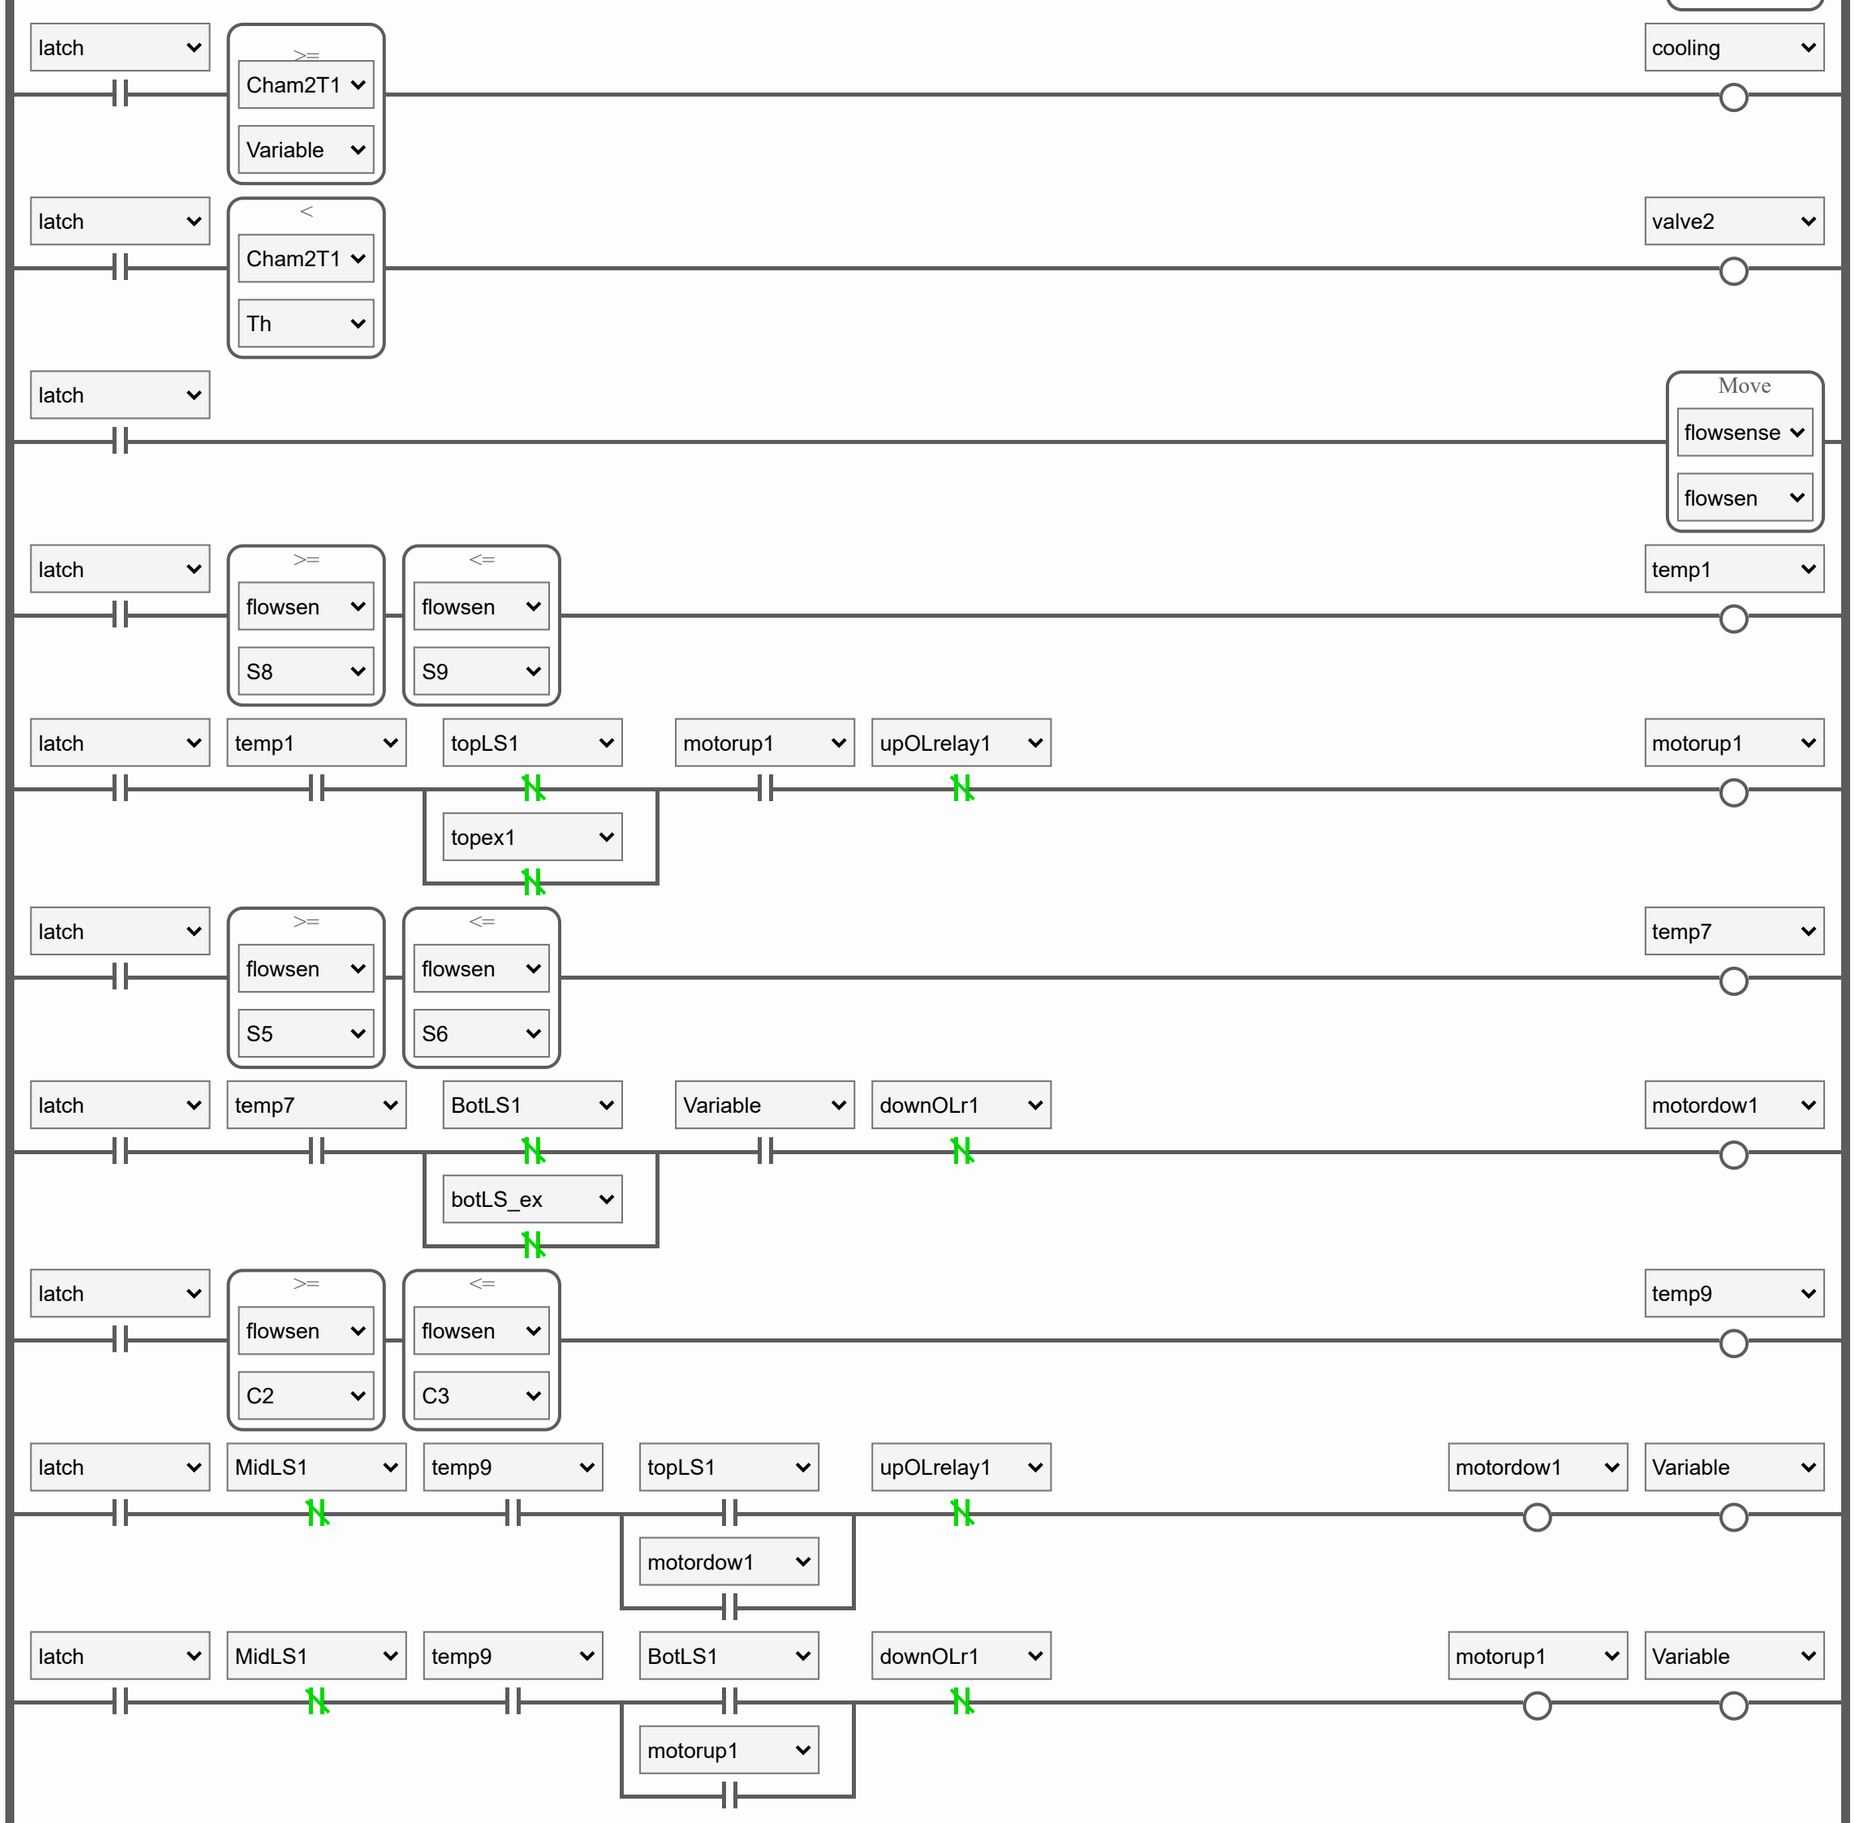

motordown1 OFF

C2 0

C3 0

temp9 OFF

MidLS1 OFF

Variable

Interested in advertising on PLC Fiddle? **Contact us** to get your name in front of thousands of controls engineers!