


原子基準 (水素, NIST ASD)

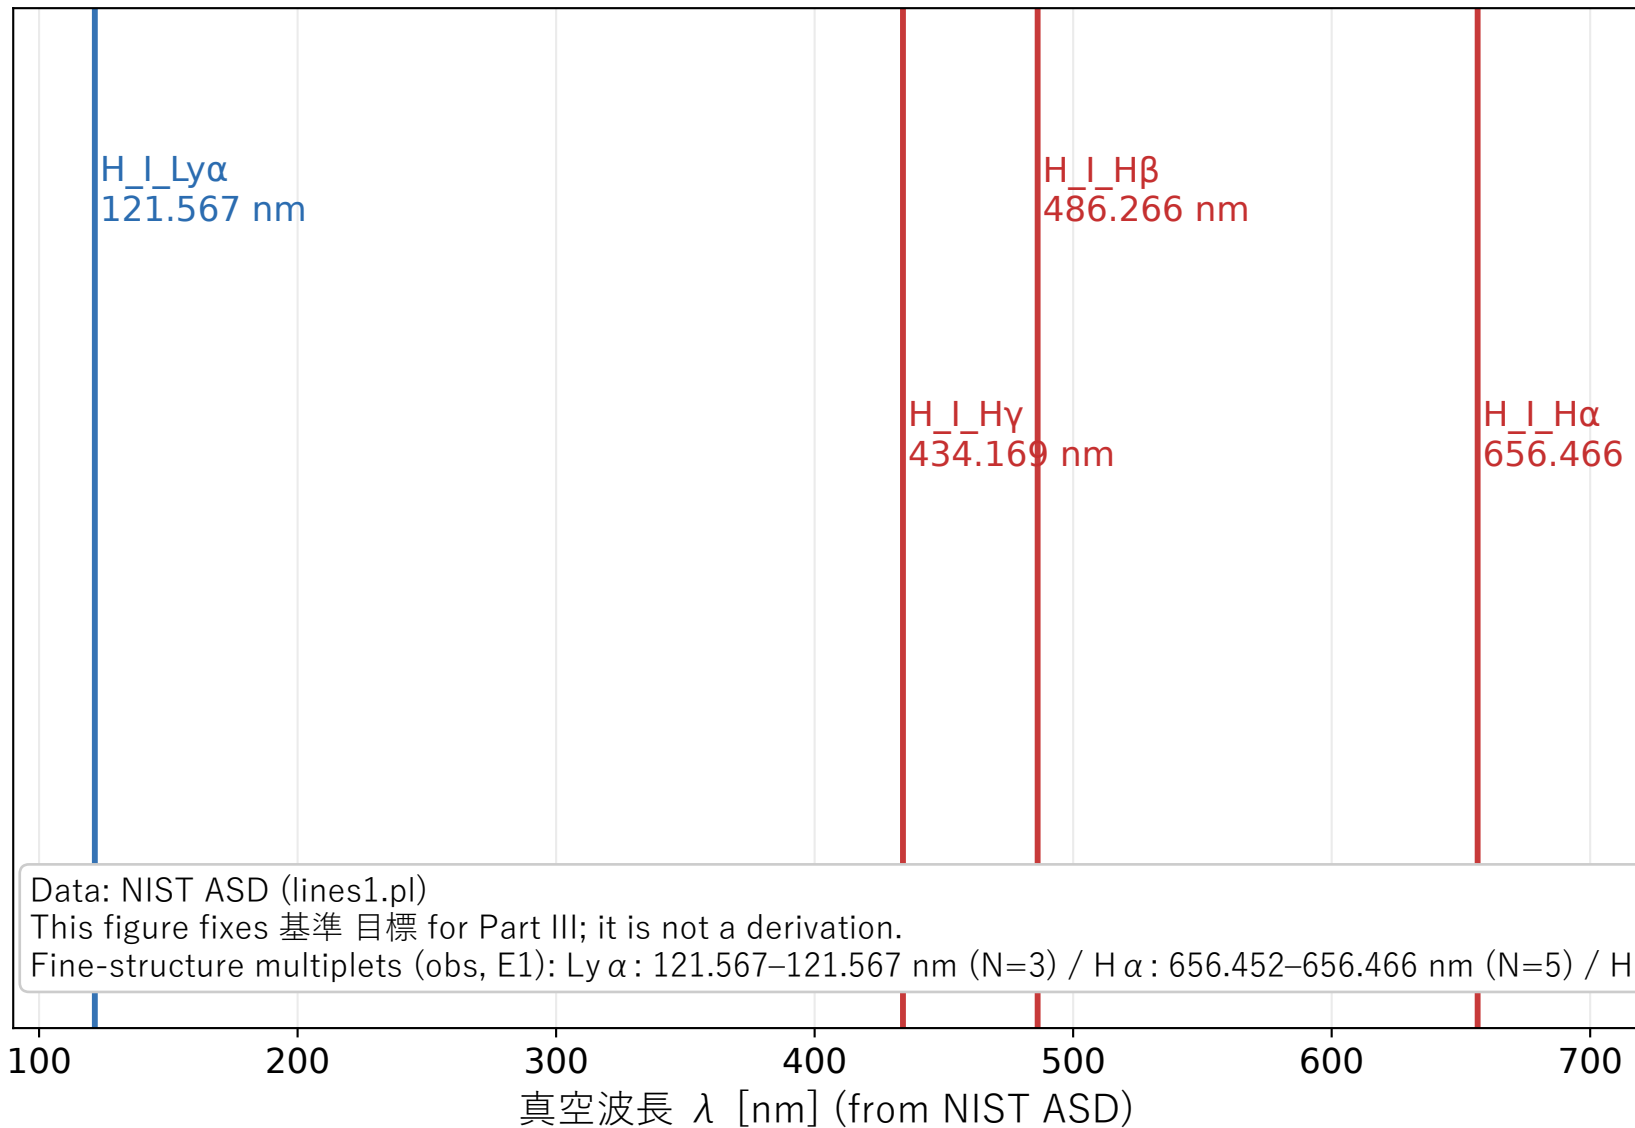

Data: NIST ASD (lines1.pl)

This figure fixes 基準 目標 for Part III; it is not a derivation.

Fine-structure multiplets (obs, E1): Ly α : 121.567–121.567 nm (N=3) / H α : 656.452–656.466 nm (N=5) / H β : 486.264–486.270 nm (N=3)