



Indoor Temperatures, Realised and Baseline Demand, Autumn 20.11.


Morning - Indoor temperatures

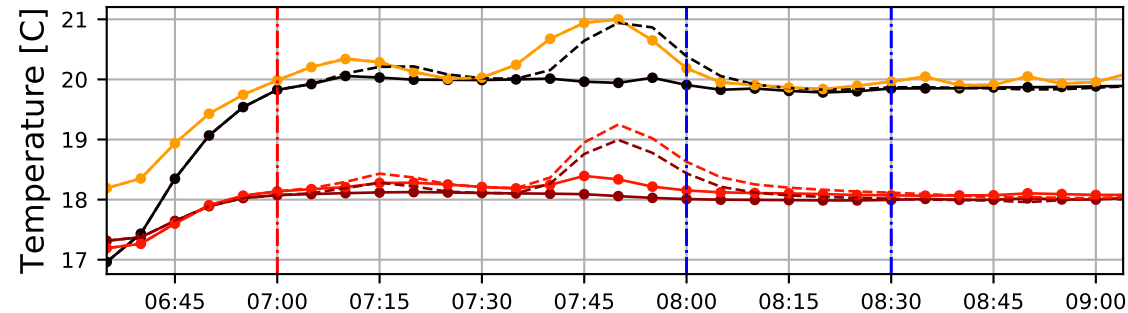


Afternoon - Indoor temperatures

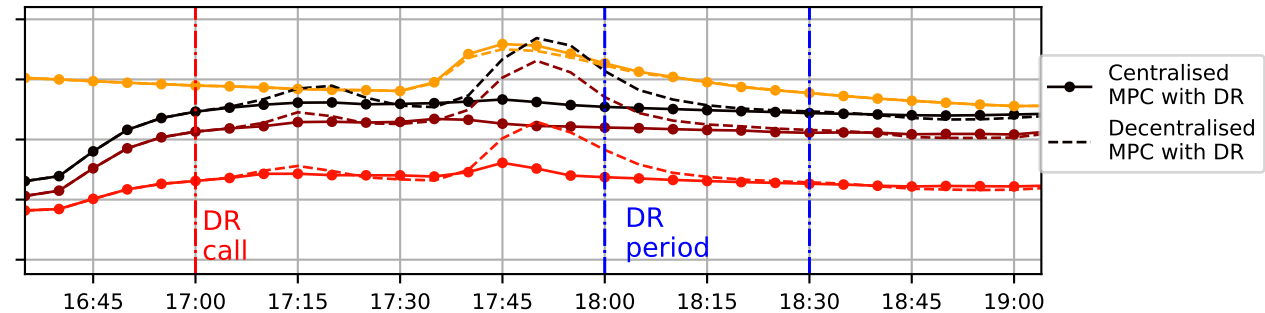


Aggregated Electricity Demand - RBC and Energy Minimisation

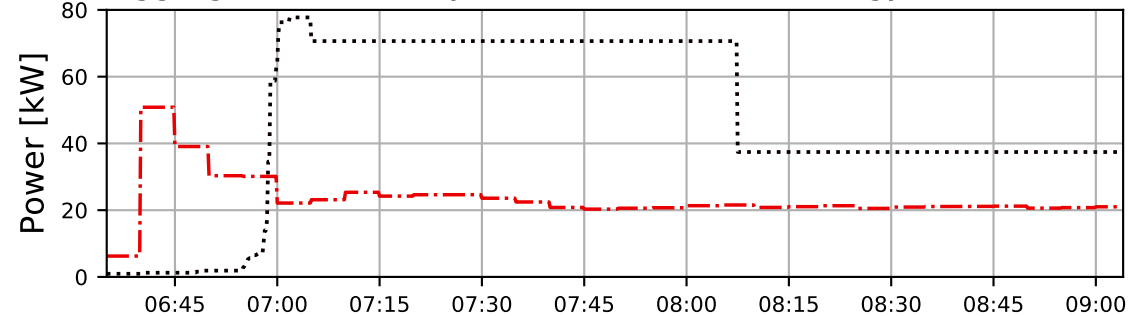

Aggregated Electricity Demand - RBC and Energy Minimisation

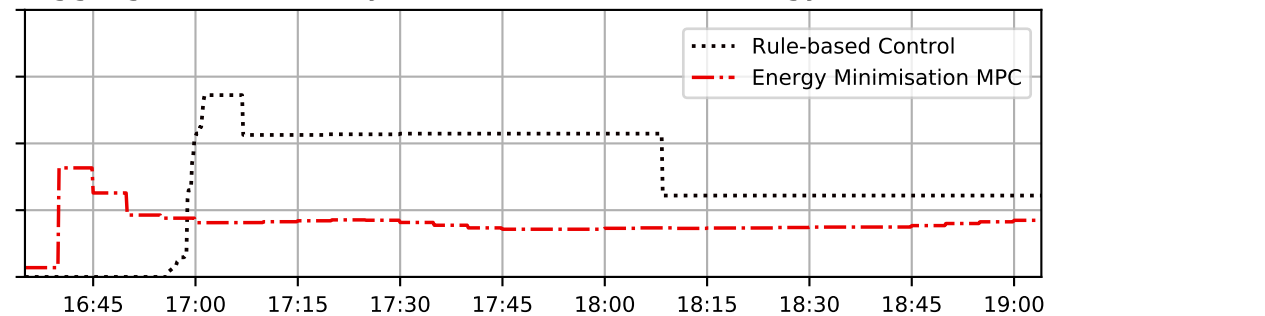

Aggregated Electricity Demand - MPC with DR

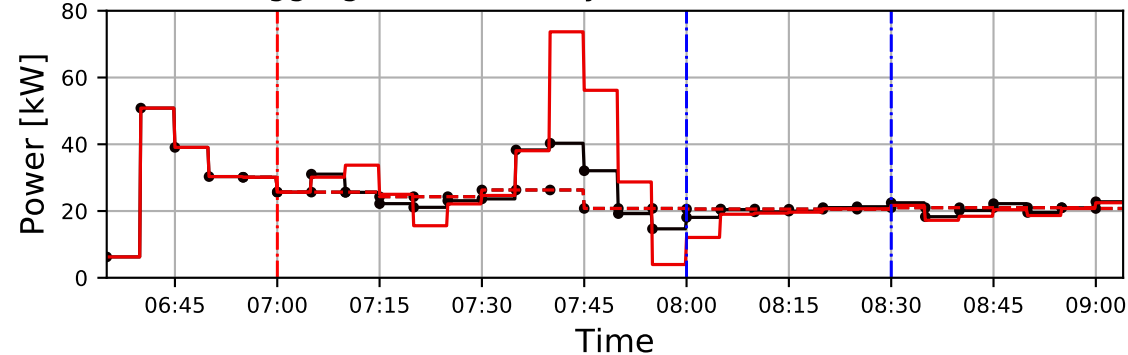

Aggregated Electricity Demand - MPC with DR

